

CAAVU
Uncased Evaporator Coil
Puron Advance™ R-454B, 1½ thru 5 Ton



Product Data

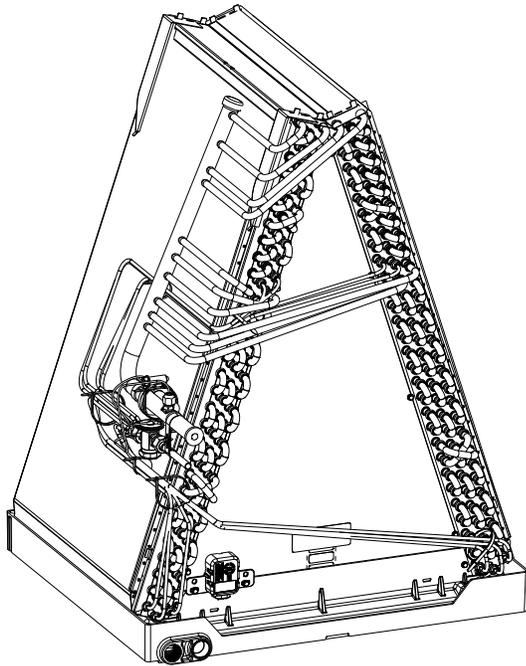


Fig. 1 – CAAVU

A240150A

Durable Condensate Pan

The corrosion-resistant drain pan, for vertical application, is designed in a “fiberglass reinforced thermoset polyester” material (FRTP) that offers unsurpassed pan strength. It is engineered with a proper slope to help ensure water drainage, improved moisture removal, and home comfort.

Refrigerant Connections

Provided with industry proven sweat connections for leak-free operation to maintain system reliability. The side mounting tubing to the coil slabs allows for easy cleaning/servicing of the coils, as well as easy access to the TXV.

Dissipation System

All models are shipped with a complete A2L (R-454B) dissipation system, which is required for installation.

Table 1 – Dissipation Parts List

Component	Location
Refrigerant Sensor	Factory Installed
Sensor Wire Harness	Factory Installed
Leak Dissipation Control Board	Parts Box
Dissipation Board Housing	Parts Box
Power Wire Harness	Parts Box

Burst Pressure

Meets or exceeds burst pressure of 2100 psi, which is at least three to five times the pressure it would see in actual application.

Serviceability

Comes with a “split delta plate” for easy, quick access to the coil for service and cleaning. Also, after the door is removed, the coil is removable from the front of the unit without use of any tools.

WARRANTY

- Default 5-year parts limited warranty:
 - 10-year parts limited warranty with timely registration*.
 Equipment must be registered within 90 days of original installation, except in jurisdictions where warranty benefits cannot be conditioned on registration.
- * Applies to original purchaser/homeowner and not available to subsequent owners, except in jurisdictions where laws dictate otherwise.

See Warranty certificate for complete details and restrictions.



A200449A

The CAAVU evaporator coil incorporates proven standards for reliable system operation and performance throughout the life of this quality Air Conditioner or Heat Pump system. These quality evaporator coils, manufactured and installed as part of a total comfort system, provide AHRI-rated performance ratings and are additionally listed with UL and c-UL.

This coil is available for use with Puron Advance Refrigerant only. It is a uncased A-coil that can be housed in any matched pre-installed cabinet or any custom built plenum. This uncased A-coil offers the most in installation application flexibility; one coil for a variety of applications with fewer SKUs to stock.

DESIGN FEATURES

Performance

Designed with performance in mind, this new A-coil offers low pressure drops to enhance system performance and airflow characteristics.

Thermostatic Expansion Valves (TXV)

All coils have refrigerant-specific, factory-installed TXVs.

MODEL NUMBER NOMENCLATURE

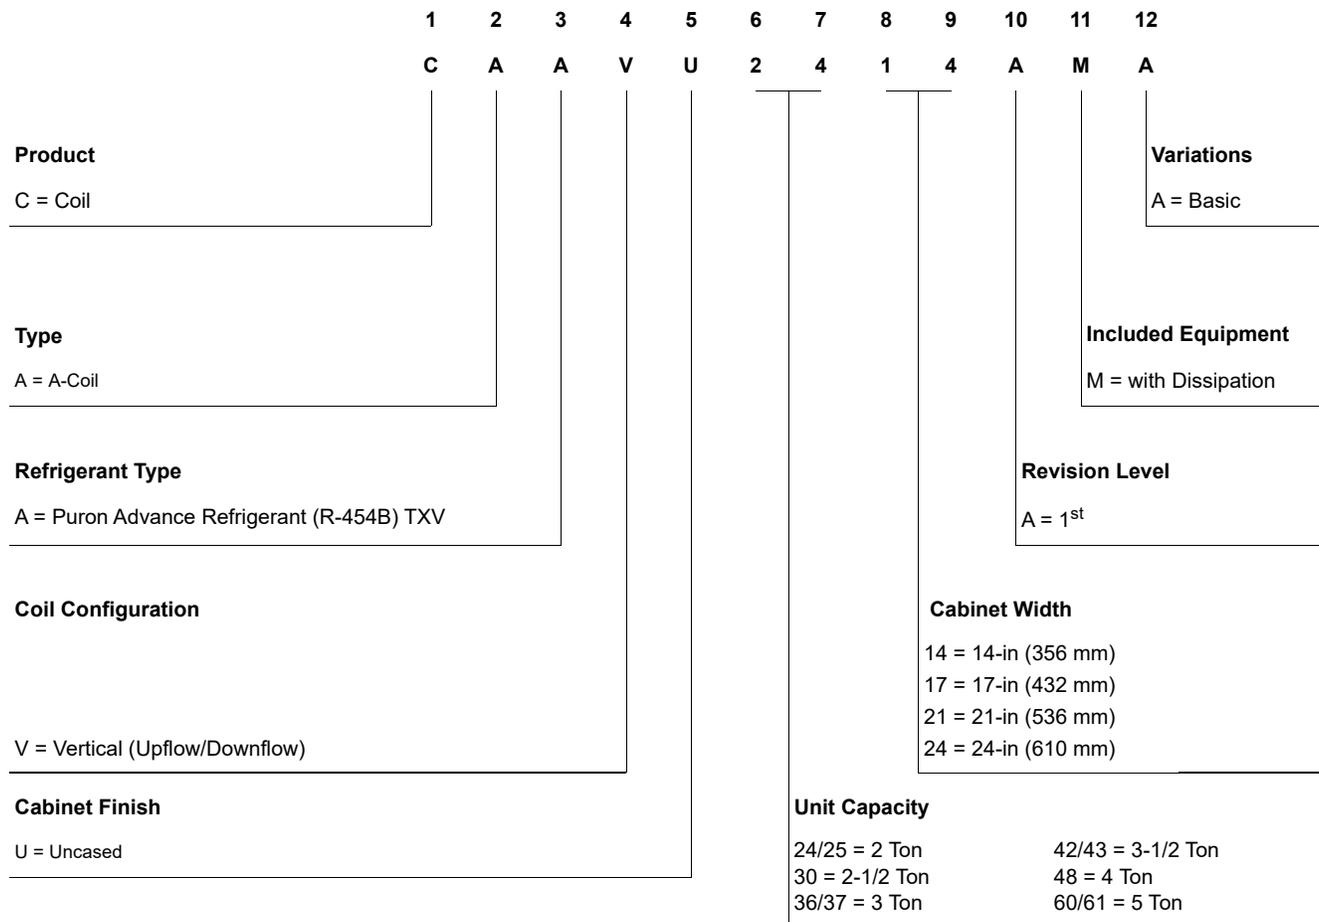


Table 2 – Accessories

PART NUMBER	DESCRIPTION
ACAWHNDIS01A	Alternate Wire Harness/Relay Kit — Y-signal airflow
ACAINTDIS10A	CNN / Communicating Plug (10-pack)

DIMENSIONS

Table 3 – Dimensions

MODEL #	A (HEIGHT)		B (WIDTH)		C (SUCTION LINE DIAMETER)		OPERATING WEIGHT		SHIPPING WEIGHT		SHIPPING HEIGHT		SHIPPING WIDTH		SHIPPING DEPTH	
	INCH	MM	INCH	MM	INCH	MM	Lbs	Kgs	Lbs	Kgs	INCH	MM	INCH	MM	INCH	MM
CAAVU2414AMA	17-3/4	450.8	13	330.2	5/8	15.9	24.5	11.1	28.5	12.9	18-5/8	472.5	15-1/8	384.4	23-3/4	603.1
CAAVU2417AMA	17-1/4	438.2	16-5/16	414.4	5/8	15.9	27.0	12.2	31.0	14.1	18-1/8	459.7	18-7/16	468.5	23-3/4	603.1
CAAVU3014AMA	21-7/8	555.6	13	330.2	3/4	19.1	29.0	13.2	35.0	15.9	22-3/4	576.9	15-1/8	384.4	23-3/4	603.1
CAAVU3017AMA	21-7/16	544.5	16-5/16	414.4	3/4	19.1	29.0	13.2	35.0	15.9	22-1/4	566.0	18-7/16	468.5	23-3/4	603.1
CAAVU3617AMA	23-9/16	598.5	16-5/16	414.4	3/4	19.1	32.5	14.7	38.5	17.5	24-3/8	618.9	18-7/16	468.5	23-3/4	603.1
CAAVU3717AMA	23-9/16	565.2	16-5/16	414.4	3/4	19.1	30.5	13.8	38.5	17.5	22-1/4	566.0	18-7/16	468.5	23-3/4	603.1
CAAVU4221AMA	25-1/16	636.6	19-13/16	503.2	7/8	22.2	34.0	15.4	42.0	19.0	25-15/16	658.5	21-15/16	557.4	23-3/4	603.1
CAAVU4821AMA	25-5/16	643.0	19-13/16	503.2	7/8	22.2	43.0	19.5	51.0	23.1	26-3/16	664.4	21-15/16	557.4	23-3/4	603.1
CAAVU6024AMA	31-1/16	789.0	23-5/16	592.2	7/8	22.2	51.0	23.1	59.0	26.8	31-7/8	810.1	25-7/16	646.3	23-3/4	603.1
CAAVU6121AMA	31-1/2	800.1	19-13/16	503.2	7/8	22.2	55.5	25.2	63.5	28.8	32-3/8	823.0	21-15/16	556.3	23-3/4	603.1

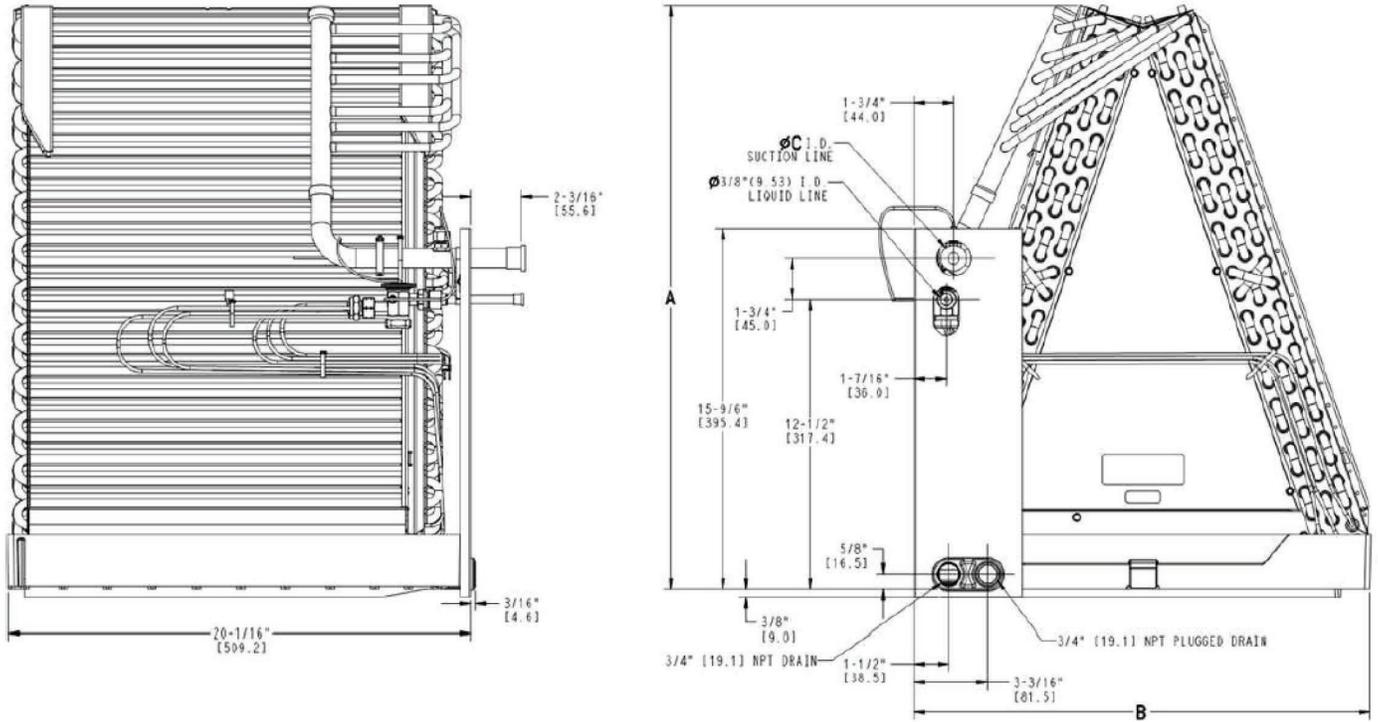


Fig. 2 – A-Coil, Side and End Views

A240239

PERFORMANCE DATA

Definitions

EWB - Entering Wet Bulb (°F)

TC - Total Cooling Capacity (1000 Btuh)

MBH - 1000 Btuh

CFM - Cubic Feet Per Minute

LWB - Leaving Wet Bulb (°F)

BF - Bypass Factor

SNC - Sensible Heat Capacities (1000 Btuh)

Table 5 – COOLING CAPACITIES (MBH) - R-454B Refrigerant

INDOOR COIL AIR		SATURATED TEMPERATURE LEAVING EVAPORATOR (deg F)														
		35			40			45			50			55		
CFM	EWB	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF
SIZE 2414																
600	72	42.71	20.16	0.00	39.29	18.26	0.00	34.54	16.29	0.12	28.99	14.08	0.07	22.76	11.76	0.05
	67	35.46	21.13	0.05	31.42	19.03	0.08	26.84	17.11	0.05	20.41	14.46	0.04	14.53	12.11	0.05
	62	28.34	21.84	0.04	23.46	19.50	0.04	19.20	17.45	0.05	16.22	15.51	0.11	13.30	13.30	0.24
800	72	50.80	23.51	0.00	45.83	21.58	0.15	40.30	19.32	0.10	33.78	16.90	0.07	26.36	14.20	0.06
	67	42.04	25.31	0.10	37.00	23.11	0.08	31.24	20.69	0.07	25.05	18.24	0.06	17.83	15.38	0.07
	62	33.81	26.81	0.07	28.20	24.28	0.06	23.71	22.13	0.07	20.31	19.30	0.17	15.17	15.17	0.35
1000	72	56.29	26.08	0.00	50.85	24.10	0.16	44.57	21.81	0.10	37.39	19.20	0.08	29.27	16.21	0.10
	67	47.00	28.79	0.13	41.50	26.48	0.11	35.25	23.94	0.10	28.25	21.33	0.09	20.43	18.16	0.10
	62	37.81	31.17	0.08	32.66	28.60	0.10	27.98	26.51	0.10	23.59	23.39	0.21	18.70	18.66	0.36
SIZE 2417																
INDOOR COIL AIR		SATURATED TEMPERATURE LEAVING EVAPORATOR (deg F)														
		35			40			45			50			55		
CFM	EWB	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF
600	72	41.92	20.12	0.00	38.61	18.20	0.00	33.95	16.27	0.13	28.55	14.09	0.07	22.55	11.81	0.05
	67	34.46	21.05	0.02	30.87	19.09	0.06	25.99	16.93	0.05	20.49	14.59	0.05	14.64	12.37	0.03
	62	27.89	21.80	0.04	23.53	19.71	0.03	19.22	17.60	0.04	15.75	15.36	0.11	12.61	12.60	0.27
800	72	49.74	23.54	0.00	45.45	21.50	0.00	40.12	19.32	0.17	33.78	16.96	0.10	26.74	14.37	0.08
	67	40.87	25.28	0.07	36.58	23.09	0.09	30.92	20.70	0.08	24.52	18.05	0.07	17.72	15.43	0.07
	62	33.07	26.69	0.07	28.45	24.57	0.06	23.46	22.14	0.07	19.25	18.55	0.20	16.24	16.24	0.29
1000	72	54.66	26.18	0.17	50.59	24.01	0.00	44.51	21.81	0.16	37.72	19.30	0.12	29.96	16.54	0.10
	67	45.90	28.69	0.12	40.94	26.43	0.12	34.62	23.87	0.10	27.58	21.07	0.10	20.33	18.22	0.10
	62	37.21	31.08	0.09	32.40	28.71	0.09	27.13	26.12	0.10	22.58	21.60	0.26	19.09	19.09	0.33
SIZE 3014																
INDOOR COIL AIR		SATURATED TEMPERATURE LEAVING EVAPORATOR (deg F)														
		35			40			45			50			55		
CFM	EWB	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF
750	72	57.03	25.01	0.00	49.74	22.12	0.00	42.73	19.74	0.21	34.16	16.74	0.19	25.10	13.68	0.19
	67	46.11	26.66	0.22	39.31	23.88	0.20	31.62	20.90	0.19	23.57	18.06	0.18	16.77	14.95	0.23
	62	35.94	27.85	0.20	29.79	25.00	0.20	24.22	21.84	0.25	20.39	17.76	0.40	16.11	16.10	0.47
1000	72	66.94	28.61	0.00	58.87	26.21	0.39	49.42	23.06	0.27	39.59	19.71	0.25	28.87	16.22	0.24
	67	53.64	31.31	0.28	45.62	28.32	0.25	36.47	24.91	0.24	27.27	21.65	0.23	20.07	18.02	0.29
	62	42.05	33.66	0.24	35.14	30.20	0.26	29.64	26.28	0.33	24.65	21.39	0.46	19.50	19.50	0.51
1250	72	74.40	31.89	0.00	65.08	29.09	0.40	54.80	25.75	0.32	43.62	22.09	0.29	32.09	18.48	0.28
	67	59.78	35.34	0.32	50.44	31.95	0.30	40.22	28.29	0.28	30.34	24.80	0.27	22.89	20.51	0.35
	62	46.81	38.26	0.28	39.73	35.04	0.29	33.85	30.00	0.38	28.30	24.54	0.50	22.34	22.33	0.55

Table 5 – COOLING CAPACITIES (MBH) - R-454B Refrigerant (Continued)

INDOOR COIL AIR		SATURATED TEMPERATURE LEAVING EVAPORATOR (deg F)														
		35			40			45			50			55		
CFM	EWB	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF
SIZE 3017																
750	72	49.74	24.83	0.00	44.62	22.35	0.02	38.79	19.85	0.00	32.47	17.11	0.03	25.63	14.24	0.06
	67	40.63	26.03	0.02	35.63	23.30	0.06	30.08	20.51	0.08	23.63	17.62	0.09	16.94	14.75	0.10
	62	32.84	26.66	0.09	27.63	24.03	0.08	22.30	21.00	0.11	17.63	17.69	0.20	14.32	14.32	0.32
1000	72	60.34	30.13	0.04	54.05	27.13	0.08	47.21	24.09	0.09	39.53	21.00	0.08	31.17	17.60	0.10
	67	49.45	31.92	0.07	43.35	28.64	0.11	36.44	25.42	0.11	28.60	21.98	0.11	20.64	18.56	0.13
	62	39.94	33.09	0.12	33.54	29.92	0.11	27.38	26.48	0.14	22.45	22.18	0.26	18.30	18.29	0.35
1250	72	68.65	34.08	0.20	61.51	30.74	0.18	53.77	27.52	0.15	45.36	24.28	0.12	35.53	20.44	0.13
	67	56.43	36.68	0.12	49.63	33.19	0.14	41.67	29.68	0.14	32.60	25.92	0.13	23.74	21.96	0.15
	62	45.59	38.67	0.14	38.69	35.21	0.14	31.73	31.39	0.17	26.58	26.13	0.30	21.69	21.69	0.38
SIZE 3617																
900	72	58.80	29.94	0.00	52.66	27.09	0.01	45.84	24.01	0.04	38.24	20.53	0.10	29.94	16.93	0.15
	67	48.62	31.72	0.09	42.61	28.28	0.14	35.48	24.68	0.16	27.95	21.14	0.18	19.84	17.53	0.20
	62	39.51	32.39	0.17	33.23	29.17	0.17	26.73	25.43	0.20	21.09	21.19	0.29	17.63	17.63	0.37
1200	72	70.59	36.27	0.02	63.15	32.65	0.08	55.17	28.97	0.12	46.11	25.02	0.15	36.21	20.86	0.18
	67	58.47	38.44	0.15	51.26	34.50	0.18	42.95	30.49	0.19	33.55	26.24	0.20	24.14	22.04	0.22
	62	47.54	39.93	0.20	40.00	36.14	0.20	32.59	31.96	0.22	26.59	26.08	0.36	21.50	21.49	0.42
1500	72	79.63	40.70	0.13	71.33	36.90	0.15	62.40	32.97	0.17	52.62	28.83	0.19	41.19	24.19	0.21
	67	66.00	43.75	0.20	58.14	39.75	0.21	48.73	35.42	0.22	38.08	30.96	0.21	27.66	25.99	0.25
	62	53.82	46.64	0.22	45.77	42.24	0.23	37.68	37.43	0.26	31.20	30.54	0.40	25.34	25.33	0.45
SIZE 3717																
900	72	66.65	33.05	0.00	60.93	30.22	0.04	54.05	27.10	0.03	46.03	23.74	0.02	36.90	20.08	0.03
	67	55.27	34.55	0.00	49.07	31.31	0.03	41.77	27.91	0.03	33.81	24.16	0.05	25.02	20.56	0.05
	62	44.68	35.50	0.02	38.53	32.39	0.02	30.99	28.42	0.05	24.88	24.59	0.12	20.28	20.28	0.26
1200	72	81.37	39.91	0.00	74.09	36.64	0.00	65.83	33.17	0.08	56.34	29.38	0.05	45.34	25.20	0.04
	67	67.35	42.43	0.05	59.96	38.95	0.05	51.39	35.14	0.04	41.35	30.84	0.04	30.11	26.07	0.06
	62	54.64	44.55	0.04	47.11	40.76	0.04	38.25	36.01	0.07	31.46	31.03	0.17	26.37	26.37	0.28
1500	72	91.04	45.18	0.16	84.13	41.81	0.21	75.03	38.15	0.11	64.27	34.13	0.07	51.94	29.58	0.06
	67	76.61	49.14	0.07	68.41	45.44	0.06	58.82	41.32	0.05	47.61	36.71	0.05	34.77	31.00	0.08
	62	62.41	52.52	0.05	54.01	48.12	0.06	44.96	43.20	0.09	37.59	36.80	0.21	31.09	31.05	0.32

Table 5 – COOLING CAPACITIES (MBH) - R-454B Refrigerant (Continued)

INDOOR COIL AIR		SATURATED TEMPERATURE LEAVING EVAPORATOR (deg F)														
		35			40			45			50			55		
CFM	EWB	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF
SIZE 4221																
1050	72	78.40	36.36	0.22	68.20	31.94	0.27	57.99	27.82	0.30	46.52	23.44	0.32	34.24	19.06	0.33
	67	63.71	37.89	0.33	53.85	33.58	0.34	43.19	29.22	0.34	31.92	25.03	0.34	22.03	19.92	0.40
	62	50.25	39.90	0.33	41.12	34.98	0.36	33.36	29.77	0.43	27.10	23.56	0.55	21.00	20.99	0.59
1400	72	91.12	41.84	0.34	79.56	37.18	0.35	67.22	32.53	0.35	53.61	27.50	0.37	39.38	22.57	0.37
	67	73.95	44.58	0.38	62.18	39.66	0.38	49.76	34.77	0.38	36.63	29.75	0.38	26.49	23.80	0.46
	62	58.06	47.35	0.38	48.14	42.11	0.40	40.09	35.60	0.48	32.74	28.59	0.58	25.30	25.29	0.62
1750	72	100.61	46.28	0.40	88.04	41.37	0.40	74.33	36.44	0.39	59.32	30.95	0.40	43.14	25.43	0.41
	67	81.97	50.23	0.42	69.11	45.00	0.42	55.05	39.62	0.41	40.81	33.97	0.42	30.02	26.93	0.51
	62	64.42	53.63	0.42	54.08	47.83	0.45	45.72	40.31	0.53	37.76	33.49	0.60	28.91	28.90	0.65
SIZE 4821																
1200	72	82.04	40.07	0.00	75.60	36.07	0.00	66.14	32.53	0.00	56.22	28.73	0.13	44.82	24.36	0.09
	67	68.03	42.46	0.14	60.16	38.58	0.12	51.08	34.62	0.09	40.72	30.15	0.08	29.23	25.40	0.08
	62	54.60	44.52	0.08	46.59	40.50	0.08	37.39	35.62	0.10	30.81	30.90	0.18	24.92	24.92	0.30
1600	72	97.29	45.49	0.00	87.98	42.49	0.00	77.77	38.70	0.25	66.15	34.31	0.16	52.92	29.43	0.13
	67	79.77	50.48	0.18	70.77	46.47	0.15	60.33	42.02	0.12	48.42	37.06	0.11	34.93	31.41	0.12
	62	64.42	54.16	0.12	55.23	49.58	0.12	45.52	44.47	0.13	37.90	37.73	0.25	31.75	31.75	0.33
2000	72	106.47	50.88	0.00	97.26	47.53	0.00	86.30	43.51	0.24	73.62	38.88	0.18	59.03	33.65	0.16
	67	88.47	57.11	0.20	78.71	52.97	0.17	67.27	48.25	0.15	54.09	42.91	0.14	39.65	36.78	0.16
	62	71.67	62.45	0.14	61.88	57.22	0.15	52.51	52.34	0.17	44.33	43.77	0.30	37.31	37.31	0.37
SIZE 6024																
1500	72	106.04	51.76	0.00	95.27	46.50	0.00	82.97	41.13	0.18	69.58	35.69	0.09	54.31	29.74	0.08
	67	86.48	54.03	0.10	75.60	48.69	0.08	63.39	42.81	0.09	49.88	36.91	0.08	35.17	30.64	0.10
	62	68.57	55.62	0.07	57.67	49.76	0.09	46.75	43.90	0.11	37.68	37.72	0.18	30.68	30.68	0.30
2000	72	127.46	61.02	0.00	114.85	56.03	0.00	100.44	50.33	0.15	83.66	43.70	0.11	64.87	36.39	0.10
	67	104.42	65.55	0.15	91.43	59.54	0.13	76.54	52.85	0.12	59.95	45.84	0.11	42.58	38.67	0.12
	62	83.69	68.68	0.12	70.34	62.14	0.11	56.53	54.88	0.13	47.35	47.18	0.23	37.24	37.24	0.36
2500	72	144.87	68.38	0.00	129.80	63.34	0.00	113.88	57.34	0.19	95.13	50.25	0.14	73.98	42.26	0.13
	67	118.40	75.16	0.18	104.04	68.73	0.16	87.74	61.70	0.15	68.54	53.91	0.13	48.95	45.54	0.15
	62	95.41	80.19	0.15	80.55	72.86	0.14	66.30	65.12	0.17	57.24	53.79	0.33	43.33	43.33	0.40

Table 5 – COOLING CAPACITIES (MBH) - R-454B Refrigerant (Continued)

INDOOR COIL AIR		SATURATED TEMPERATURE LEAVING EVAPORATOR (deg F)														
		35			40			45			50			55		
CFM	EWB	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF	TC	SHC	BF
SIZE 6121																
1500	72	112.11	55.08	0.00	101.70	49.99	0.02	89.58	44.70	0.00	75.64	39.01	0.00	60.50	32.81	0.03
	67	92.62	57.34	0.00	81.73	51.72	0.03	69.28	45.84	0.04	55.22	39.68	0.04	40.13	33.48	0.05
	62	74.69	58.45	0.04	63.29	52.60	0.05	51.17	46.56	0.06	40.87	39.92	0.14	33.94	33.93	0.27
2000	72	136.71	66.82	0.00	123.80	60.91	0.11	109.34	54.72	0.07	93.11	48.24	0.05	74.27	41.10	0.05
	67	113.10	70.55	0.05	100.14	64.26	0.06	85.10	57.60	0.05	67.64	50.26	0.05	49.20	42.68	0.06
	62	91.55	73.55	0.05	77.91	66.58	0.06	63.46	59.20	0.08	52.22	50.85	0.18	42.81	42.72	0.31
2500	72	155.68	76.12	0.00	141.46	69.96	0.13	125.41	63.39	0.10	106.83	56.23	0.07	85.68	48.45	0.06
	67	129.41	81.91	0.08	114.66	75.25	0.07	97.99	67.94	0.07	78.43	59.92	0.06	57.24	51.14	0.08
	62	104.93	86.59	0.07	90.39	79.22	0.08	74.33	70.77	0.10	62.17	59.97	0.23	51.13	51.02	0.34

Coil Static Pressure Drop (IN. WC.) - R-454B Refrigerant

Table 6 – COIL STATIC PRESSURE DROP (IN. WC.) - R-454B REFRIGERANT

Unit Size	STANDARD CFM																						
	400	500	600	700	800	900	1000	1100	1200	1300	1400	1500	1600	1700	1800	1900	2000	2100	2200				
2414	Dry																						
	0.065	0.091	0.120	0.154	0.194	0.237	0.284																
	Wet																						
2417	0.066	0.094	0.124	0.161	0.203	0.250	0.301																
	Dry																						
	0.056	0.076	0.097	0.123	0.151	0.182	0.215																
3014	Wet																						
	0.060	0.082	0.105	0.132	0.163	0.195	0.231																
	Dry																						
3017	0.054	0.077	0.102	0.133	0.167	0.206	0.248	0.296	0.347														
	Wet																						
	0.059	0.084	0.111	0.142	0.181	0.223	0.269	0.319	0.375														
3617	Dry																						
	0.043	0.059	0.077	0.096	0.119	0.144	0.171	0.201	0.232														
	Wet																						
3717	0.046	0.063	0.083	0.105	0.130	0.157	0.186	0.219	0.252														
	Dry																						
	0.023	0.036	0.052	0.069	0.089	0.110	0.135	0.160	0.189	0.219	0.251												
4221	Wet																						
	0.042	0.058	0.076	0.095	0.117	0.142	0.169	0.198	0.231	0.265	0.299												
	Dry																						
4821	0.077	0.099	0.124	0.152	0.182	0.216	0.253	0.294	0.338														
	Wet																						
	0.088	0.113	0.137	0.170	0.209	0.247	0.287	0.326	0.368														
6024	Dry																						
			0.044	0.056	0.068	0.082	0.099	0.119	0.138	0.161	0.183	0.205	0.233										
	Wet																						
6121			0.058	0.073	0.089	0.106	0.125	0.143	0.165	0.189	0.213	0.239	0.268										
	Dry																						
			0.055	0.072	0.089	0.107	0.128	0.150	0.175	0.199	0.228	0.257	0.288	0.321	0.356								
6121	Wet																						
			0.058	0.075	0.094	0.115	0.136	0.161	0.188	0.217	0.247	0.279	0.313	0.347	0.386								
	Dry																						
6121					0.073	0.083	0.095	0.107	0.120	0.136	0.152	0.169	0.184	0.203	0.217	0.238	0.260	0.283	0.307				
	Wet																						
					0.076	0.086	0.098	0.110	0.124	0.140	0.157	0.175	0.193	0.215	0.238	0.261	0.286	0.314	0.342				
6121	Dry																						
						0.111	0.133	0.153	0.163	0.204	0.234	0.262	0.293	0.326	0.366	0.392	0.437	0.48	0.52				
	Wet																						
6121						0.13	0.15	0.183	0.21	0.245	0.28	0.32	0.355	0.4	0.435	0.48	0.525	0.57	0.63				
	Dry																						
							0.13	0.15	0.183	0.21	0.245	0.28	0.32	0.355	0.4	0.435	0.48	0.525	0.57	0.63			

Cooling Capacity Notes

NOTE:

1. Contact manufacturer for cooling capacities at conditions other than shown in the table.
2. Formulas:
 Leaving db = entering db - $\frac{\text{sensible heat cap.}}{1.09 \times \text{CFM}}$
 Leaving wb = wb corresponding to enthalpy of air leaving coil (hlwb)

$$\text{hlwb} = \text{hewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{CFM}}$$
 Where hewb = enthalpy of air entering coil.
 Direct interpolation is permissible. Do not extrapolate.
3. SHC is based on 80°F (27°C) db temperature of air entering coil. Below 80°F (27°C) db, subtract (Correction Factor x CFM) from SHC. Above 80°F (27°C) db, add (Correction Factor x CFM) to SHC.
4. Bypass Factor = 0 indicates no psychometric solution. Use bypass factor of next lower EWB for approximation.
5. Fan motor heat has not been deducted.
6. All data points are based on 10°F superheat leaving coil and use of thermostatic expansion valve (TXV) device.
7. All units have sweat suction-tube connection and a liquid-tube connection. For 1-1/8-in. system suction tube, 3/4 x 1-1/8 in. suction tube connection adapter is available as accessory.
8. The WLAU**4 coils can be used in any properly designed system using R-410A refrigerant.
9. The WLAU**2 coils can be used in any properly designed system using R-22 refrigerant.
10. Before using maximum CFM shown in table, check coil static pressure drop to ensure system blower can provide necessary static pressure needed for coil and duct systems.
11. Bypass Factor = 0 indicates no psychometric solution. Use bypass factor of next lower EWB for approximation.

BYPASS FACTOR	ENTERING AIR DRY BULB TEMPERATURE °F					
	79	78	77	76	75	Under 75
	81	82	83	84	84	Above 85
Correction Factor						
010	0.98	1.96	2.94	3.92	4.91	Use formula shown below
0.20	0.87	1.74	2.62	3.49	4.36	
0.30	0.76	1.53	2.29	3.05	3.82	

Interpolation is permissible.
 Correction Factor = 1.09 x (1 - BF) x (db - 80)