




JAY R. SMITH MFG. CO.
DIVISION OF SMITH INDUSTRIES, INC.
POST OFFICE BOX 3237
MONTGOMERY, ALABAMA 36109-0237 (USA)
TEL: 334-277-8520 FAX: 334-272-7396 www.jrsmith.com



LOCATION

ADJUSTABLE FIXTURE SUPPORTS FOR SIPHON JET WATER CLOSETS


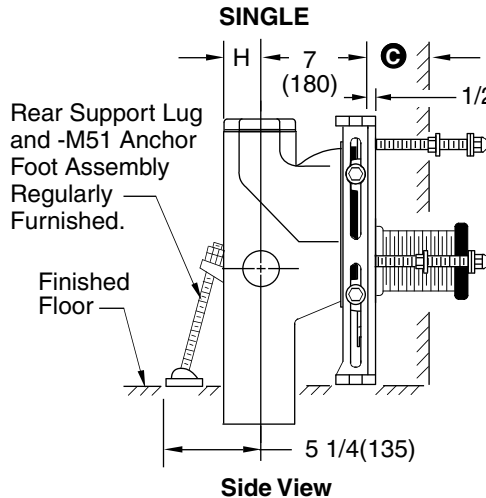


A SIZE	E	**F	H	J
4(100)	14(355)	5 1/4(135)	2 1/4(57)	9(230)
5(125)	11 1/2(290)	6 1/4(160)	2 3/4(70)	11 1/2(290)
6(150)	11 1/2(290)	6 1/4(160)	3 1/4(83)	11 1/2(290)

NOTE: Base support must be firmly anchored to floor with one 1/2"(13) bolt per base support provided by contractor.

NOTE: All single supports shall have the rear support lug anchored by the contractor to assure a rigid installation. The rear support completes the 3-point anchoring system for ultimate stability of the installation.

Fig. 0230Y (-M54-M58) . . . NO-HUB
Fig. 0230DY (-M54-M58) . . . NO-HUB DOUBLE

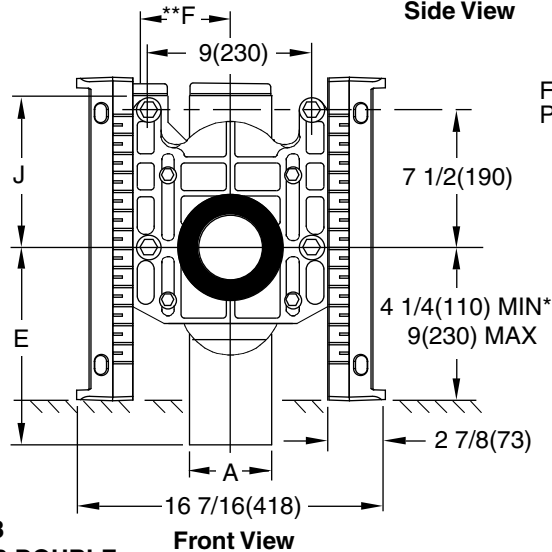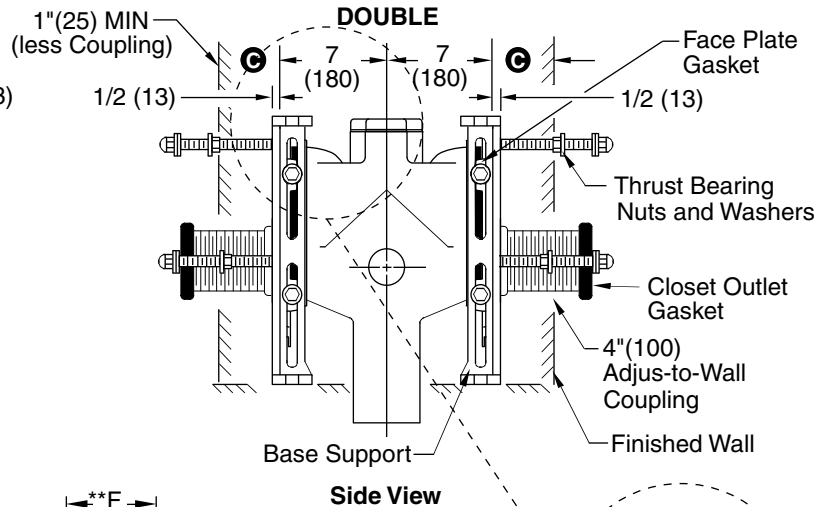


NOTE: When used with concealed flush valve locate face plate behind supply pipe.

NOTE: Shallower minimum rough-in dimension available to accommodate lower rough bowls. Specify dimension required.

NOTE: 1 1/2(38) or 2(51) NPT inlet available. Add suffix -N

*NOTE: 9"(230) core drilled hole is required for rough-in 4 1/4(110) thru 6 1/2(165)

**NOTE: "F" dimension is from centerline of vent to centerline of stack.

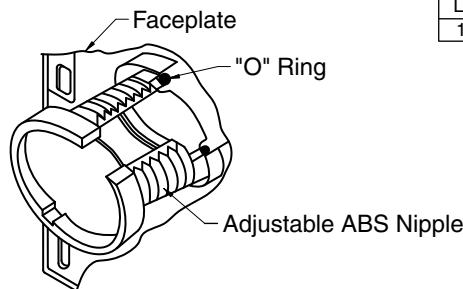

NOTE: Dimensions shown in parentheses are in millimeters.

NOTE: When nipple lengths between 3 1/4"(83) and 10 3/4"(275) are specified, the 10"(255) nipple will be supplied. The threaded end of nipple must be cut to specified length by others.

LENGTH	MIN.	MAX.
10(255)	9 3/4"(250)	10 3/4"(275)

*ABS (Regularly Furnished).

DRAWING NUMBER
0230Y (-M54-M58)

SIZE
A

SCALE:
NONE

DATE:
12/09/04

APPROVED BY:
AM

CHECKED BY:
AM

DRAWN BY:
JJ

0230Y (-M54-M58)

FIGURE
NUMBER

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

REV.	DATE	DESCRIPTION	BY	CKD. BY

WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER 0230Y (-M54-M58)