MATCO-NORCA
Global sourcing. National compliance. Local service.

90-deg Elbow、45-deg Elbow、Tee、Cross、Coupling&Cap

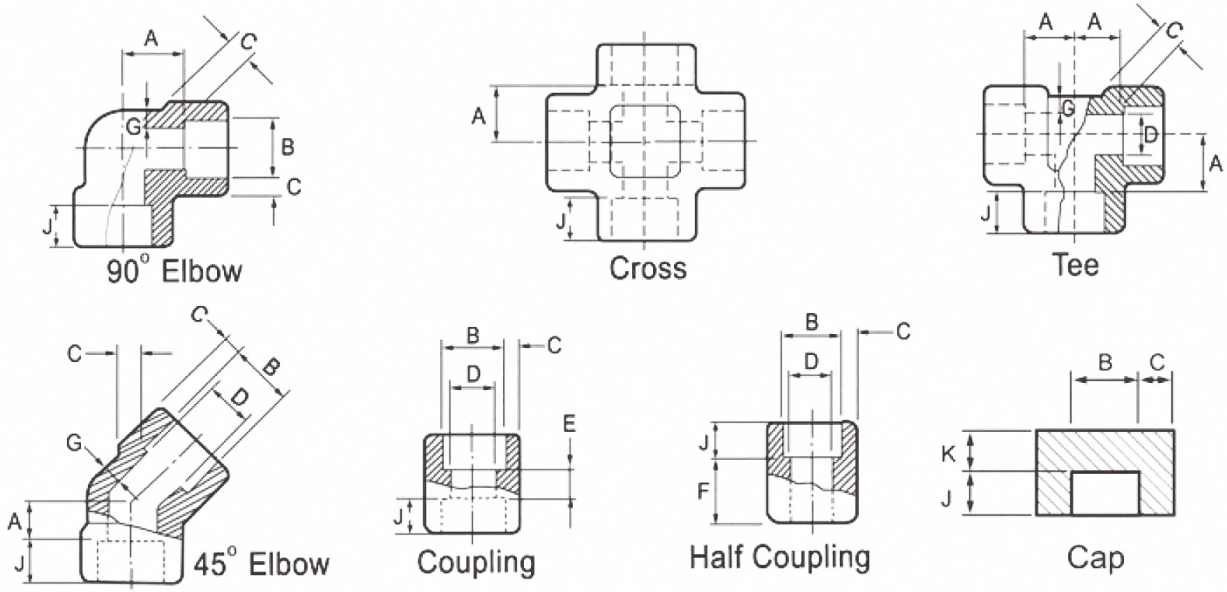

ASME B16.11

Nominal Pipe Size		Socket Bore Diameter B	Bore Diameter of Fittings,D[Note(2)]			Socket Wall Thickness,C[Note(3)]						Body Wall,G			Min. Depth of Socket, J	Center to Bottom of Socket,A						Laying Lengths		Tolerances,+			End Wall Thickness, Kmin.		
			Class Designation			Class Designation						Class Designation				90-deg Elbow, Tee,and Crosses			45-deg Elbow										
DN	NPS		3000	6000	9000	3000		6000		9000		3000	6000	9000		Class Designation						Couplings	Half Couplings	A	E	F	Class Designation		
						Avg.	Min.	Avg.	Min.	Avg.	Min.	Min.	Min.	Min.		3000	6000	9000	3000	6000	9000	E	F				3000	6000	9000
25	1"	34.3 33.9	27.4 25.9	21.5 19.9	16 14.4	5.69	4.98	7.92	6.93	11.4	9.96	4.55	6.35	9.09	12.5	23	27	32	14	18	21	12.5	28.5	2	4	2	9.6	11.2	14.2
32	1-1/4"	43.1 42.7	35.8 34.3	30.2 28.7	23.5 22	6.07	5.28	7.92	6.93	12.1	10.6	4.85	6.35	9.7	12.5	27	32	35	18	21	23	12.5	30	2	4	2	9.6	11.2	14.2
40	1-1/2"	49.2 48.8	41.6 40.1	34.7 33.2	28.7 27.2	6.35	5.54	8.92	7.8	12.7	11.1	5.08	7.14	10.2	12.5	32	38	38	21	26	26	12.5	32	2	4	2	11.2	12.7	15.7
50	2"	61.7 61.2	53.3 51.7	43.6 42.1	38.9 37.4	6.93	6.04	10.9	9.5	13.8	12.1	5.54	8.74	11.1	16	38	41	54	26	29	29	19	41	2	4	2	12.7	15.7	19
65	2-1/2"	74.4 73.9	64.2 61.2	- -	- -	8.76	7.67	-	-	-	-	7.01	-	-	16	41	-	-	29	-	-	19	43	2.5	5	2.5	15.7	19	-