
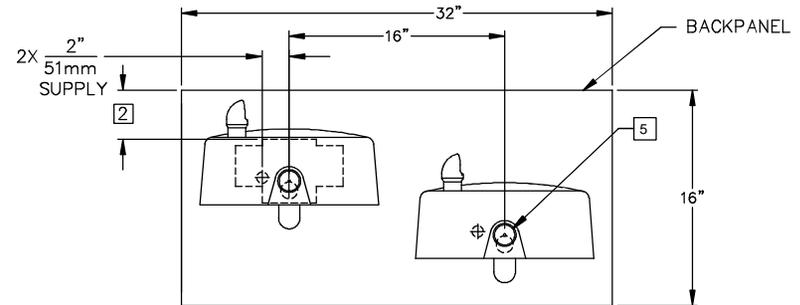
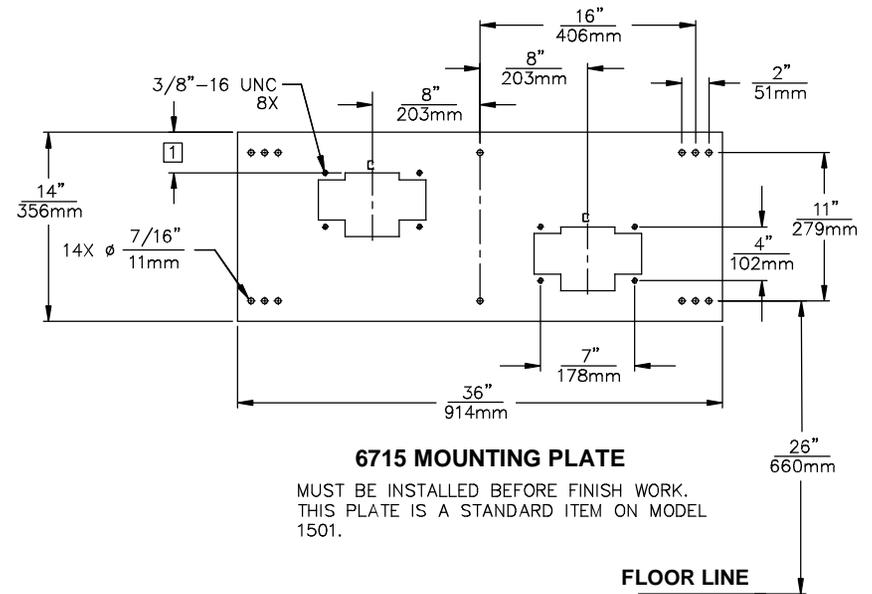


FINISH WALL OVER MOUNTING PLATE AND BEHIND BACKPANEL. BE CAREFUL THAT FINISHED WALL EXTENDS WITHIN THE HAWS BACKPANEL.

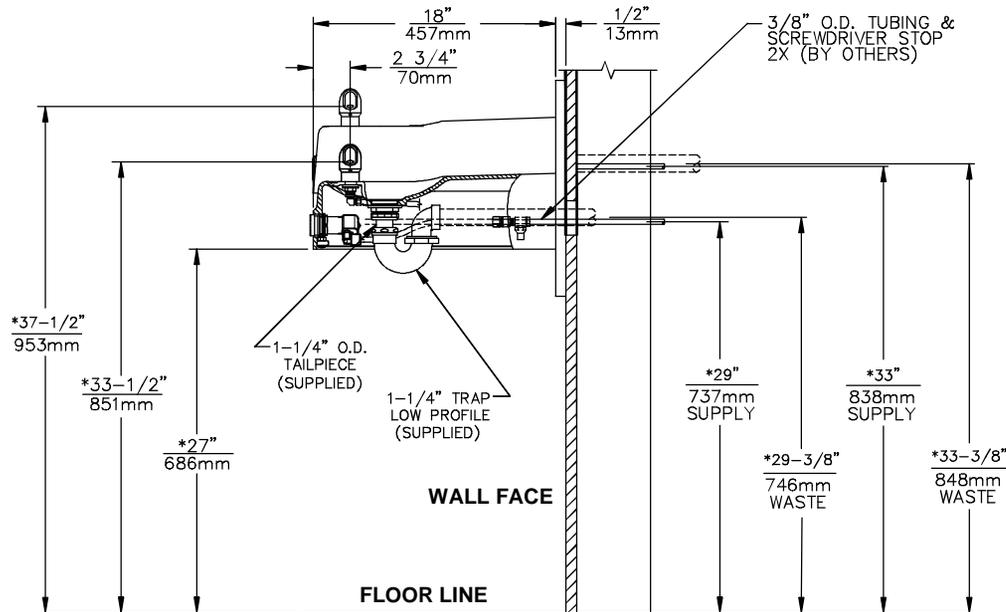


NOTES:


1. 3" DIM TO SLOTTED OPENING ON THE MOUNTING PLATE MUST BE ON THE TOP L.H. SIDE WHEN INSTALLED.
2. 4-5/16" DIM TO SLOTTED OPENING ON THE BACKPANEL MUST BE ON TOP L.H. SIDE WHEN INSTALLED.
3. HOLD ROUGH-IN DIMENSIONS ± 1/4" (6.4MM).
4. WHEN INSTALLING THIS UNIT, LOCAL, STATE, OR FEDERAL CODES SHOULD BE ADHERED TO. FOR INSTALLATION HEIGHTS OTHER THAN SHOWN, DIMENSIONS MARKED (*) MUST BE ADJUSTED ACCORDINGLY.
5. REFER TO 5874SS/VRK5874 OPERATION AND MAINTENANCE MANUAL FOR PUSH BUTTON AND VALVE INSTALLATION/MAINTENANCE INSTRUCTIONS.

1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWSCO.COM
WEBSITE: WWW.HAWSCO.COM

ECN NO. REVISED PER BY:		MODEL(S)		PART NUMBER	
ECN: 4733 HN		1501		0002076988.D	
DRAWN:	DATE:	CHK'D.:		DRAWING NO.:	REV
F. VASQUEZ	05/15/01			14939A00	10
APPROVED:	DATE:	SCALE: 1:14	DRAWING TYPE: INSTALLATION	SIZE: A	SHEET 1 OF 1

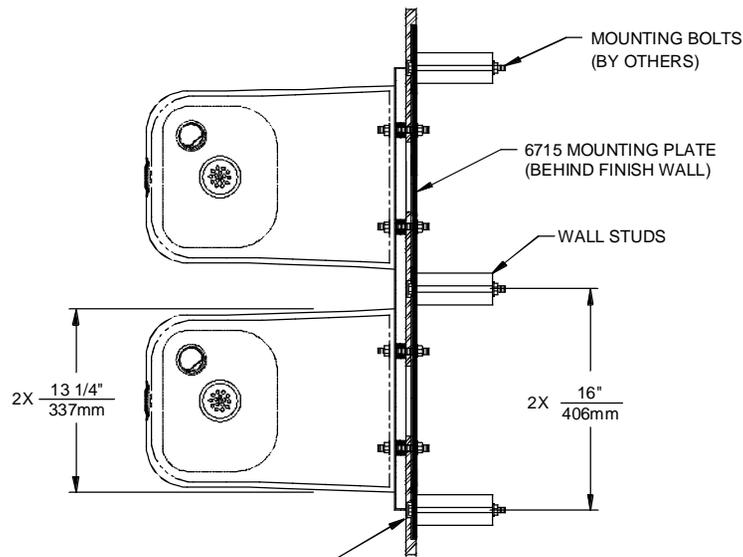


FINISH WALL OVER MOUNTING PLATE AND BEHIND BACKPANEL. BE CAREFUL THAT FINISHED WALL EXTENDS WITHIN THE HAWS BACKPANEL.

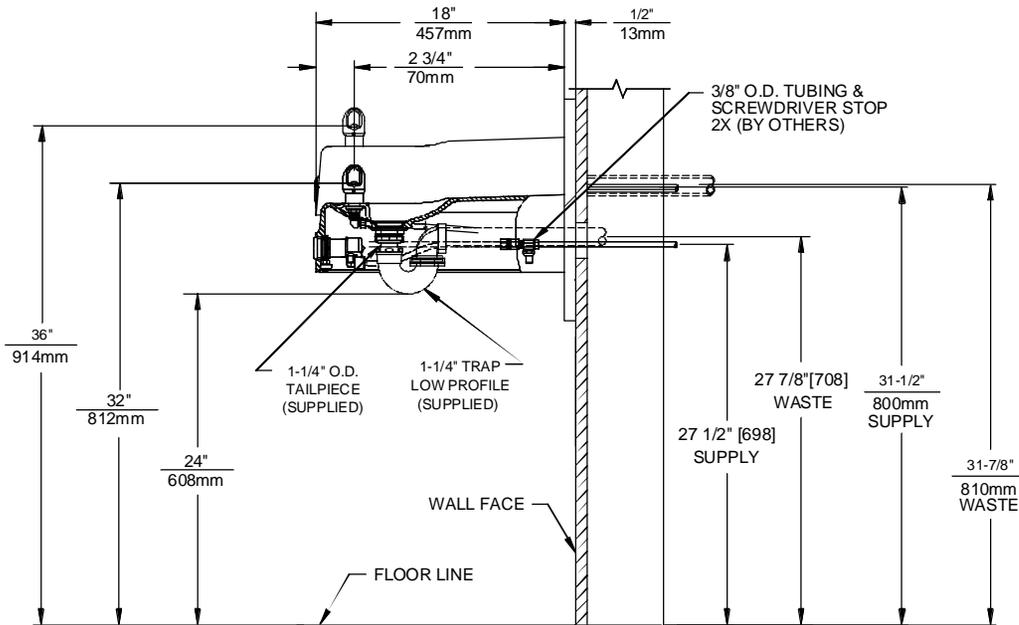

NOTES:


1. 3" DIM TO SLOTTED OPENING ON MOUNTING PLATE MUST BE ON TOP L.H. SIDE WHEN INSTALLED.
2. 4 5/16" DIM TO SLOTTED OPENING ON BACKPANEL MUST BE ON TOP L.H. SIDE WHEN INSTALLED.
3. HOLD ROUGH-IN DIMENSIONS $\pm 1/4"$ (6.4MM).
4. WHEN INSTALLING THIS UNIT, LOCAL, STATE, OR FEDERAL CODES SHOULD BE ADHERED TO. FOR INSTALLATION HEIGHTS OTHER THAN SHOWN, DIMENSIONS MARKED (*) MUST BE ADJUSTED ACCORDINGLY.
5. REFER TO 5874SS/VRK5874 OPERATION AND MAINTENANCE MANUAL FOR PUSH BUTTON AND VALVE INSTALLATION/MAINTENANCE INSTRUCTIONS.

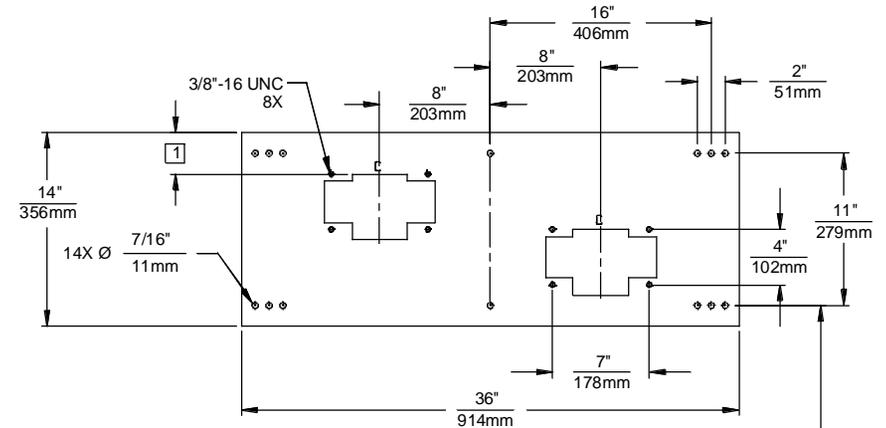

6715 MOUNTING PLATE



MUST BE INSTALLED BEFORE FINISH WORK. THIS PLATE IS A STANDARD ITEM ON MODEL 1501.

FLOOR LINE

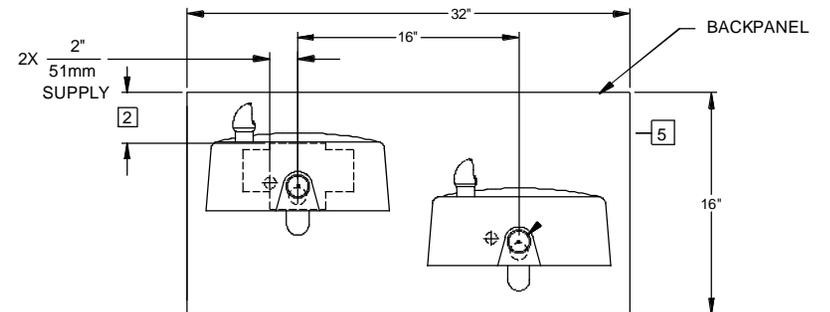


1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWSCO.COM
WEBSITE: WWW.HAWSCO.COM

ECN NO.	REVISED PER ECN:	BY: VWC	MODEL(S)	PART NUMBER
DRAWN: VWC	DATE: 10/25/12	CHKD.:	<p>1501 CHILD ADA HEIGHT (24" - 32")</p>	<p>2-SP</p>
APPROVED:	DATE:			<p>DRAWING NO. 16231A</p>
			SCALE: 1:14	DRAWING TYPE: INSTALLATION
			SIZE: A	SHEET 1 OF 1

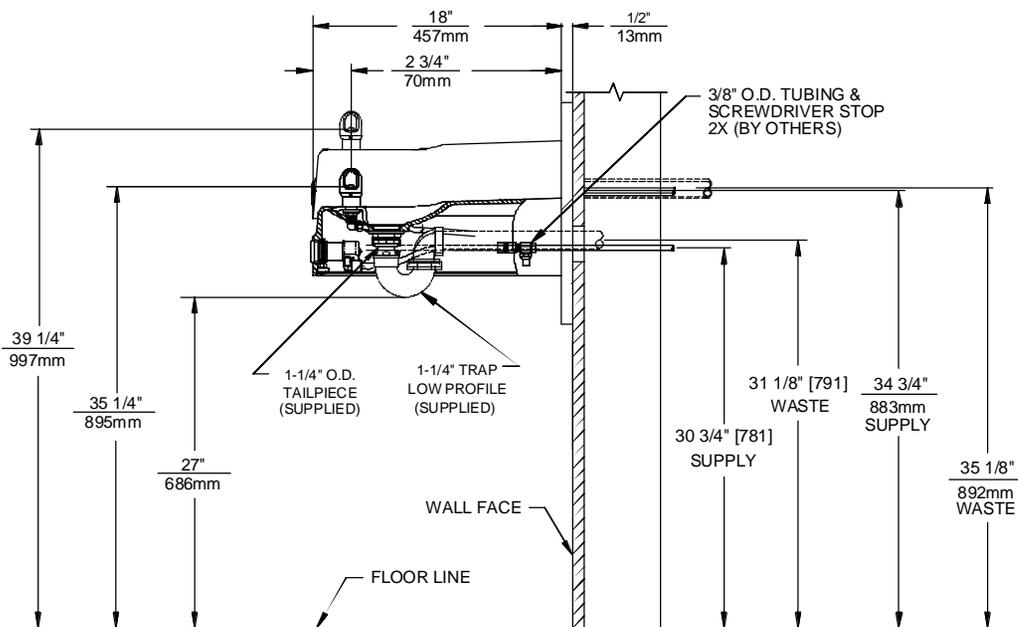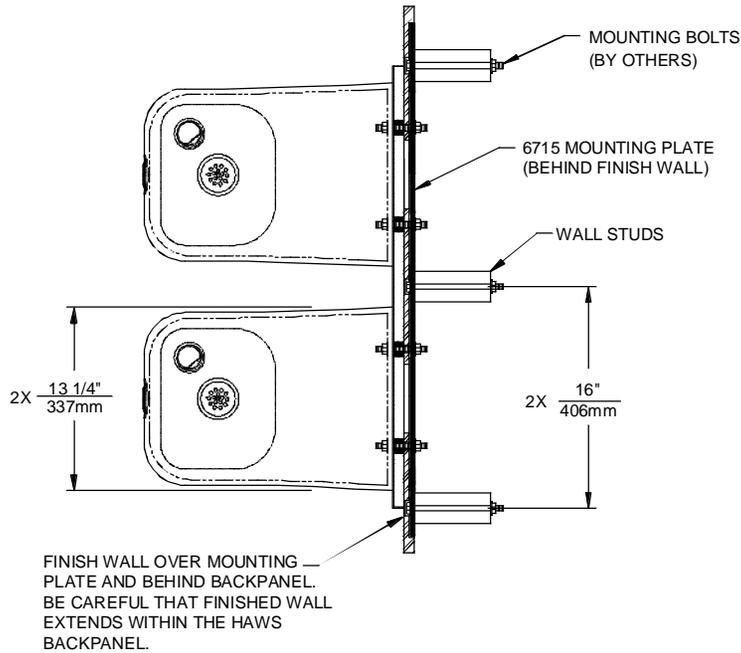


NOTES:

- 1 3" DIM TO SLOTTED OPENING ON MOUNTING PLATE MUST BE ON TOP L.H. SIDE WHEN INSTALLED.
- 2 4 5/16" DIM TO SLOTTED OPENING ON BACKPANEL MUST BE ON TOP L.H. SIDE WHEN INSTALLED.
3. HOLD ROUGH-IN DIMENSIONS $\pm 1/4"$ (6.4MM).
4. WHEN INSTALLING THIS UNIT, LOCAL, STATE, OR FEDERAL CODES SHOULD BE ADHERED TO. FOR INSTALLATION HEIGHTS OTHER THAN SHOWN, DIMENSIONS MARKED (*) MUST BE ADJUSTED ACCORDINGLY.
- 5 REFER TO 5874SS/VRK5874 OPERATION AND MAINTENANCE MANUAL FOR PUSH BUTTON AND VALVE INSTALLATION/MAINTENANCE INSTRUCTIONS.

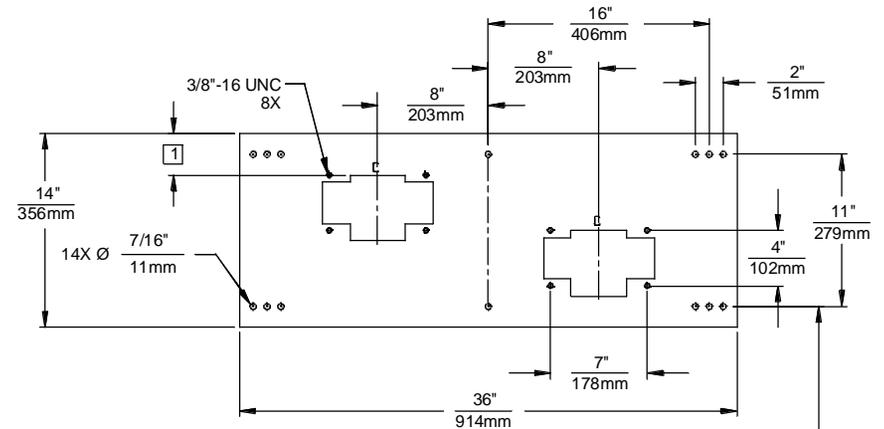

6715 MOUNTING PLATE
MUST BE INSTALLED BEFORE FINISH WORK.
THIS PLATE IS A STANDARD ITEM ON MODEL 1501.

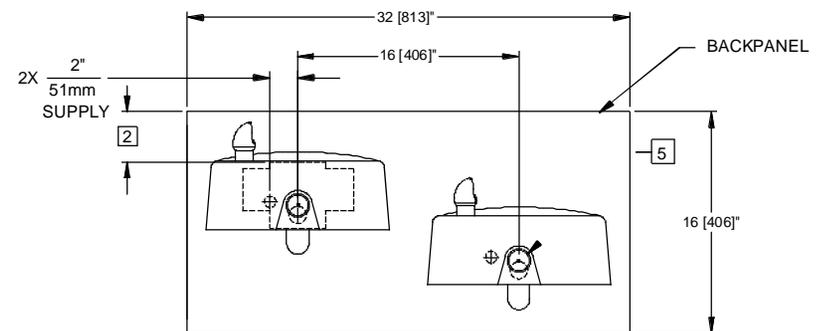

		1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWS.CO.COM WEBSITE: WWW.HAWS.CO.COM	
		ECN NO. REVISED PER ECN: BY: VWC DATE: 10/25/12 APPROVED: DATE:	MODEL(S) 1501 W/ 27" KNEE CLEARANCE (27" - 36")
SCALE: 1:14		DRAWING TYPE: INSTALLATION	SIZE: A SHEET 1 OF 1