



# REMP3, REMP16

+/- 1/16" (+/- 1.6mm) unless otherwise stated

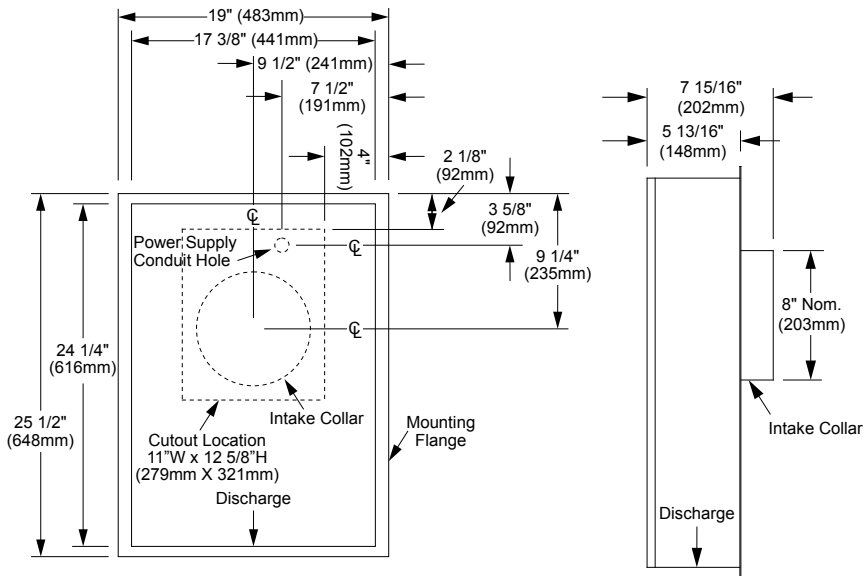

**REMP3 OVERALL DIMENSIONS**  
(Top & Side Views)

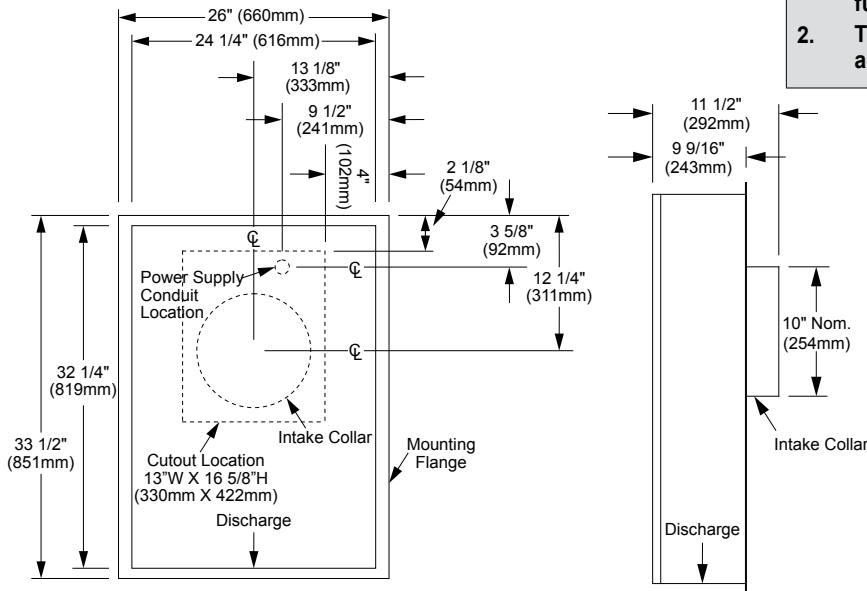

**REMP16 OVERALL DIMENSIONS**  
(Top & Side Views)

### WARNING


1. Observe all governing codes and ordinances during planning and installation. Contact your local building department for further information.
2. This appliance must be installed in accordance with the accompanying installation instructions.

Model No.	Electrical Supply Requirements	Maximum Duct Length	Total Connected Load	Blower Rating*	Approximate Shipping Weight	Finish
REMP3	Refer to raised vent or hood specifications	Refer to raised vent or hood specifications	120 Vac, 3.8 Amp	600 CFM (nominal) 620.5 CFM (actual)	35 lbs.	Galvanized (may be painted)
REMP16			120 Vac, 2.7 Amp	1000 CFM (nominal) 994.8 CFM (actual)	55 lbs.	


\* At 0" static pressure

# REMP3, REMP16

### REMP3 Blower Performance

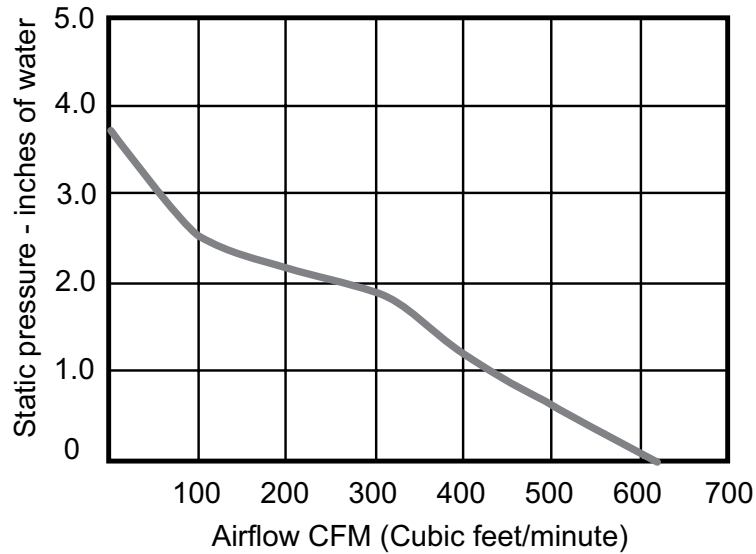


### REMP16 Blower Performance

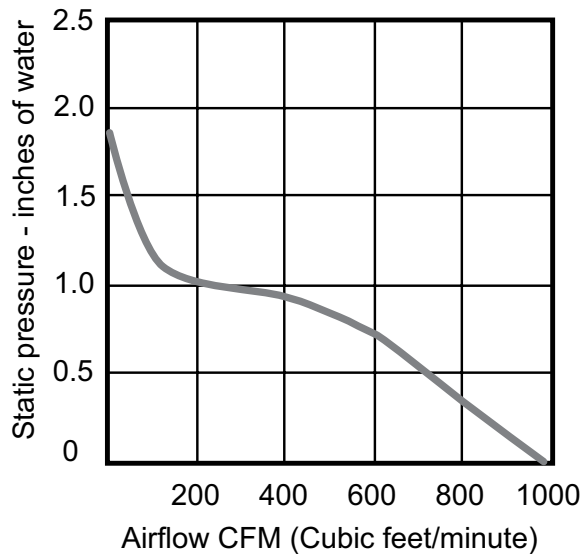

# REMP3, REM16

+/- 1/16" (+/- 1.6mm) unless otherwise stated

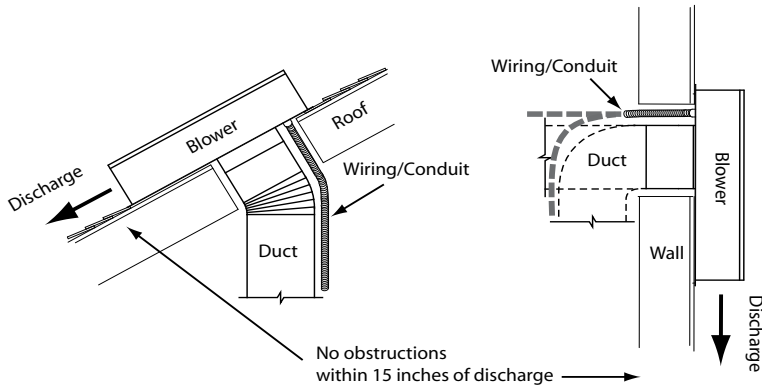


**SAMPLE REMP ROOF INSTALLATION**  
(Side View)




**NOTE:**


1. The REMP chassis may be rotated to clear obstructions. 15" (381mm) min. clearance must be maintained from the air discharge to any obstruction. When mounting in a horizontal position, shield the REMP to protect from possible water collection in the chassis. Maintain a minimum down slope of 1/4" (6mm) per foot for evacuation of water.
2. When the REMP is installed on to a flat (less than a 2:12 pitch) roof, a roof curb is required.
3. The blower discharge must be pointed in the same direction as the prevailing wind.

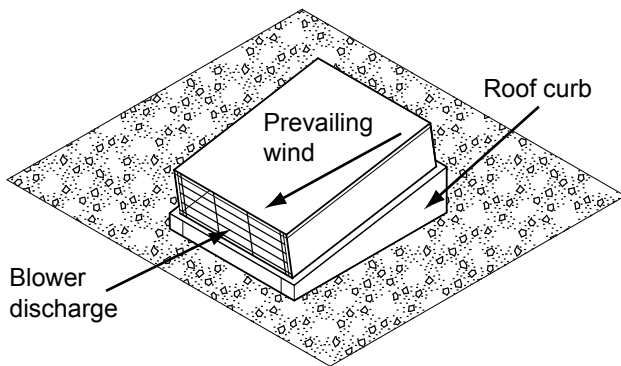

**REMP FLAT ROOF INSTALLATION**  
(Top & Side Views)

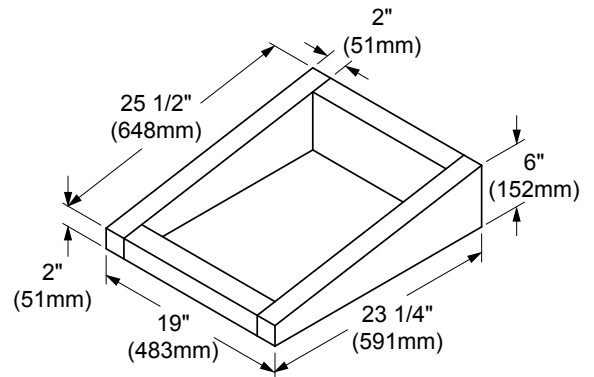

**REMP3 ROOF CURB DIMENSIONS**

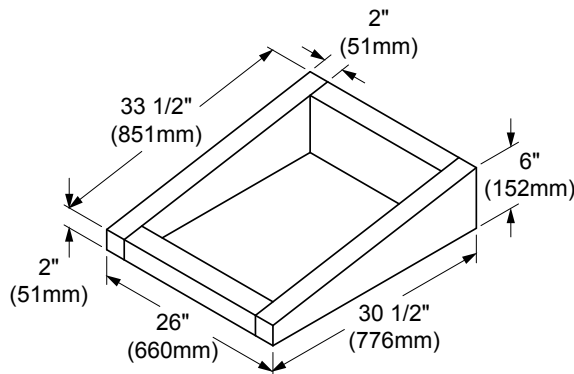

**REMP16 ROOF CURB DIMENSIONS**

\*All the CFM Blower Ratings are valued at 0" (zero-inch) static pressure.