



SUBMITTAL INFORMATION

Service Insulators - (SI-x-NL style)



FEMALE FLARE COPPER BY MALE FLARE COPPER

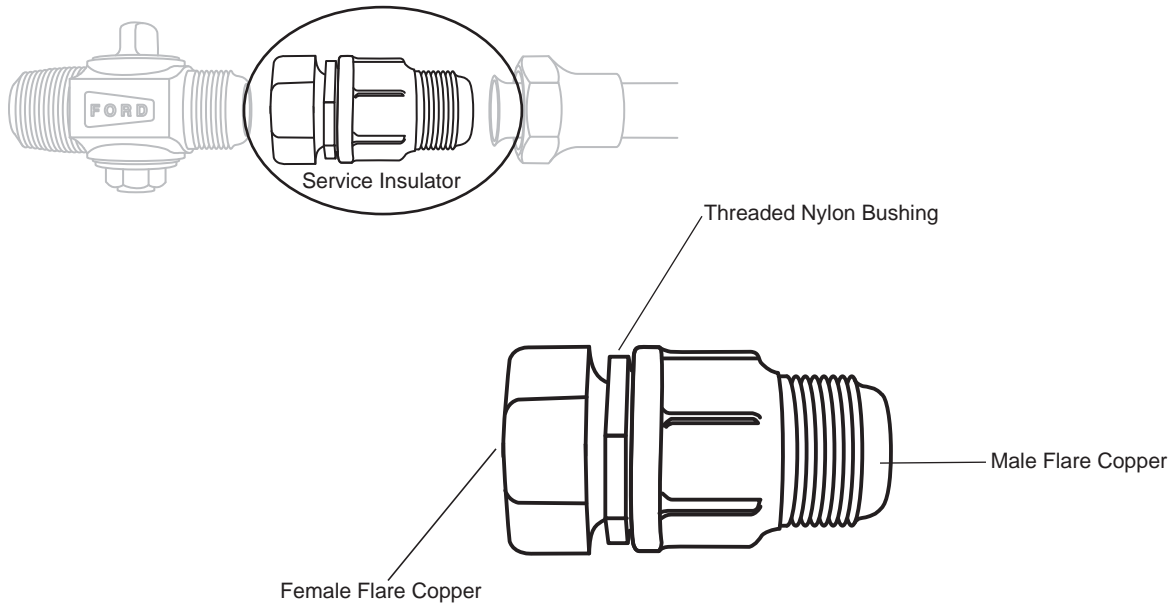

INLET SIZE	OUTLET SIZE	APPROX. WT. LBS.	PRODUCT NUMBER	✓ SUBMITTED ITEM(S)
3/4"	3/4"	0.9	SI-3-NL	
1"	1"	1.4	SI-4-NL	
1-1/2"	1-1/2"	3.7	SI-6-NL	
2"	2"	7.1	SI-7-NL	

FEATURES

- All brass that comes in contact with potable water conforms to AWWA Standard C800 (UNS NO C89833)
- The product has the letters "NL" cast into the main body for proper identification
- Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B-62 and ASTM B-584, UNS NO C83600 - 85-5-5-5)
- Threaded nylon bushing assembled between to flare copper adapters provides protection against service line electrolysis
- Body design provides wrench lugs to facilitate installation
- 150 psi working pressure
- Various service line connection types are available

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.



The Ford Meter Box Company, Inc.

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443

Phone: 260-563-3171 / Fax: 800-826-3487

Overseas Fax: 260-563-0167

<http://www.fordmeterbox.com>

01/28/13

Submitted By: