



**G5046** Eyewash/Drench Hose Unit, Wall Mounted **G5046BP** Eyewash/Drench Hose Unit, Wall Mounted, with Backflow Preventer



**Application:** Dual purpose eyewash/drench hose for wall mounting. Unit meets the provisions of ANSI Z358.1-2014 as both an eyewash and a drench hose. Unit may be left in the mounting bracket for use as a fixed eyewash, leaving user's hands free. Alternatively, unit may be removed for use as a drench hose to rinse any part of user's eyes, face or body.

Spray Head Assembly: Two GS-Plus<sup>™</sup> spray heads mounted side-by-side. Each head has a "flip top" dust cover, internal flow control and filter to remove impurities from the water flow.

Valve: Forged brass squeeze valve activated by stainless steel lever handle. Valve has replaceable stainless steel seat for exceptional durability. Locking clip engages when handle is depressed, providing "hands free" operation. Valve stays open until locking clip is released.

Hose: 12' reinforced nylon retractable coiled hose. 180 PSI maximum rated working pressure.

Mounting: Bracket with spring clips to hold unit on wall. Clips position spray heads and handle to face forward at all times.

Backflow Preventer: In-line dual check backflow preventer installed on inlet of hose (G5046BP only). Note: Check with code authority for compliance with local plumbing code.

Supply: 3/8" NPT female inlet.

Sign: ANSI-compliant identification sign.

Quality Assurance: Unit is completely assembled and water tested prior to shipment.

## **Available Options**

- **DC** Stainless steel dust cover for each spray head.
- **VB** In-line vacuum breaker for installation between valve and spray head.
- **TMV** G3600LF thermostatic mixing valve precisely blends hot and cold water to deliver warm (tepid) water as provided by ANSI Z358.1-2014. Refer to "Tempering Units" section for complete technical and product selection information.

Guardian Equipment 1140 N North Branch St 312 447 8101 FACSIMILE Chicago, IL 60642


312 447 8100 телерноме gesafety.com

Listed 8116. Units have been tested to and comply with ANSI 7358.1-2014 and the Uniform Plumbing Code. C







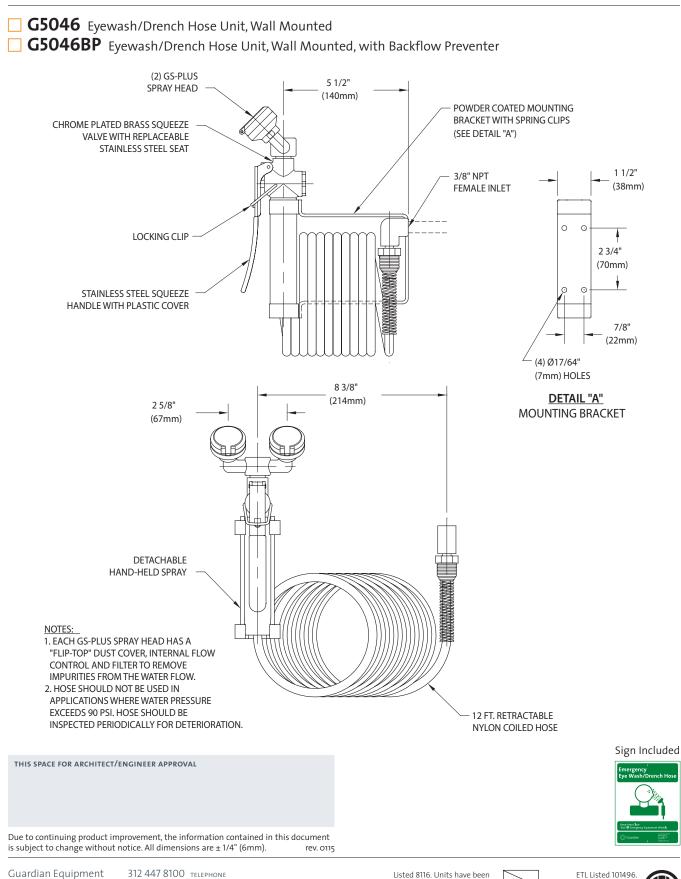

1140 N North Branch St Chicago, IL 60642

312 447 8101 FACSIMILE gesafety.com

tested to and comply with ANSI Z358.1-2014 and the Uniform Plumbing Code.

UF





Units have been tested to and comply with ANSI Z358.1-2014.