



**McGuire Manufacturing Co., Inc.**

60 Grandview Court  
 P.O. Box 746 • Cheshire, CT 06410  
 203-699-1801 • Fax: 203-699-1813  
 www.mcguiremfg.com

**Part No.**


LFHST02, LFHST02LK,  
 LFHST03, LFHST03LK,  
 LFHST04, LFHST04LK

**PRODUCT SPECIFICATION**

Heavy Pattern Angle Supply Stop  
 IPS x Compression

**Job Name:**

**Submittal Number:**

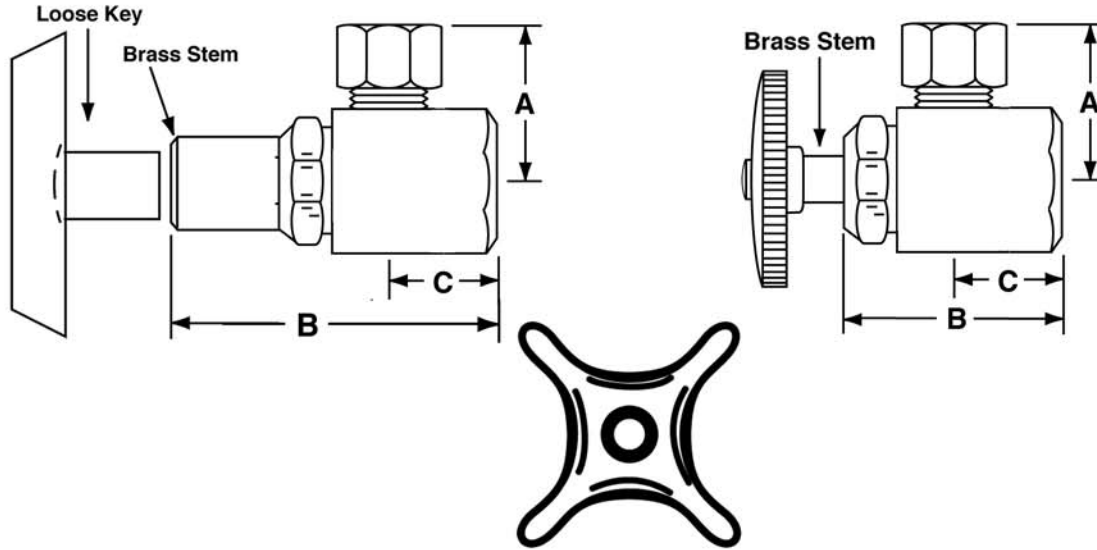

| NO.       | DESCRIPTION                      | ROUGHING MEASUREMENTS |        |      |
|-----------|----------------------------------|-----------------------|--------|------|
|           |                                  | A                     | B      | C    |
| LFHST02   | 1/2" IPS x 3/8" OD, Wheel Handle | 1-3/16"               | 1-1/2" | 3/4" |
| LFHST02LK | 1/2" IPS x 3/8" OD, Loose Key    | 1-3/16"               | 2-1/4" | 3/4" |
| LFHST03   | 3/8" IPS x 1/2" OD, Wheel Handle | 1-5/16"               | 1-1/2" | 3/4" |
| LFHST03LK | 3/8" IPS x 1/2" OD, Loose Key    | 1-5/16"               | 2-1/4" | 3/4" |
| LFHST04   | 1/2" IPS x 1/2" OD, Wheel Handle | 1-5/16"               | 1-1/2" | 3/4" |
| LFHST04LK | 1/2" IPS x 1/2" OD, Loose Key    | 1-5/16"               | 2-1/4" | 3/4" |

**X** designates Cross Handle

**LK** designates *Loose Key*

See options and accessories section for details on product variations.



ASME A112.18.1-2011

**Specifications:**

Chrome plated brass supply stop valve with full turn brass stem. Inlet shall be (3/8, 1/2) inch (IPS, sweat, compression). Outlet shall be (3/8, 1/2) inch (IPS, compression). Supply stop valve shall be McGuire \_\_\_\_\_. Supply stop valve shall be certified or recognized by testing authority and bear manufacturer and testing mark.