



Halsey Taylor[®]
Satisfying Thirsts Since 1912

Filterless HYDROBOOST™

Model HTHB-HAC-RF-NF

GENERAL

Bottle filling station designed to retro-fit existing HAC pushbar activated models. Applicable on 115V models only. Rated for indoor use.

Supplied with redesigned basin to ensure proper fit and allow for easy installation.

Ideal for use in sports and fitness centers, educational and healthcare facilities, airports, office buildings and many other commercial buildings.

HYDROBOOST™ RETRO-FIT BOTTLE FILLING STATION

Sensor-activated enhanced with user interface graphics. Quick fill rate is 1.5 gallons per minute on refrigerated model and 1 gallon per minute on ambient model. Laminar flow provides a clean fill with minimal splash and easy maintenance. Equipped with an automatic 20-second shut-off timer. Key plastic components are integrated with silver ion anti-microbial protection to inhibit growth of mold and mildew.

GREEN COUNTER™

Visually displays account of the plastic bottles saved from the landfills.

Bottle Filler Retro-fit for HAC models



SUGGESTED SPECIFICATION

Model HTHB-HAC-RF-NF retrofits existing 115V pushbar activated HAC models. Shall include redesigned basin to ensure proper fit and function. Shall be sensor-actuated with auto shut-off timer and bottle counter. Shall provide 1-1.5 GPM with laminar flow for minimal splash. Shall include anti-microbial protected components. Shall comply with ADA standards, be U.L. Listed and be certified to lead-free compliance including NSF/ANSI 61-Annex G, AB1953.

Protected by Halsey Taylor's Limited Warranty. Warranty details available at halseytaylor.com.

JOB NAME: _____

ENGINEER/CONTRACTOR NAME: _____

APPROVAL: _____
DATE: _____

NOTE: Continued product improvement makes specification sheets subject to change without notice.



HTHB-HAC-RF-NF

Filterless Single HAC Cooler with Retro-fit HydroBoost™ Bottle Filler

(CONTINUED)


OPERATING PRESSURES

Supply water – 105 psi maximum
 Minimum 40 psi supply line pressure required in special circumstances when both units are in use simultaneously to ensure adequate flow.


ELECTRICAL

HydroBoost Station equipped with plug-in, 3-wire ground type service cord. Install 120-volt receptacle, rated at 15-amp minimum, to receive 3-wire parallel blade grounding type male plug.

FRONT VIEW

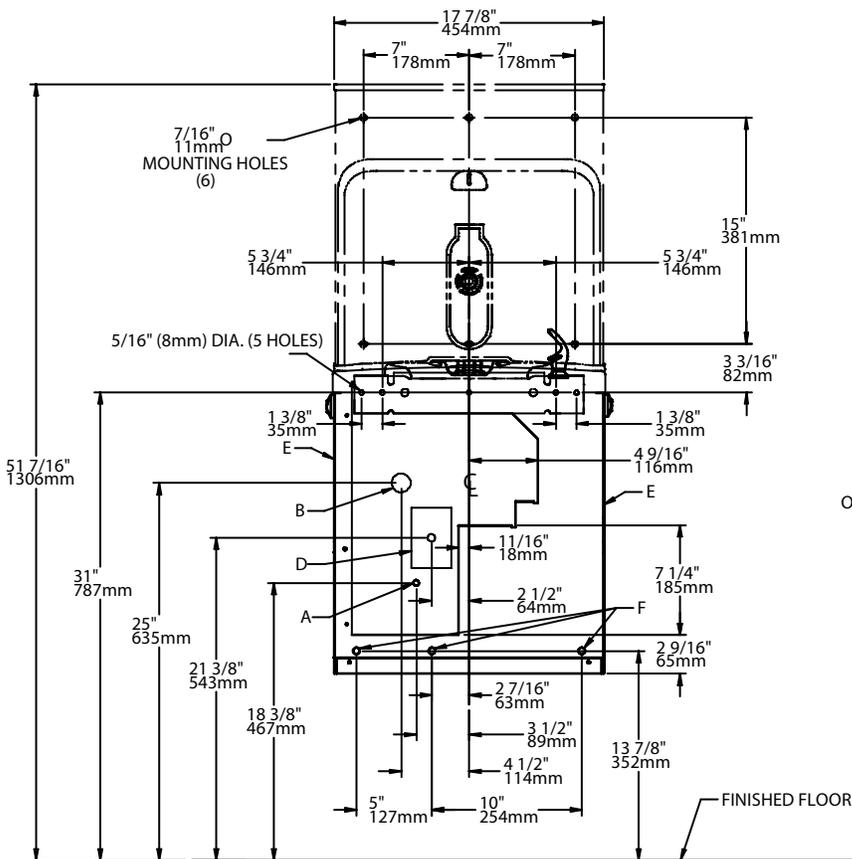

SIDE VIEW

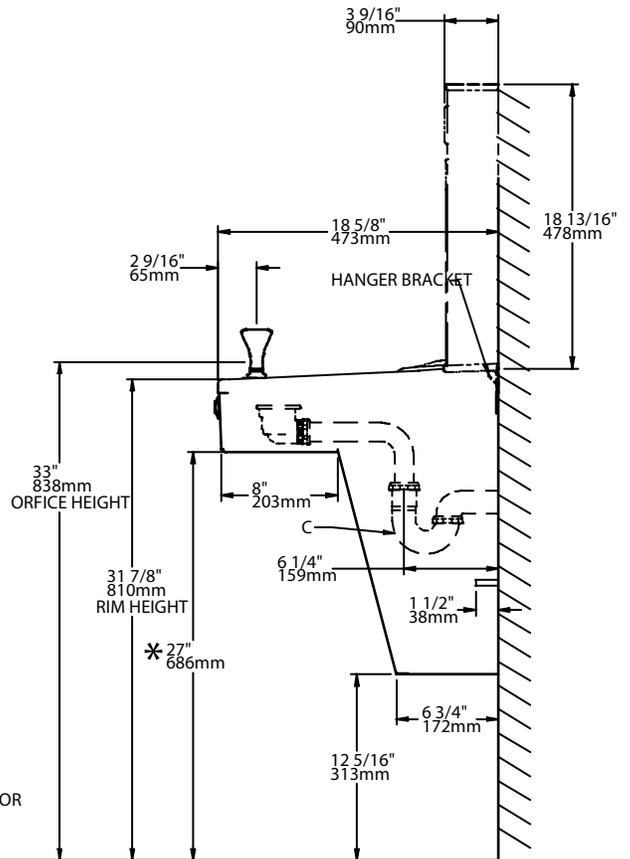

*ADA Requirement

LEGEND:

- A = Recommended Water Supply Location. 3/8" O.D. Unplated Copper Tube Connect Stub 1-1/2" (38mm) Out From Wall. Shut Off Valve Not Provided
- B = Recommended Location for Waste Outlet 1-1/4" O.D. Drain
- C = 1-1/4" Trap Not Furnished
- D = Electrical Supply (3) Wire Recessed Box
- E = Insure Proper Ventilation By Maintaining 6" (152mm) Min. Clearance From Cabinet Louvers to Wall
- F = 7/16" Bolt Holes For Fastening Unit To Wall

HTHB-HAC-RF

Bi-Level HAC Cooler with Retro-fit HydroBoost™ Bottle Filler

(CONTINUED)


OPERATING PRESSURES

Supply water – 105 psi maximum
 Minimum 40 psi supply line pressure required in special circumstances when both units are in use simultaneously to ensure adequate flow.


ELECTRICAL

HydroBoost Station equipped with plug-in, 3-wire ground type service cord. Install 120-volt receptacle, rated at 15-amp minimum, to receive 3-wire parallel blade grounding type male plug.

FRONT VIEW

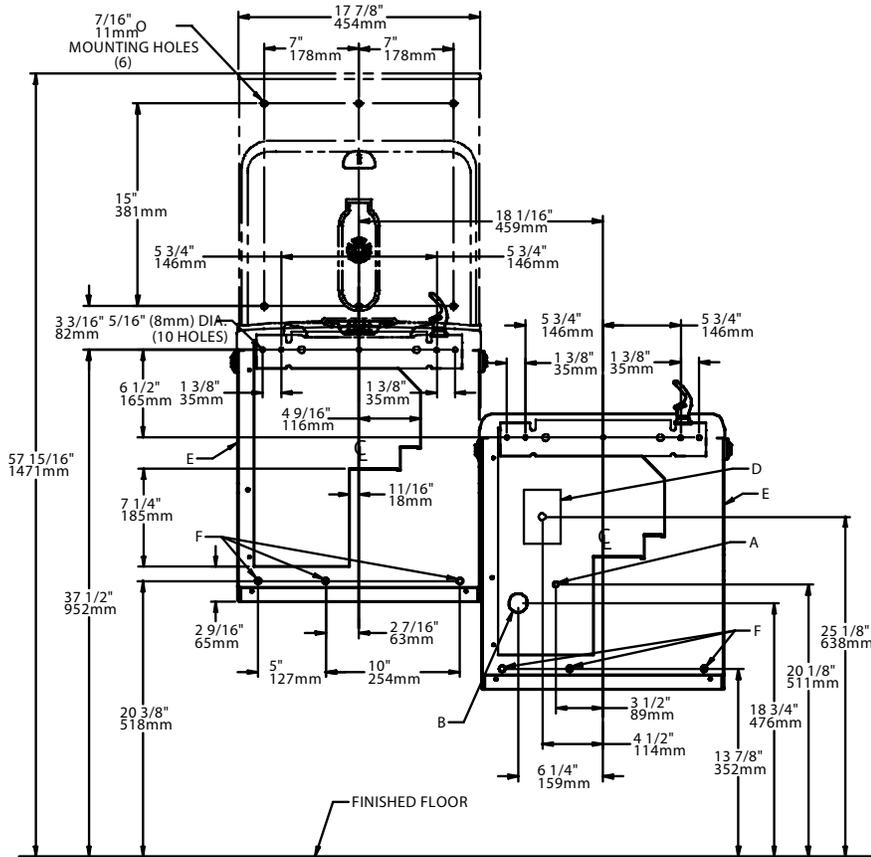

SIDE VIEW

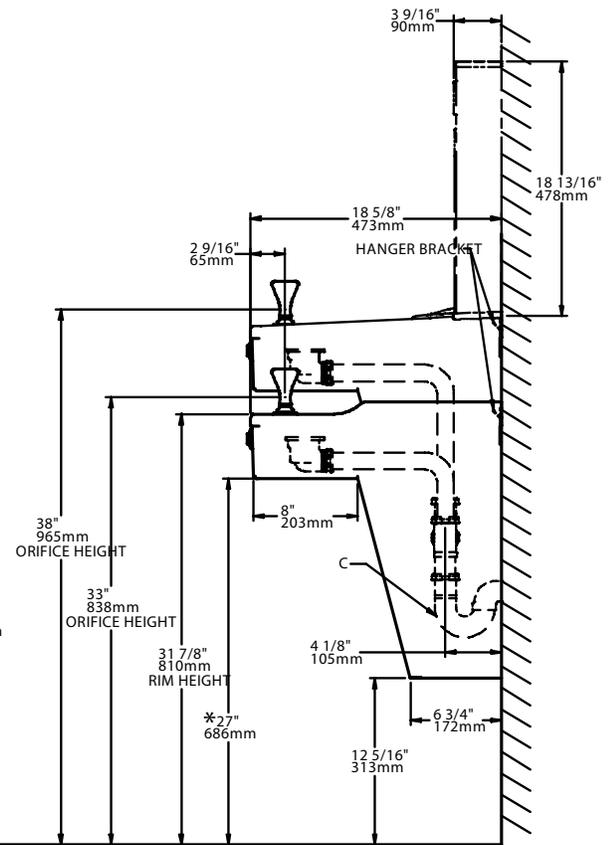

LEGEND:

- A = Recommended Water Supply Location. 3/8" O.D. Unplated Copper Tube Connect Stub 1-1/2" (38mm) Out From Wall. Shut Off Valve Not Provided
- B = Recommended Location for Waste Outlet 1-1/2" O.D. Drain
- C = 1-1/2" Trap Not Furnished
- D = Electrical Supply (3) Wire Recessed Box
- E = Insure Proper Ventilation By Maintaining 6" (152mm) Min. Clearance From Cabinet Louvers to Wall
- F = 7/16" Bolt Holes For Fastening Unit To Wall

*ADA Requirement

HTHB-HAC-RF-NF

Filterless Single HAC Cooler with Retro-fit HydroBoost™ Bottle Filler

(CONTINUED)


OPERATING PRESSURES

Supply water – 105 psi maximum
 Minimum 40 psi supply line pressure required in special circumstances when both units are in use simultaneously to ensure adequate flow.


ELECTRICAL

HydroBoost Station equipped with plug-in, 3-wire ground type service cord. Install 120-volt receptacle, rated at 15-amp minimum, to receive 3-wire parallel blade grounding type male plug.

FRONT VIEW

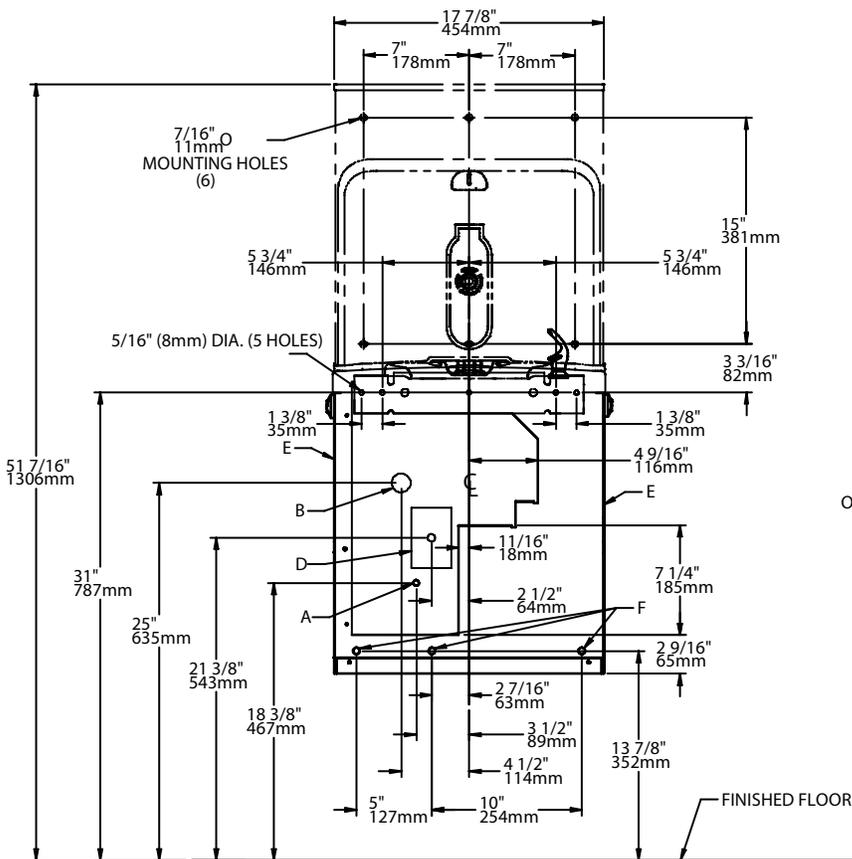

SIDE VIEW

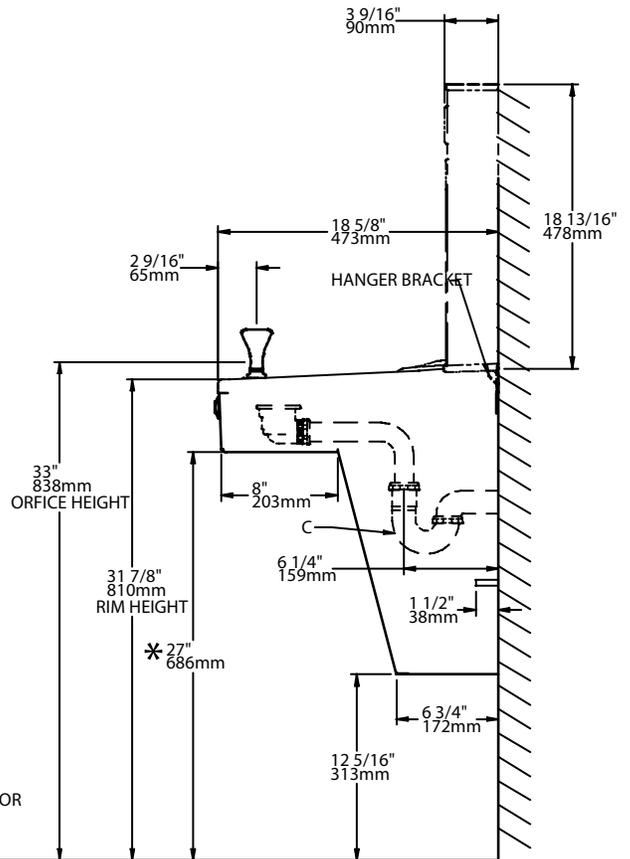

*ADA Requirement

LEGEND:

- A = Recommended Water Supply Location. 3/8" O.D. Unplated Copper Tube Connect Stub 1-1/2" (38mm) Out From Wall. Shut Off Valve Not Provided
- B = Recommended Location for Waste Outlet 1-1/4" O.D. Drain
- C = 1-1/4" Trap Not Furnished
- D = Electrical Supply (3) Wire Recessed Box
- E = Insure Proper Ventilation By Maintaining 6" (152mm) Min. Clearance From Cabinet Louvers to Wall
- F = 7/16" Bolt Holes For Fastening Unit To Wall