

SPECIFICATION SUBMITTAL SHEET



Metal DWV Pipe Hanger

SPECIFICATION

Water-Tite's Metal DWV Pipe hanger shall be used where necessary to secure Schedule 40 DWV piping according to all national code requirements. Hanger shall be of galvanized steel material, with or without flexible PVC sleeve.

Hanger shall have a minimum 12" stem length to the top of the pipe loop. Hanger stem shall have alternating mounting hole sizes to accommodate approved mounting hardware.

Locking screw shall be tightened once DWV pipe is installed to secure pipe in place.

MATERIALS

Hanger: galvanized steel Screw for galv/vinyl: combo Phillips/slot pan head #12 x 1 1/2" LG sheet metal screw type "B" blunt point

Sleeve: Flexible PVC-Black

MAXIMUM RECOMMENDED LOAD

150 lbs. @ 4ft. spacing


DIMENSIONS

Galvanized

A: DWV diameter	1 1/2"	2"	3"	4"
B: Width	3/4"	3/4"	3/4"	3/4"
C: Stem length	13"	12 1/2"	12 1/2"	13 1/4"
Gauge	16	16	16	16

Galv w/Plastic Sleeve

A: DWV diameter	1 1/2"	2"	3"	4"
B: Width	3/4"	3/4"	3/4"	3/4"
C: Stem length	13"	12 1/2"	12 1/2"	13 1/4"
Gauge	16	16	16	16

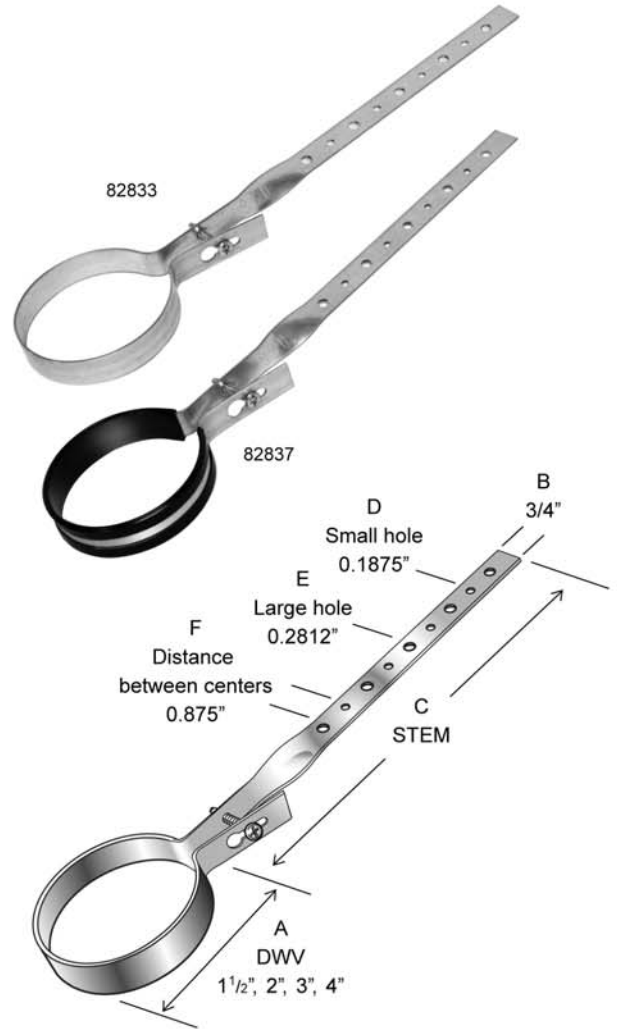

PROD. CODE	DESCRIPTION	MODEL #
------------	-------------	---------

WITHOUT PLASTIC SLEEVE

82830	1 1/2" Galvanized DWV hanger uncoated / 3/4" width	MH321
82831	2" Galvanized DWV hanger uncoated / 3/4" width	MH322
82832	3" Galvanized DWV hanger uncoated / 3/4" width	MH323
82833	4" Galvanized DWV hanger uncoated / 3/4" width	MH324

WITH PLASTIC SLEEVE

82834	1 1/2" Galvanized DWV hanger w/Plastic Sleeve / 3/4" width	MH421
82835	2" Galvanized DWV hanger w/Plastic Sleeve / 3/4" width	MH422
82836	3" Galvanized DWV hanger w/Plastic Sleeve / 3/4" width	MH423
82837	4" Galvanized DWV hanger w/Plastic Sleeve / 3/4" width	MH424



www.ipscorp.com watertite@ipscorp.com

500 Distribution Parkway, Collierville, TN 38017, USA ■ TEL: 901-853-5001 ■ WATS: 800-888-8312 ■ FAX: 901-853-5008

BB12785