

SPEAKMAN SAFETY PRODUCTS

Installation, Maintenance & Operation Instructions

SEF-1800-SL EYESAVER® FAUCET

DESCRIPTION

The SEF-1800 Eyesaver® faucet combines a gooseneck faucet with an independently operated eyewash. The faucet features a vandal resistant, single lever faucet utilizing a ceramic cartridge with an adjustable temperature limit and flow control.

SPECIFICATIONS

OPERATION: Eyewash and faucet operate independently of each other

SUPPLY: 3/8 compression male connections for hot and cold inlets

FAUCET VALVE: Ceramic cartridges

FINISH: Chrome plated brass

EYEWASH ACTIVATION: Pull handle with graphics

EYEWASH SPRAYS: Aerated sprays.

FAUCET FLOW RATE: Autoflo® device controls flow to 2.2 GPM/ 8.3 LPM


EYEWASH FLOW RATE: 2.6 GPM at 30 psi. flowing. See flow data chart for additional information.

PRESSURE: 30 psi. minimum flow pressure, 80 psi. maximum static pressure

APPROVALS: Meets ASME A112.18.1, ANSI Z358.1 and CSA B125.1

VACUUM BREAKER (ST option): Approved by ASSE, UPC and CSA. Meets the ANSI/ASSE 1035 standard for "Laboratory Faucet Vacuum Breakers", CSA B64.8 and UPC.


SHIPPING WEIGHT: 10 LBS.

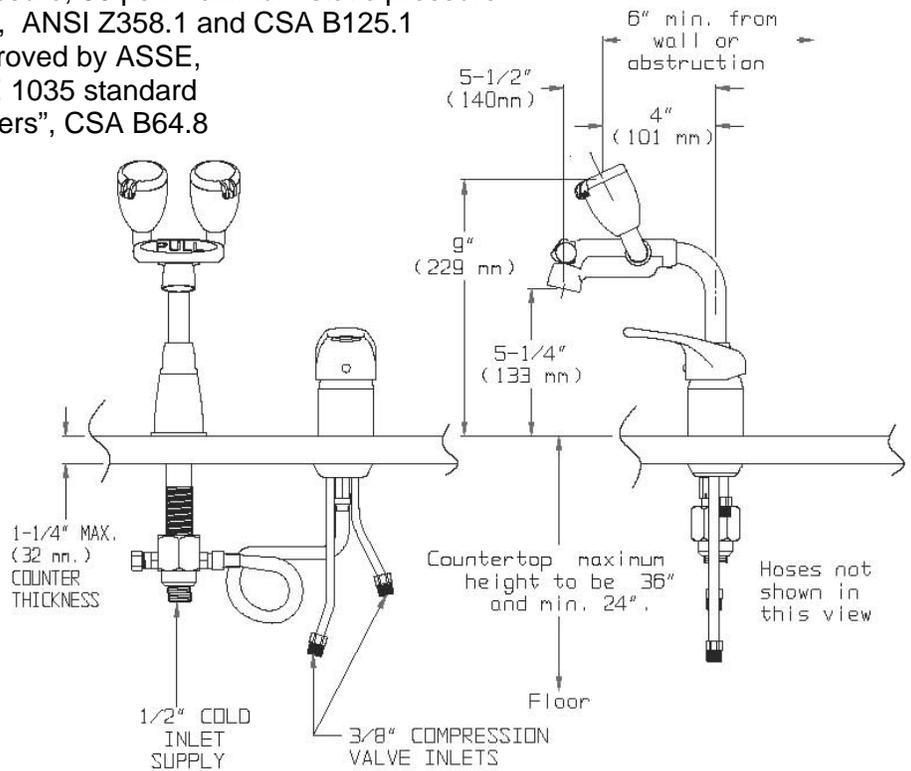

Notes:

- 1) All dimensions are in inches (millimeters) unless otherwise specified and are subject to change.
- 2) For "FP" (Foot Pedal Valve) option, see separate rough-in sheet #92-2844.


IMPORTANT: The supply line for plumbed units shall provide an uninterrupted supply of flushing fluid at a minimum of 30 psi. of flow pressure. If shut off valve are installed in the supply line of the eyewash for maintenance purposes, provisions shall be made to prevent unauthorized shut off.

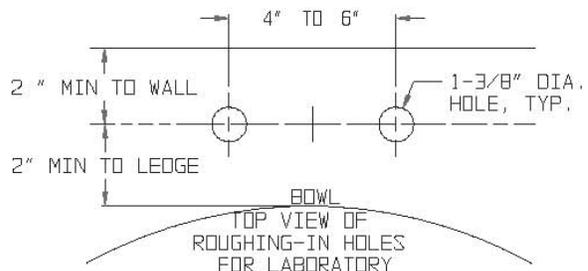

8/10 rev.6
92-2512


OPTIONS

◇ BOCA – Vandal-Resistant 0.5 gpm Flow Control
◇ CA- Low Lead for CA AB1953 Compliance
◇ LF – Laminar Flow Outlet 2.2gpm
◇ ST – Serrated Tip with Vacuum Breaker
◇ FP- Foot Pedal Valve

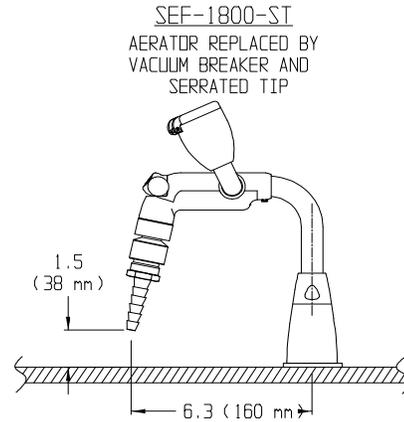


FLOW DATA

Flowing Pressure- psi. (BAR)	30 (2.07)	40 (2.76)	50 (3.45)	60 (4.14)	70 (4.83)	80 (5.52)
Flow Rate- gpm (LPM)	2.6 (9.8)	2.9 (11)	3.0 (11.4)	2.8 (10.6)	2.8 (10.6)	3.0 (11.4)
Distance Eyewash Plume, 'A' - ins. (cm.)	13 (33.0)	14-1/2 (36.8)	15 (38.1)	15 (38.1)	15 (38.1)	16 (40.6)

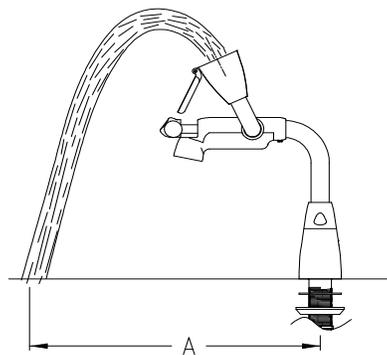

PACKING LIST


Item	Description	Qty.	Item	Description	Qty.
1	Single lever Valve	1			
2	Valve Mounting Hardware Bag Group	1	7	Aerator	1
3	Gooseneck Eyewash	1	8	Serrated Tip and Vacuum Breaker for -ST option, (replaces item #8)	1
4	Gooseneck Mounting Hardware	1	9	.5 gpm aerator for - BOCA option, Item not shown (replaces item #8)	1
5	3/8 Hose	1	10	Laminar flow outlet for - LF option, Item not shown (replaces item #8)	1
6	Tee Assembly	1			

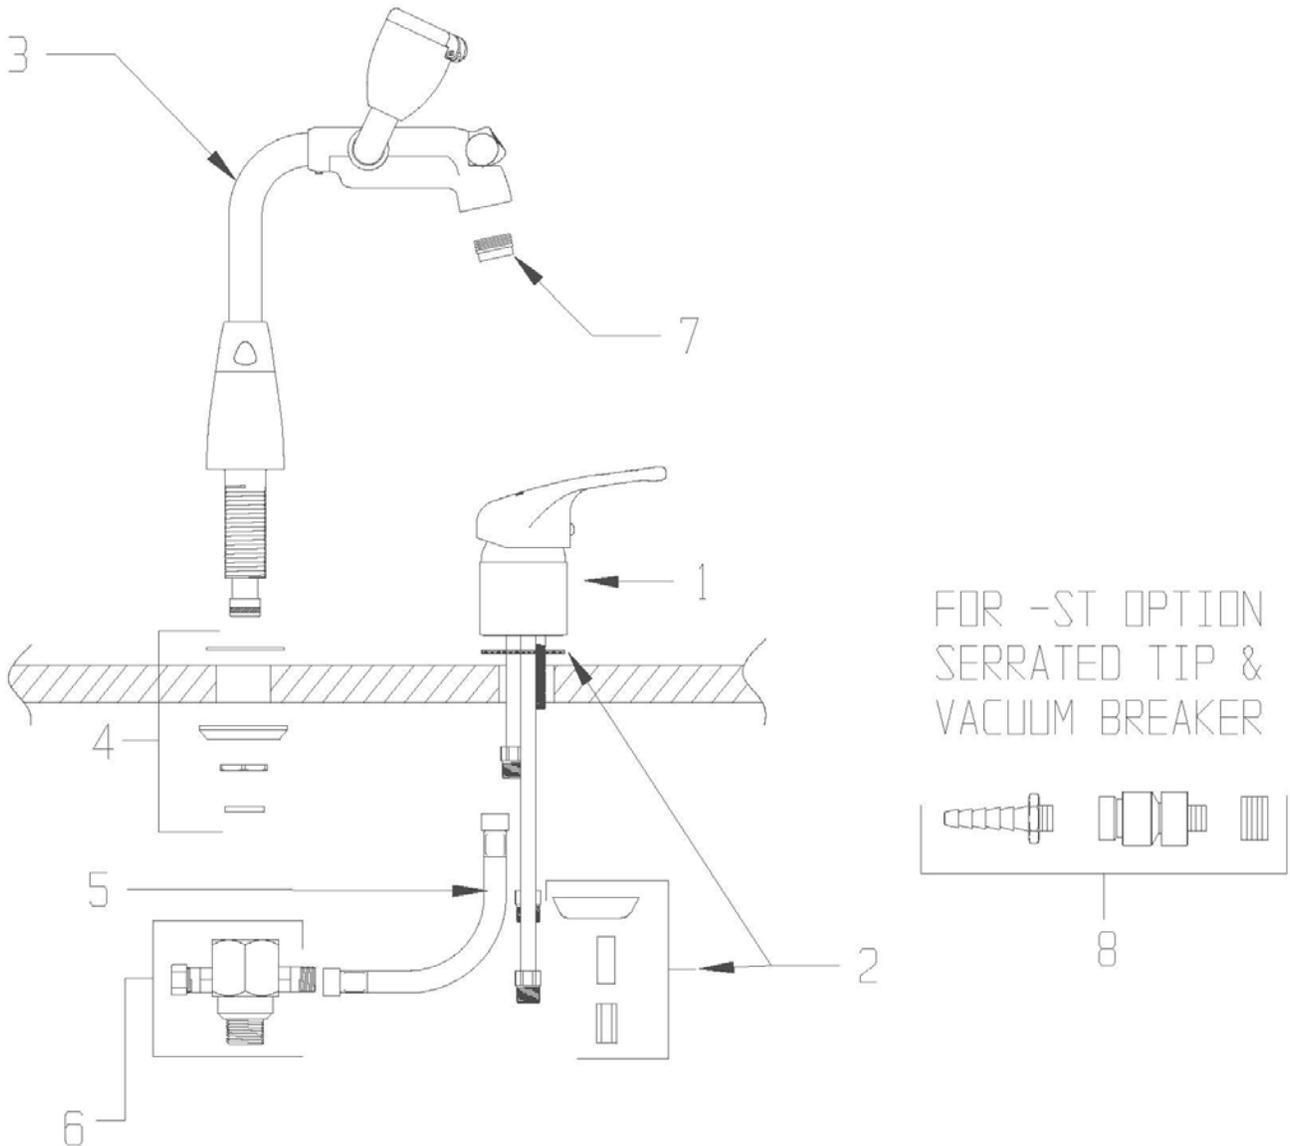

INSTALLATION


Step 1: Gooseneck Eyewash Mounting-

- Place the gasket and deck plate onto the sink bowl. Slip the base washer onto the gooseneck eyewash and slip through the center hole of the sink or countertop.
- The gooseneck eyewash swivels through 200° of rotation. Position the base of the gooseneck eyewash so the setscrew hole in the base is pointing towards the back of the sink or countertop. Note- For rigid gooseneck, position the gooseneck and tighten the setscrew in the mounting base. From below the sink slip the cup washer onto the shank and use the nut to tighten the assembly down onto the sink or countertop.
- Important-** Next insert the rubber seal into the adapter and screw the adapter onto the shank of the gooseneck eyewash until it bottoms out (Tape may be applied to the shank). If the adapter needs to be positioned for hose attachment, it can be backed off up to a maximum of 1 / 2 turn.

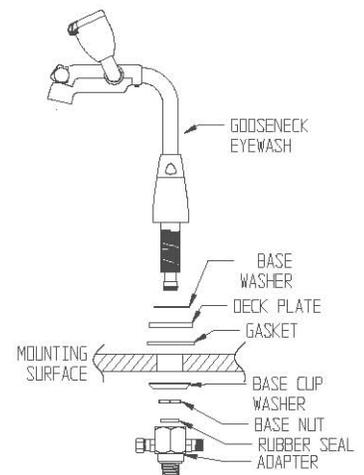

Step 2: Valve Assembly-

- Slide the gasket up over the tubes.
- Slip the tubes through the hole in the sink. Make sure the gasket is properly aligned in the cavity of the valve sleeve.
- Secure the valve using the mounting bracket and tighten using the wrench provided. Use the spacer washer for thin sink applications.



Step 3: Hose Connections-

- Warning:** Be careful when bending the copper tubing. Kinked tubes will void the warranty. Use a wrench to hold the soldered connectors, do not twist these. While the soldered connectors are secure, tighten the hose connection with the other wrench. DO not over tighten.


- Screw 3/8" hoses onto the outlet of the valve body (Shortest length tube) and tighten. Screw the other end of the hose onto base adapter.

Note- 3/8 capped inlet port of tee used only for "FP" (Foot Pedal Valve) option installation.

- Connect the vertical inlet of the tee to the cold water inlet supply.

- Connect the hot & cold water supply lines to the inlets of the valve body (Longest length tube is the hot inlet) and tighten the coupling nuts.


Note- Use flexible hose connections for the hot & cold water supplies. Use of copper tube supply connections may interfere with function of checks located in the inlets.

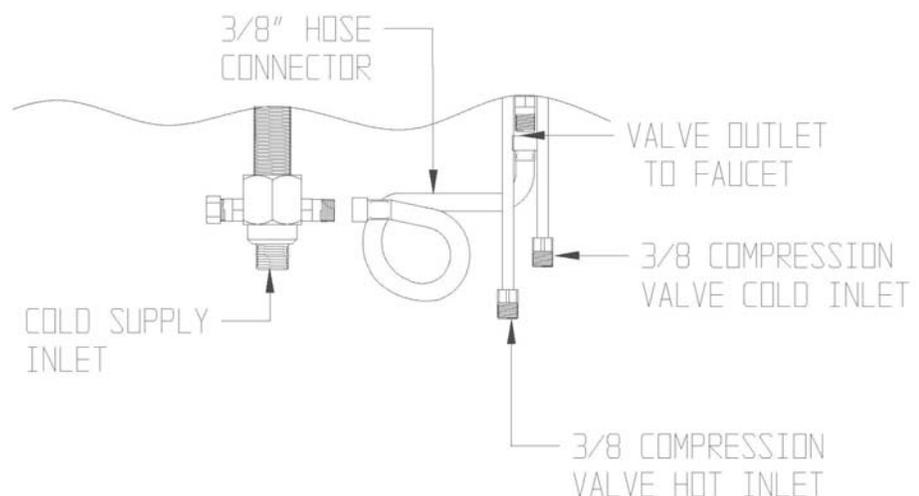



8/10 rev.6
92-2512

Step 4: Unit Flushing-

- a. After the assembly is complete, turn the hot and cold water supplies on and check for leaks.
- b. Activate the faucet to flush both the hot and cold sides of fixture. Check all connections for leaks.
- c. Install the aerator into the faucet outlet.
- d. At this time activate faucet and then activate the eyewash by pulling the handle and assure proper spray formation and no leaks.

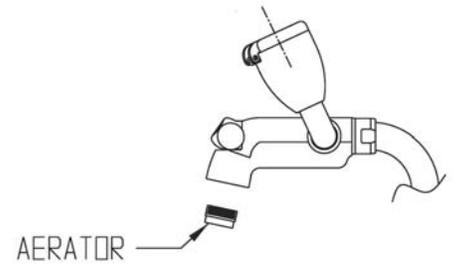

TEMPERATURE LIMIT STOP RING ADJUSTMENT

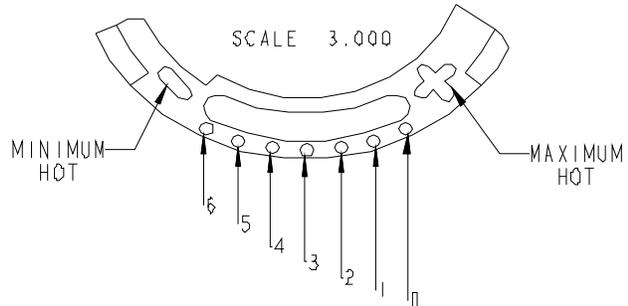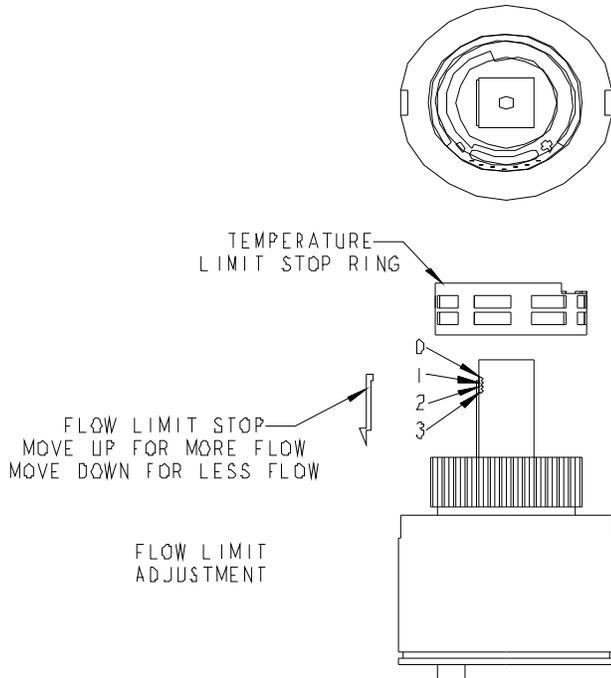

POSITIO N @ 45 PSI.	FLOW LIMIT	TEMP. L IMIT
0	0%	0%
1	5%	0%
2	12%	3%
3	25%	10%
4		20%
5		30%
6		40%

FLOW AND TEMPERATURE ADJUSTMENT INSTRUCTIONS

Adjusting Temperature Limit:

- 1) Remove handle by removing red/blue button (2) and set screw (3) using an Allen key and remove collar (4) by hand counter-clockwise.
- 2) With cartridge control shaft in the center and off position, carefully lift and rotate the temperature limit stop ring to the desired setting using needle nose pliers or by hand. Clockwise rotation of the ring increases temperature and counterclockwise rotation of the ring lowers temperature (see table and schematic for details). Turn water on and test for desired temperature.

Adjusting Flow Limit control:

- 1) Using a thin flat screwdriver, carefully remove flow limit stop by prying it away from the cartridge control shaft.
- 2) Reset flow limit stop higher on the shaft to increase flow or lower to decrease flow.
- 3) Re-install handle and check for proper operation.


NOTE: The flow limit adjustment is effective when a higher than 2.2 GPM flow outlet is installed in the faucet or the flow outlet has been removed.

ALTERNATE INSTALLATION FOR DEDICATED TEPID WATER SUPPLY

The unit is designed so the eyewash has a dedicated supply line. This allows the eyewash to have a tepid water supply. Attach the tepid water supply to the center adapter as shown in the figure and your cold water supply to the cold valve body.

ANSI Z358.1-1998 requires that the delivered flushing fluid temperature shall be tepid. Also, in circumstances where chemical reaction is accelerated by flushing fluid temperature, a medical advisor should be consulted for the optimum temperature of each application.

IMPORTANT: The supply line for plumbed eyewash units shall provide an uninterrupted supply of flushing fluid at a minimum of 30 psi. of flow pressure. If shut off valve is installed in the supplyline of the eyewash for maintenance purposes, provisions shall be made to prevent unauthorized shut off.

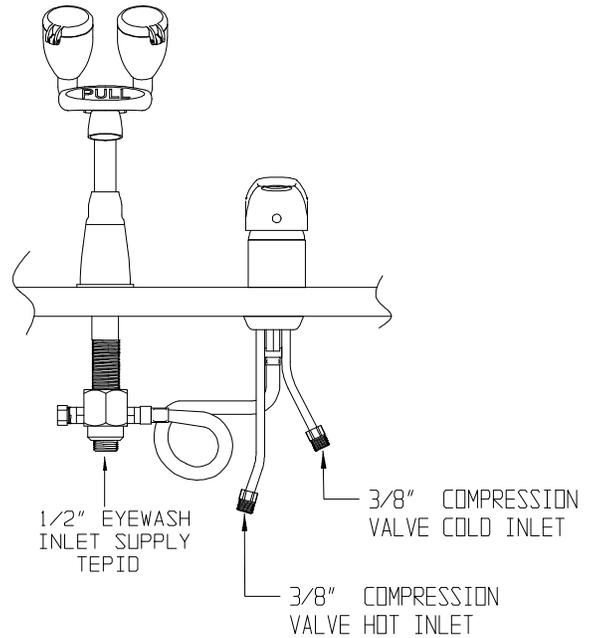

OPERATION

Faucet- Lift the lever to activate the faucet. To achieve the desired temperature, rotate the lever.

“FP” (Foot Pedal Valve) option only- Press foot pedal(s) to activate faucet.

Eyewash- The eyewash is activated by pulling the handle out. Once the eyewash is activated, the eyewash caps will flip off and water will come out of the aerated spray heads. The eyewash will continually discharge water until the handle is manually pushed back into the off position. The flow of the individual spray heads is controlled by built-in flow controls. Each spray assembly is tested and aligned in the factory.

TESTING PROGRAM

ANSI Z358.1 requires that all emergency equipment shall be tested weekly to verify proper operation and inspected annually to assure conformance with ANSI Z358.1 requirement.

MAINTENANCE (CARE and CLEANING)

Valves are washer-less and require no routine maintenance. The gleaming finish of your SPEAKMAN Eyesaver® faucet can be cleaned by using mild soap and warm water. Rinse thoroughly and dry immediately with a soft, clean cloth for best results.

REPAIR PARTS LISTING

Part or Group Number	Description	Refer to Packing List Figure
G20-1979	Single Lever Faucet	
RPG38-0388	Yellow spray head and aerator repair parts assembly	Part of item 3
RPG49-0003	Repair parts for internal seals of the gooseneck eyewash	Not shown
G05-0724-PC	Faucet 2.2 gpm aerator	Item 8
RPG04-0366	Eyewash handle with yellow text and set screw	Part of item 3