

# Class 150 Ductile Iron Body Globe Valves

Raised face flanges • bolted bonnet • outside screw and yoke • bronze trim

**285 PSI/19.7 bar non-shock cold working pressure to -20°F to 100°F/-29°C to 38°C\***

**Maximum working temperature 650°F/343°C at 125 PSI/8.6 bar**

**150 PSI/10.3 bar saturated steam to 366°F/186°C**

TESTING SPECIFICATION TO MSS SP-85

## MATERIAL LIST


PART	SPECIFICATION
1. Handwheel Nut	Steel ASTM A563
2. Identification Plate	Aluminum
3. Handwheel	Iron ASTM A126 Class B
4. Yoke Bushing	Brass ASTM B584
5. Bonnet	Ductile Iron ASTM A395
6. Stem	Brass ASTM B371 Alloy C69400 or C69430
7. Gland Follower Nut	Brass ASTM F467 Alloy C27000
8. Gland Follower	Ductile Iron ASTM A536
9. Packing Gland	Zinc Plated Powdered Iron ASTM B 310 or Brass ASTM B371 C69300
10. Gland Follower Stud	Steel ASTM A307/SAE J429
11. Packing	PTFE Braided
12. <sup>1</sup> Body Bolt	Steel ASTM A307/SAE J429
13. Body Gasket	Synthetic Fibers
14. <sup>2</sup> Body Nut	Steel ASTM A563
15. Swivel Nut	Brass ASTM B584 Alloy C84400
16. <sup>2</sup> Disc	Brass ASTM B584 Alloy C84400
17. Seat Ring	Brass ASTM B584 Alloy C84400
18. Body	Ductile Iron ASTM A395

<sup>1</sup>2" and 10" have hex head steel capscrew.

<sup>2</sup>2" thru 6" have Bronze ASTM B584 Disc. 8" thru 10" have Ductile Iron Disc with Bronze ASTM B584 Disc Face Rings and Brass Pilots.



**F-738-31**  
Flanged-Raised Face

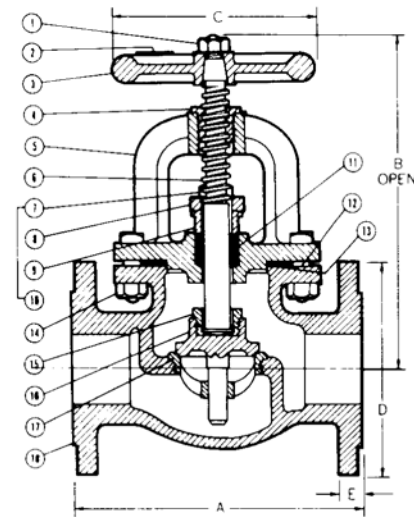

**F-738-31**  
Flg x Flg

## DIMENSIONS—WEIGHTS—QUANTITIES

Size	Dimensions										Weight		
	A		B		C		D		E		Lbs.	Kg.	
In.	mm.	In.	mm.	In.	mm.	In.	mm.	In.	mm.	In.	mm.		
2	50	8.00	203	10.19	259	7.00	178	6.00	152	.63	16	32	15
2½	65	8.50	216	11.81	300	8.00	203	7.00	178	.69	17	49	22
3	80	9.50	241	12.50	318	8.00	203	7.50	191	.75	19	66	30
4	100	11.50	292	15.81	402	10.00	254	9.00	229	.94	24	98	45
5	125	13.00	330	16.50	419	10.00	254	10.00	254	.94	24	139	63
6	150	14.00	356	18.88	479	12.00	305	11.00	279	1.00	25	183	83
8	200	19.50	495	21.13	537	16.00	406	13.50	343	1.13	29	362	164
10	250	24.50	622	25.19	640	18.00	457	16.00	406	1.19	30	582	264

Install 5 pipe diameters minimum downstream from pump discharge or changes in direction to avoid flow turbulence. Flow straighteners may be required in extreme cases.

**FREEZING WEATHER PRECAUTION:** Subsequent to testing a piping system, valves should be left in an open position to allow complete drainage.

VISIT [WWW.NIBCO.COM](http://WWW.NIBCO.COM) FOR CURRENT CHEM-GUIDE AND GALVANIC POTENTIAL IN PIPING SYSTEMS INFORMATION.

Visit our website for the most current information.

◆ For detailed Operating Pressure, refer to Pressure Temperature Chart on page 114.