

SPEAKMAN COMPANY

SE-855 Installation, Maintenance & Operation Instructions

Emergency Shower Head

DESCRIPTION

Replacement emergency shower head for SE-700 and SE-701.

SPECIFICATIONS

SHANK: 5" Dia. Brass, Chrome-Plated.
SPRAYFACE: Chrome-Plated Brass.
INLET: 1/2" NPT Female.
SHIPPING WEIGHT: 2 lb.

INSTALLATION

When assembling use wrench on hex (flats) only. Be sure and use pipe sealant on threaded connection. Failure to use potable water can result in emergency units producing impure or contaminated water causing possible further injury.

TESTING PROGRAM

The American National Standards Institute (ANSI) states that all safety emergency equipment shall be activated on a weekly basis to flush the line and verify proper operation. Speakman Company furnishes a testing record tag (91-0635) with each unit. On this tag the date of inspection and the inspectors initials should be noted.

MAINTENANCE

Should you need parts to repair this unit, please reference the parts listing below for correct part numbers. Before any maintenance is done **be sure the water supply is off.**

WARNING: Use only genuine Speakman parts when repairing or replacing components. To order parts call 1-800-537-2107.



SE-855 REPLACEMENT/REPAIR PARTS

<u>ITEM</u>	<u>PART/GROUP #</u>	<u>DESCRIPTION</u>
1	G38-0378-PC-P	Assy., Chrome-Plated

If a 3/4" NPT inlet connection is needed, order these additional parts

05-2116-PC	Reducer
31-0030-RCP-PUR	Nipple

NOTE: This unit should be connected to an uninterrupted source of potable water, with a minimum flowing pressure of 20 PSI and a maximum static pressure of 125 PSI.

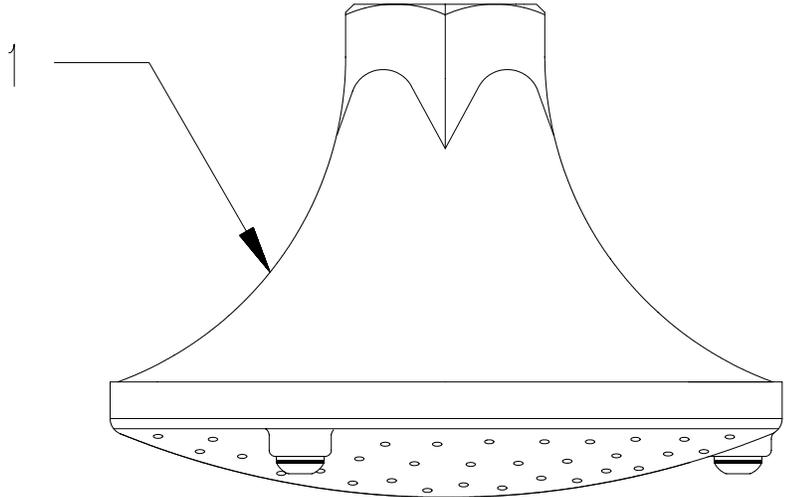

SPEAKMAN COMPANY
The Difference Is The Experience
P.O. Box 191, Wilmington, DE 19899-0191
Phone: 800-537-2107 Fax: 800-977-2747

Note: Product improvements may cause specification and dimensional changes without notice.

2/02
92-1520 Rev-3