

SUBMITTAL SHEET

JOB NAME	ITEM TAG
JOB LOCATION	PART NUMBER
CONTRACTOR	DATE
ENGINEER APPROVAL	DATE

NO LEAD PACK JOINT COUPLING

T-4301NL

Designed and manufactured for the repair of, or new underground water service applications only.

CTS pack-joint end connections provide the maximum pullout resistance against internal pressure variations and backfilling stress. They are designed to be installed onto the following tubing types: Type K or L copper water tubing compliant with ASTM B88; Polyethylene plastic tubing compliant with ASTM D2737 SDR 9 (insert stiffener required).


Insert stiffeners (Model T-4500, sold separately) are required at each pack-joint connection, when installing Polyethylene (PE) plastic tubing.

Available in nominal sizes 3/4" to 2" copper-tubing-size.

Working Pressure, Non Shock (PSI)

3/4" - 1" - 100 psi up to 100° F

1-1/4" - 2" - 80 psi up to 100° F

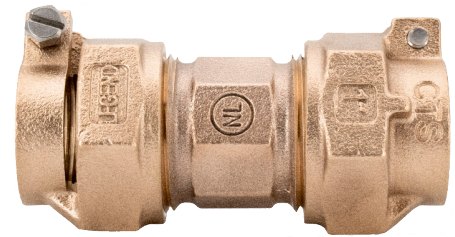


Pictured:
T-4301NL

MATERIAL SPECIFICATION

PART	MATERIAL	SPECIFICATION
1 Body	Lead-free cast bronze	ASTM B584 UNS C89836
2 Pack-joint nut	Cast bronze	ASTM B584 UNS C89836
3 Pack-joint gasket	Buna-N (NBR) nitrilic rubber	Commercial grade
4 Pack-joint anti-friction ring	PA 66	Commercial grade
5 Pack-joint clamp bolt	Stainless steel	AISI grade 304

DIMENSIONS

Size	A	B	C	D	Item No.
3/4"	0.44	4.13	1.56	0.89	313-214NL
1"	0.49	4.37	1.83	1.14	313-215NL
1-1/4"	0.57	4.82	2.42	1.37	313-216NL
1-1/2"	0.61	6.57	2.41	1.63	313-217NL
2"	0.66	7.16	2.97	2.14	313-218NL

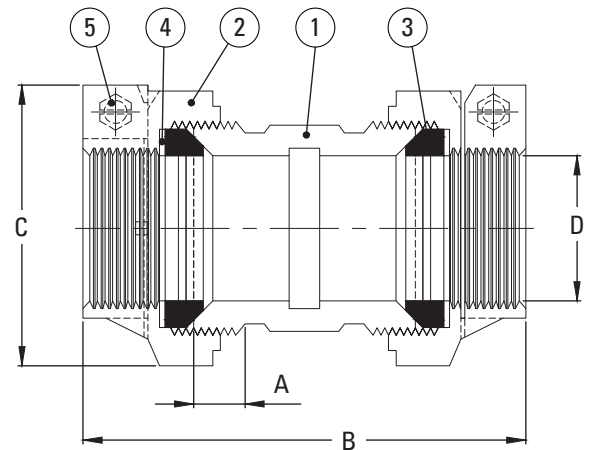

Pictured:
T-4301NL
Cut-away

Certifications/Listings:

Third-party certified.

ANSI/NSF 61: Drinking water system components health effects.

ANSI/NSF 372: Drinking water system components-lead content.

Standards:

AWWA C800: Underground service line valves and fittings.