

INSTALLATION INSTRUCTIONS

FOR PACKAGE AIR CONDITIONERS FEATURING NEW INDUSTRY STANDARD R410A REFRIGERANT ~~R-410B~~ R-410A WITH CLEAR CONTROL

RLNL-G SERIES 15, 20 & 25 TON [52.8, 70.3, 87.9 kW]
60 HZ MODELS (COMPLIES WITH ASHRAE 90.1-2007)



RECOGNIZE THIS SYMBOL AS AN INDICATION OF IMPORTANT SAFETY INFORMATION!

⚠ WARNING

THESE INSTRUCTIONS ARE INTENDED AS AN AID TO QUALIFIED, LICENSED SERVICE PERSONNEL FOR PROPER INSTALLATION, ADJUSTMENT AND OPERATION OF THIS UNIT. READ THESE INSTRUCTIONS THOROUGHLY BEFORE ATTEMPTING INSTALLATION OR OPERATION. FAILURE TO FOLLOW THESE INSTRUCTIONS MAY RESULT IN IMPROPER INSTALLATION, ADJUSTMENT, SERVICE OR MAINTENANCE POSSIBLY RESULTING IN FIRE, ELECTRICAL SHOCK, PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.



DO NOT DESTROY THIS MANUAL

PLEASE READ CAREFULLY AND KEEP IN A SAFE PLACE FOR FUTURE REFERENCE BY A SERVICEMAN



[] INDICATES METRIC CONVERSIONS

92-23577-126-00

I. TABLE OF CONTENTS

Table of Contents	2
Introduction	3
Checking Product Received.	3
Equipment Protection.	3
Specifications.	3
General	3
Major Components.	4
R-410A Refrigerant	4
Unit Dimensions	5-7
General Data	8-10
Electrical Data.	11-12
Installation	13
General	13
Pre-Installation Check Points.	13
Location	13
Outside Slab Installation	13
Clearances.	13
Rooftop Installation	14
Ductwork	15
Filters	15
Cover Panel Installation/Conversion Procedure	16
Condensate Drain	16
Electrical Wiring	16
Power Wiring	16
Control Wiring	17
Internal Wiring	17
Thermostat/Humidity Sensor	17
Indoor Air Flow Data	18
Crankcase Heat	18
Airflow Performance Tables	19-21
Pre-Start Check	22
Startup	22
Operation	22
Cooling Mode.	22
Heating Mode.	22
HumidiDry™ System	23
Humidity Sensory.	23
Refrigerant Solenoid Valves.	23
Operation	23
Variable Frequency Drive (VFD)	24
VFD Model.	24
Replacement	24
Operation	24
Outdoor Fan Motor Controller	24
Auxiliary Heat.	25
Heater Kit Characteristics.	26-27
Troubleshooting Chart	28
Wiring Diagrams	29-30
Charge Charts	31-33

▲ WARNING

PROPOSITION 65: THIS APPLIANCE CONTAINS FIBERGLASS INSULATION. RESPIRABLE PARTICLES OF FIBERGLASS ARE KNOWN TO THE STATE OF CALIFORNIA TO CAUSE CANCER.

▲ WARNING

THE MANUFACTURER'S WARRANTY DOES NOT COVER ANY DAMAGE OR DEFECT TO THE AIR CONDITIONER CAUSED BY THE ATTACHMENT OR USE OF ANY COMPONENTS, ACCESSORIES OR DEVICES (OTHER THAN THOSE AUTHORIZED BY THE MANUFACTURER) INTO, ONTO OR IN CONJUNCTION WITH THE AIR CONDITIONER. YOU SHOULD BE AWARE THAT THE USE OF UNAUTHORIZED COMPONENTS, ACCESSORIES OR DEVICES MAY ADVERSELY AFFECT THE OPERATION OF THE AIR CONDITIONER AND MAY ALSO ENDANGER LIFE AND PROPERTY. THE MANUFACTURER DISCLAIMS ANY RESPONSIBILITY FOR SUCH LOSS OR INJURY RESULTING FROM THE USE OF SUCH UNAUTHORIZED COMPONENTS, ACCESSORIES OR DEVICES.

▲ WARNING

DISCONNECT ALL POWER TO THE UNIT BEFORE STARTING MAINTENANCE. FAILURE TO DO SO CAN RESULT IN SEVERE ELECTRICAL SHOCK OR DEATH.

II. INTRODUCTION

This booklet contains the installation and operating instructions for your air conditioner. There are a few precautions that should be taken to derive maximum satisfaction from it. Improper installation can result in unsatisfactory operation or dangerous conditions.

Read this booklet and any instructions packaged with separate equipment required to make up the system prior to installation. Give this booklet to the owner and explain its provisions. The owner should retain this booklet for future reference.

III. CHECKING PRODUCT RECEIVED

Upon receiving the unit, inspect it for any damage from shipment. Claims for damage, either shipping or concealed, should be filed immediately with the shipping company. Check the unit model number, heating size, electrical characteristics, and accessories to determine if they are correct.

IV. EQUIPMENT PROTECTION FROM THE ENVIRONMENT

The metal parts of this unit may be subject to rust or deterioration in adverse environmental conditions. This oxidation could shorten the equipment's useful life. Salt spray, fog or mist in seacoast areas, sulphur or chlorine from lawn watering systems, and various chemical contaminants from industries such as paper mills and petroleum refineries are especially corrosive.

If the unit is to be installed in an area where contaminants are likely to be a problem, special attention should be given to the equipment location and exposure.

1. Avoid having lawn sprinkler heads spray direction on the unit cabinet.
2. In coastal areas, locate the unit on the side of the building away from the waterfront.
3. Shielding provided by a fence or shrubs may give some protection.

Regular maintenance will reduce the buildup of contaminants and help to protect the unit's finish.

1. Frequent washing of the cabinet, fan blade and coil with fresh water will remove most of the salt or other contaminants that build up on the unit.
2. Regular cleaning and waxing of the cabinet with a good automobile polish will provide some protection.
3. A good liquid cleaner may be used several times a year to remove matter that will not wash off with water.

Several different types of protective coatings are offered in some areas. These coatings may provide some benefit, but the effectiveness of such coating materials cannot be verified by the equipment manufacturer.

The best protection is frequent cleaning, maintenance and minimal exposure to contaminants.

V. SPECIFICATIONS

A. GENERAL

The Packaged Air Conditioner is available without heat or with 20, 40, 60 or 75 kW electric heat. Cooling capacities of 15, 20, and 25 nominal tons of cooling are available. Units are convertible from bottom supply and return to horizontal supply and return by relocation of supply and return air access panels. See cover installation detail.

The units are weatherized for mounting outside of the building.

The information on the rating plate is in compliance with the FTC and DOE rating for single phase units. The following information is for three phase units which **are not** covered under the DOE certification program.

1. The efficiency rating of this unit is a product thermal efficiency rating determined under continuous operating conditions independent of any installed system.

B. MAJOR COMPONENTS

The unit includes a hermetically-sealed refrigerating system (consisting of compressors, condenser coil, evaporator coil with thermal expansion valves, micro-channel reheat coil, solenoid valves), circulation air blower, condenser fans, variable frequency drive (VFD) outdoor fan motor controller (OFMC) and all necessary internal electrical wiring. The cooling system of these units is factory-evacuated, charged and performance tested. Refrigerant amount and type are indicated on rating plate.

C. R-410A REFRIGERANT

All units are factory charged with R-410A refrigerant.

1. Specification of R-410A:

Application: R-410A is not a drop-in replacement for R-22; equipment designs must accommodate its higher pressures. It cannot be retrofitted into R-22 units.

Pressure: The pressure of R-410A is approximately 60% (1.6 times) greater than R-22. Recovery and recycle equipment, pumps, hoses and the like need to have design pressure ratings appropriate for R-410A. *Manifold sets need to range up to 800 psig high-side and 250 psig low-side with a 550 psig low-side retard. Hoses need to have a service pressure rating of 800 psig. Recovery cylinders need to have a 400 psig service pressure rating.* DOT 4BA400 or DOT BW400.

Combustibility: At pressures above 1 atmosphere, mixture of R-410A and air can become combustible. R-410A and air should never be mixed in tanks or supply lines, or be allowed to accumulate in storage tanks. Leak checking should never be done with a mixture of R-410A and air. Leak checking can be performed safely with nitrogen or a mixture of R-410A and nitrogen.

2. Quick Reference Guide For R-410A

- R-410A refrigerant operates at approximately 60% higher pressure (1.6 times) than R-22. Ensure that servicing equipment is designed to operate with R-410A.
- R-410A refrigerant cylinders are pink.
- R-410A, as with other HFC's is only compatible with POE oils.
- Vacuum pumps will not remove moisture from POE oil.
- R-410A systems are to be charged with liquid refrigerants. Prior to March 1999, R-410A refrigerant cylinders had a dip tube. These cylinders should be kept upright for equipment charging. Post March 1999 cylinders do not have a dip tube and should be inverted to ensure liquid charging of the equipment.
- Do not install a suction line filter drier in the liquid line.
- A liquid line filter drier is standard on every unit.
- Desiccant (drying agent) must be compatible for POE oils and R-410A.

3. Evaporator Coil / TXV

The thermostatic expansion valve is specifically designed to operate with R-410A. **DO NOT use an R-22 TXV. The existing evaporator must be replaced with the factory specified TXV evaporator specifically designed for R-410A.**

4. Tools Required For Installing & Servicing R-410A Models

Manifold Sets:

- Up to 800 PSIG High side
- Up to 250 PSIG Low Side
- 550 PSIG Low Side Retard

Manifold Hoses:

- Service Pressure Rating of 800 PSIG


Recovery Cylinders:

- 400 PSIG Pressure Rating
- Dept. of Transportation 4BA400 or BW400

CAUTION


R-410A systems operate at higher pressures than R-22 systems. Do not use R-22 service equipment or components on R-410A equipment.

FIGURE 1
UNIT DIMENSIONS (BOTTOM VIEW)

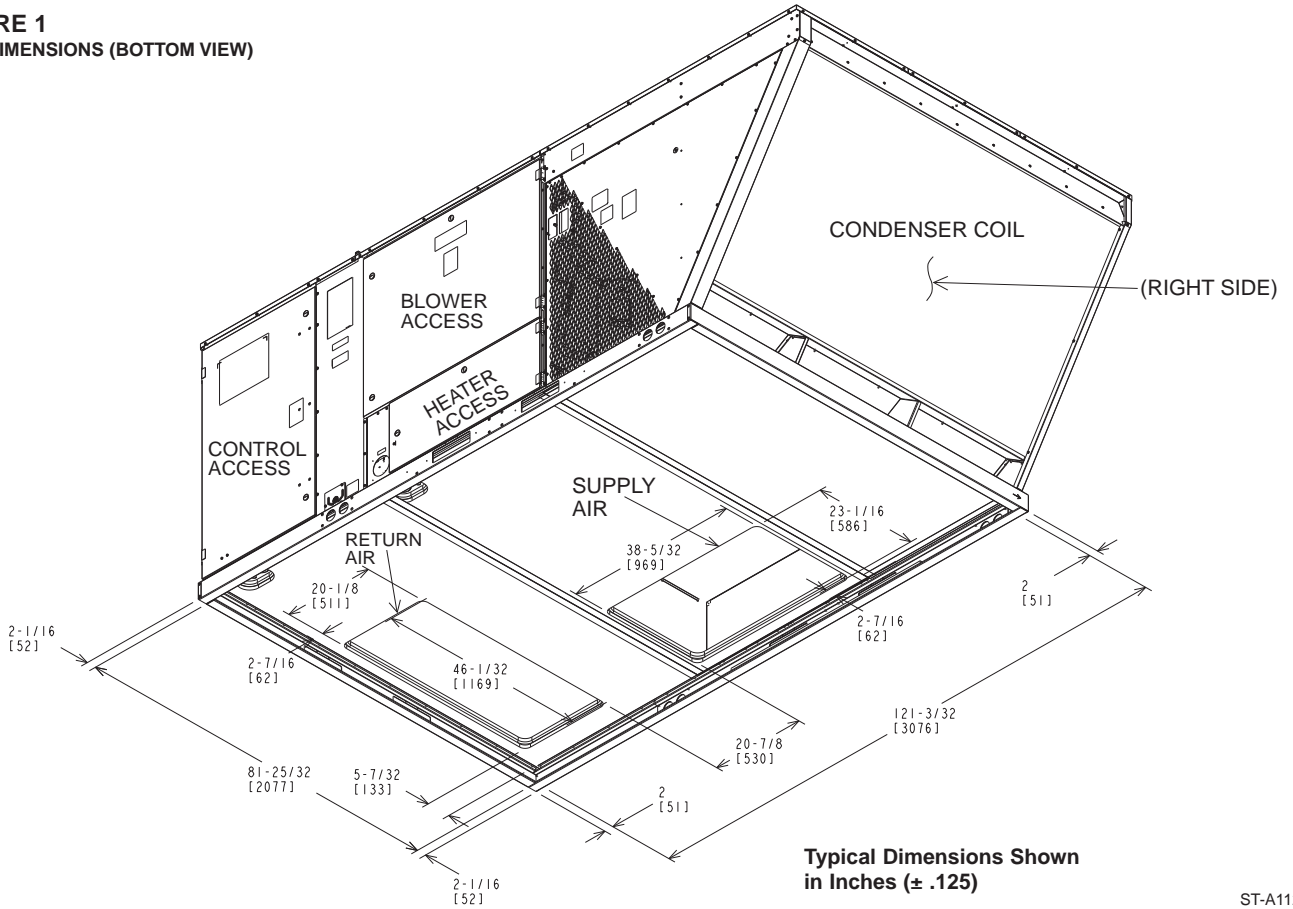


ST-A1125-02B

FIGURE 2
UNIT DIMENSIONS (BOTTOM VIEW)

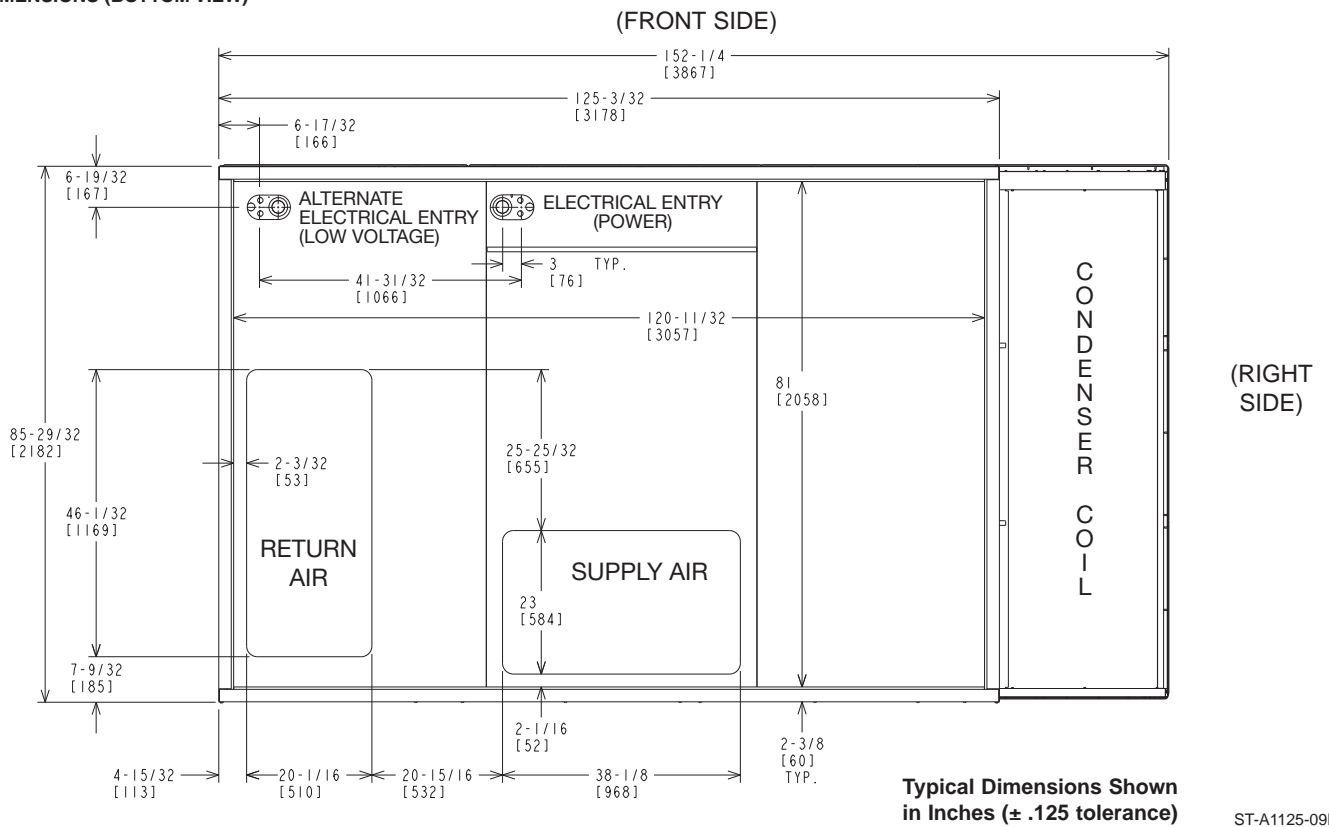

ST-A1125-09B


**FIGURE 3
UNIT DIMENSIONS**

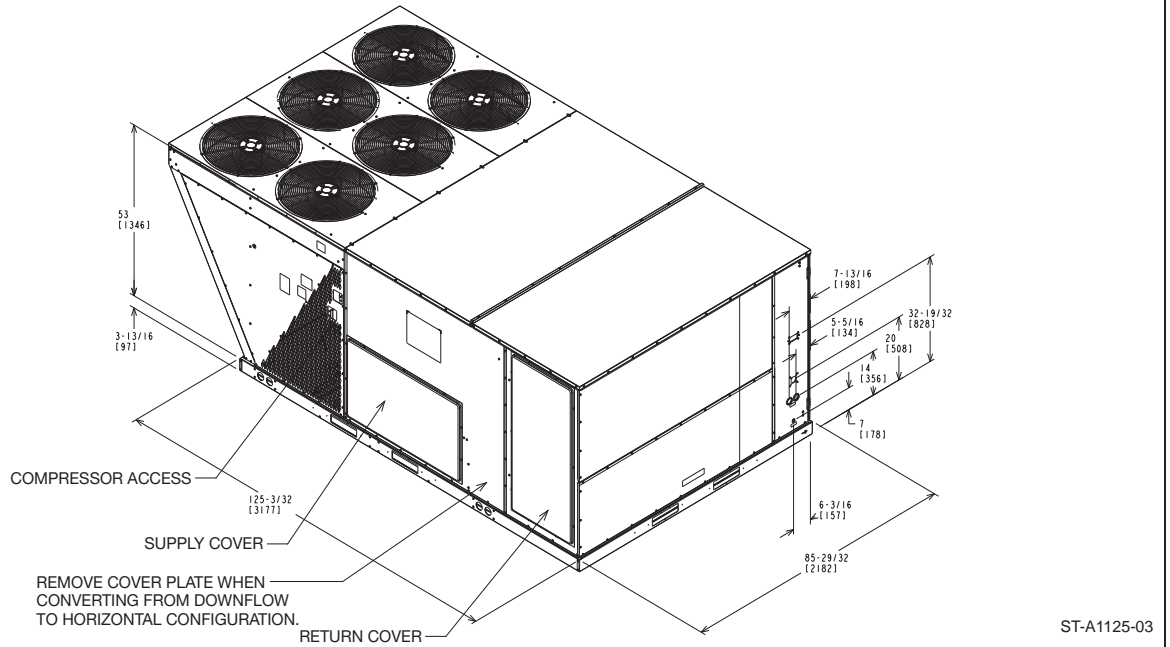

**FIGURE 4
UNIT DIMENSIONS**

REAR VIEW

CONDENSER COIL (RIGHT SIDE)

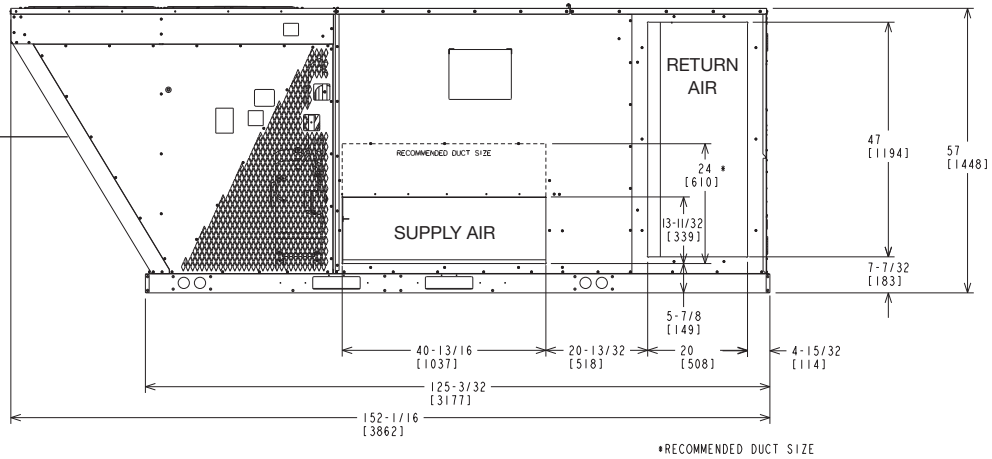

**FIGURE 5
COMPONENT LOCATION**

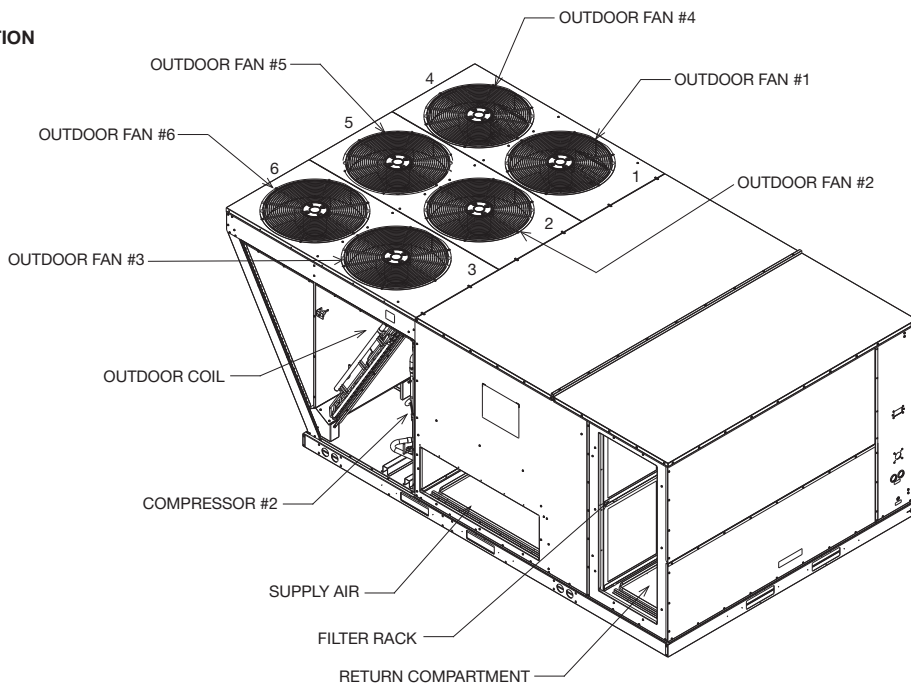


FIGURE 6
UNIT DIMENSIONS & COMPONENT ACCESS

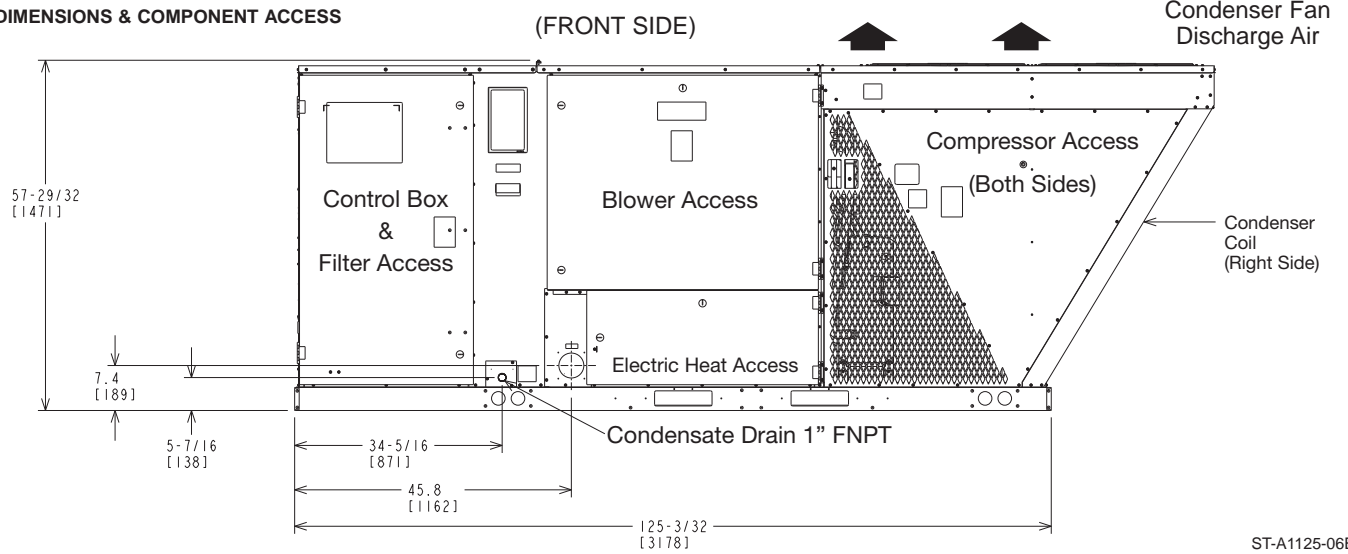


FIGURE 7
UNIT DIMENSIONS & COMPONENT ACCESS


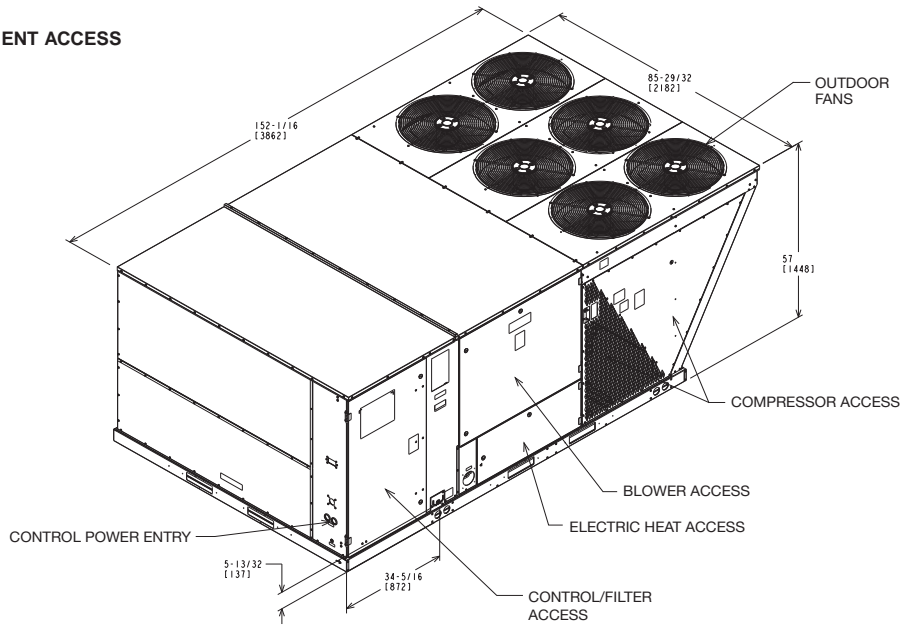


FIGURE 8
INTERNAL COMPONENT LOCATIONS

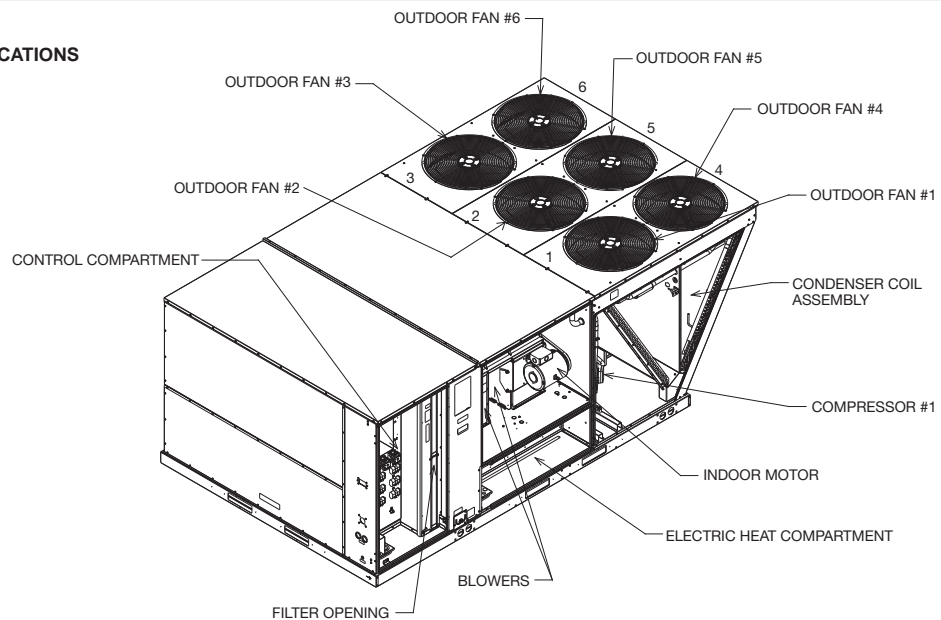

GENERAL DATA - RLNL

Model RLNL- Series	G180CR	G180CS	G180DR	G180DS
Cooling Performance¹				Continued ->
Gross Cooling Capacity Btu [kW]	188,000 [55.08]	188,000 [55.08]	188,000 [55.08]	188,000 [55.08]
EER, SEER ²	11.1/NA	11.1/NA	11.1/NA	11.1/NA
Nominal CFM/AHRI Rated CFM [L/s]	6000/5900 [2831/2784]	6000/5900 [2831/2784]	6000/5900 [2831/2784]	6000/5900 [2831/2784]
AHRI Net Cooling Capacity Btu [kW]	182,000 [53.33]	182,000 [53.33]	182,000 [53.33]	182,000 [53.33]
Net Sensible Capacity Btu [kW]	135,700 [39.76]	135,700 [39.76]	135,700 [39.76]	135,700 [39.76]
Net Latent Capacity Btu [kW]	46,300 [13.57]	46,300 [13.57]	46,300 [13.57]	46,300 [13.57]
IEER ³ (Standard / VFD)	14.6	14.6	14.6	14.6
Net System Power kW	16.35	16.35	16.35	16.35
Compressor				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
Outdoor Sound Rating (dB)⁵	91	91	91	91
Outdoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]
Rows / FPI [FPcm]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]
Indoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows / FPI [FPcm]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Re-Heat Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	0.709 [18]	0.709 [18]	0.709 [18]	0.709 [18]
Face Area sq. ft. [sq. m]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Outdoor Fan - Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	4/24 [609.6]	4/24 [609.6]	4/24 [609.6]	4/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	16000 [7550]	16000 [7550]	16000 [7550]	16000 [7550]
No. Motors/HP	4 at 1/3 HP	4 at 1/3 HP	4 at 1/3 HP	4 at 1/3 HP
Motor RPM	1075	1075	1075	1075
Indoor Fan - Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds (Standard / VFD)	Multiple	Multiple	Multiple	Multiple
No. Motors	1	1	1	1
Motor HP	3	5	3	5
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	184	56	184
Filter - Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]	299/211 [8477/5982]	299/211 [8477/5982]	299/211 [8477/5982]	299/211 [8477/5982]
Weights				
Net Weight lbs. [kg]	1906 [865]	1935 [878]	1906 [865]	1935 [878]
Ship Weight lbs. [kg]	2032 [922]	2061 [935]	2032 [922]	2061 [935]

NOTES:

- Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- Integrated Energy Efficiency Ratio (IEER) is rated in accordance with AHRI Standard 210/240 or 340/360.
- Not applicable to these units.
- Outdoor Sound Rating shown is tested in accordance with ARI Standard 270. 25 Ton Model is outside the scope of AHRI Standard 340/360.

GENERAL DATA - RLNL

Model RLNL- Series	G240CR	G240CS	G240DR	G240DS
Cooling Performance¹				Continued ->
Gross Cooling Capacity Btu [kW]	244,000 [71.49]	244,000 [71.49]	244,000 [71.49]	244,000 [71.49]
EER, SEER ²	11.1/NA	11.1/NA	11.1/NA	11.1/NA
Nominal CFM/AHRI Rated CFM [L/s]	8000/7725 [3775/3645]	8000/7725 [3775/3645]	8000/7725 [3775/3645]	8000/7725 [3775/3645]
AHRI Net Cooling Capacity Btu [kW]	234,000 [68.56]	234,000 [68.56]	234,000 [68.56]	234,000 [68.56]
Net Sensible Capacity Btu [kW]	171,600 [50.28]	171,600 [50.28]	171,600 [50.28]	171,600 [50.28]
Net Latent Capacity Btu [kW]	62,400 [18.28]	62,400 [18.28]	62,400 [18.28]	62,400 [18.28]
IEER ³ (Standard / VFD)	14.8	14.8	14.8	14.8
Net System Power kW	21.04	21.04	21.04	21.04
Compressor				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
Outdoor Sound Rating (dB)⁵	91	91	91	91
Outdoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
Indoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows / FPI [FPcm]	3 / 13 [7]	3 / 13 [7]	3 / 13 [7]	3 / 13 [7]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Re-Heat Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	0.709 [18]	0.709 [18]	0.709 [18]	0.709 [18]
Face Area sq. ft. [sq. m]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Outdoor Fan - Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	19800 [9344]	19800 [9344]	19800 [9344]	19800 [9344]
No. Motors/HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP
Motor RPM	1075	1075	1075	1075
Indoor Fan - Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds (Standard / VFD)	Multiple	Multiple	Multiple	Multiple
No. Motors	1	1	1	1
Motor HP	5	7 1/2	5	7 1/2
Motor RPM	1725	1725	1725	1725
Motor Frame Size	184	213	184	184
Filter - Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]	430/331 [1219/9384]	430/331 [1219/9384]	430/331 [1219/9384]	430/331 [1219/9384]
Weights				
Net Weight lbs. [kg]	2231 [1012]	2269 [1029]	2231 [1012]	2269 [1029]
Ship Weight lbs. [kg]	2357 [1069]	2395 [1086]	2357 [1069]	2395 [1086]

NOTES:

- Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- Integrated Energy Efficiency Ratio (IEER) is rated in accordance with AHRI Standard 210/240 or 340/360.
- Not applicable to these units.
- Outdoor Sound Rating shown is tested in accordance with ARI Standard 270. 25 Ton Model is outside the scope of AHRI Standard 340/360.

GENERAL DATA - RLNL

Model RLNL- Series	G300CR	G300CS	G300DR	G300DS
Cooling Performance¹				
Gross Cooling Capacity Btu [kW]	304,000 [89.07]	304,000 [89.07]	304,000 [89.07]	304,000 [89.07]
EER, SEER ²	10/NA	10/NA	10/NA	10/NA
Nominal CFM/AHRI Rated CFM [L/s]	10000/9575 [4719/4518]	10000/9575 [4719/4518]	10000/9575 [4719/4518]	10000/9575 [4719/4518]
AHRI Net Cooling Capacity Btu [kW]	288,000 [84.38]	288,000 [84.38]	288,000 [84.38]	288,000 [84.38]
Net Sensible Capacity Btu [kW]	210,000 [61.53]	210,000 [61.53]	210,000 [61.53]	210,000 [61.53]
Net Latent Capacity Btu [kW]	78,000 [22.85]	78,000 [22.85]	78,000 [22.85]	78,000 [22.85]
IEER ³ (Standard / VFD)	14.1	14.1	14.1	14.1
Net System Power kW	26.87	26.87	26.87	26.87
Compressor				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
Outdoor Sound Rating (dB)⁵				
	91	91	91	91
Outdoor Coil - Fin Type				
Tube Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
Indoor Coil - Fin Type				
Tube Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows / FPI [FPcm]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Re-Heat Coil - Fin Type				
Tube Type	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	0.709 [18]	0.709 [18]	0.709 [18]	0.709 [18]
Face Area sq. ft. [sq. m]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Outdoor Fan - Type				
Tube Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	19800 [9344]	19800 [9344]	19800 [9344]	19800 [9344]
No. Motors/HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP
Motor RPM	1075	1075	1075	1075
Indoor Fan - Type				
Tube Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds (Standard / VFD)	Multiple	Multiple	Multiple	Multiple
No. Motors	1	1	1	1
Motor HP	7 1/2	10	7 1/2	10
Motor RPM	1725	1725	1725	1725
Motor Frame Size	213	215	213	215
Filter - Type				
Tube Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]				
	464/357 [13154/10121]	464/357 [13154/10121]	464/357 [13154/10121]	464/357 [13154/10121]
Weights				
Net Weight lbs. [kg]	2330 [1057]	2341 [1062]	2330 [1057]	2341 [1062]
Ship Weight lbs. [kg]	2456 [1114]	2467 [1119]	2456 [1114]	2467 [1119]

NOTES:

- Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- Integrated Energy Efficiency Ratio (IEER) is rated in accordance with AHRI Standard 210/240 or 340/360.
- Not applicable to these units.
- Outdoor Sound Rating shown is tested in accordance with ARI Standard 270. 25 Ton Model is outside the scope of AHRI Standard 340/360.

ELECTRICAL DATA - RLNL

ELECTRICAL DATA - RLNL SERIES									
		G180CR	G180CS	G180DR	G180DS	G240CR	G240CS	G240DR	G240DS
Unit Information	Unit Operating Voltage Range	187-253	187-253	414-506	414-506	187-253	187-253	414-506	414-506
	Volts	208/230	208/230	460	460	208/230	208/230	460	460
	Minimum Circuit Ampacity	78/78	81/81	38	40	101/101	109/109	52	56
	Minimum Overcurrent Protection Device Size	90/90	90/90	45	45	110/110	125/125	60	60
	Maximum Overcurrent Protection Device Size	100/100	100/100	45	50	125/125	125/125	60	70
Compressor Motor	No.	2	2	2	2	2	2	2	2
	Volts	200/230	200/230	460	460	200/230	200/230	460	460
	Phase	3	3	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	7	7	7	7	10	10	10	10
	Amps (RLA), Comp. 1	25/25	25/25	12.2	12.2	33.3/33.3	33.3/33.3	17.9	17.9
	Amps (LRA), Comp. 1	164/164	164/164	100	100	239/239	239/239	125	125
	HP, Compressor 2	7	7	7	7	7 1/2	7 1/2	7 1/2	7 1/2
	Amps (RLA), Comp. 2	25/25	25/25	12.2	12.2	29.5/29.5	29.5/29.5	14.7	14.7
	Amps (LRA), Comp. 2	164/164	164/164	100	100	195/195	195/195	95	95
Condenser Motor	No.	4	4	4	4	6	6	6	6
	Volts	208/230	208/230	460	460	208/230	208/230	460	460
	Phase	1	1	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA, each)	2.4/2.4	2.4/2.4	1.4	1.4	2.4/2.4	2.4/2.4	1.4	1.4
	Amps (LRA, each)	4.7/4.7	4.7/4.7	2.4	2.4	4.7/4.7	4.7/4.7	2.4	2.4
Evaporator Fan	No.	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	208/230	208/230	460	460
	Phase	3	3	3	3	3	3	3	3
	HP	3	5	3	5	5	7 1/2	5	7 1/2
	Amps (FLA, each)	11.5/11.5	14.9/14.9	4.6	6.6	14.7/14.7	23.1/23.1	6.6	9.6
	Amps (LRA, each)	74.5/74.5	82.6/82.6	38.1	46.3	82.6/82.6	136/136	46.3	67

ELECTRICAL DATA - RLNL (continued)

ELECTRICAL DATA - RLNL SERIES					
		G300CR	G300CS	G300DR	G300DS
Unit Information	Unit Operating Voltage Range	187-253	187-253	414-506	414-506
	Volts	208/230	208/230	460	460
	Minimum Circuit Ampacity	147/147	149/149	60	63
	Minimum Overcurrent Protection Device Size	175/175	175/175	70	70
	Maximum Overcurrent Protection Device Size	175/175	175/175	70	70
Compressor Motor	No.	2	2	2	2
	Volts	208/240	208/240	460	460
	Phase	3	3	3	3
	RPM	3450	3450	3450	3450
	HP, Compressor 1	11 1/2	11 1/2	11 1/2	11 1/2
	Amps (RLA), Comp. 1	48.1/48.1	48.1/48.1	18.6	18.6
	Amps (LRA), Comp. 1	245/245	245/245	125	125
	HP, Compressor 2	11 1/2	11 1/2	11 1/2	11 1/2
	Amps (RLA), Comp. 2	48.1/48.1	48.1/48.1	18.6	18.6
	Amps (LRA), Comp. 2	245/245	245/245	125	125
Condenser Motor	No.	6	6	6	6
	Volts	208/230	208/230	460	460
	Phase	1	1	1	1
	HP	1/3	1/3	1/3	1/3
	Amps (FLA, each)	2.4/2.4	2.4/2.4	1.4	1.4
	Amps (LRA, each)	4.7/4.7	4.7/4.7	2.4	2.4
Evaporator Fan	No.	1	1	1	1
	Volts	208/230	208/230	460	460
	Phase	3	3	3	3
	HP	7 1/2	10	7 1/2	10
	Amps (FLA, each)	24.2/24.2	28.5/28.5	9.6	12.5
	Amps (LRA, each)	136/136	178/178	67	74.6

V. INSTALLATION

A. GENERAL

1. PRE-INSTALLATION CHECK-POINTS

Before attempting any installation, the following points should be carefully considered:

- Structural strength of supporting members. (rooftop installation)
- Clearances and provision for servicing.
- Power supply and wiring.
- Air duct connections.
- Drain facilities and connections.
- Location for minimum noise.

2. LOCATION

These units are designed for outdoor installations. They can be mounted on a slab or rooftop. They are not to be installed within any part of a structure such as an attic, crawl space, closet, or any other place where condenser air flow is restricted or other than outdoor ambient conditions prevail. Since the application of the units is of the outdoor type, it is important to consult your local code authorities at the time the first installation is made.

B. OUTSIDE SLAB INSTALLATION (Typical outdoor slab installations are shown in Figures 9 and 10.)


- Select a location where external water drainage cannot collect around the unit.
- Provide a level concrete slab extending 3" beyond all four sides of the unit. The slab should be sufficient above grade to prevent ground water from entering the unit. **IMPORTANT: To prevent transmission of noise or vibration, slab should not be connected to building structure.**
- The location of the unit should be such as to provide proper access for inspection and servicing.
- Locate unit where operating sounds will not disturb owner or neighbors.
- Locate unit so roof runoff water does not pour directly on the unit. Provide gutter or other shielding at roof level. Do not locate unit in an area where excessive snow drifting may occur or accumulate.

C. CLEARANCES

The following minimum clearances must be observed for proper unit performance and serviceability.


FIGURE 9
PACKAGED AIR CONDITIONER
OUTSIDE SLAB INSTALLATION, BASEMENT OR CRAWL SPACE
DISTRIBUTION SYSTEM

RECOMMENDED CLEARANCE	LOCATION	+ WITHOUT HORIZONTAL ECONOMIZER/ 42" WITH HORIZONTAL ECONOMIZER
80"	A - FRONT	
18"	B - CONDENSER COIL	
18/42"	+C - DUCT SIDE	
18/48"	*D - EVAPORATOR END	
60"	E - ABOVE	
* WITHOUT ECONOMIZER/48" WITH ECONOMIZER		

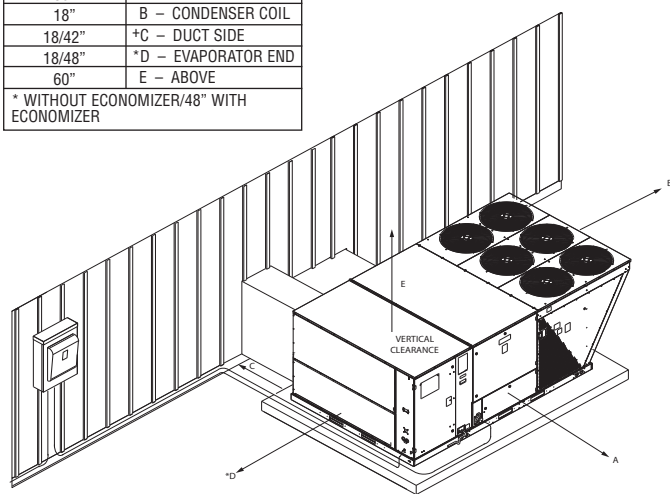


ST-A1125-29

FIGURE 10
PACKAGED AIR CONDITIONER
OUTSIDE SLAB INSTALLATION, CLOSET DISTRIBUTION SYSTEM. SLAB
FLOOR CONSTRUCTION

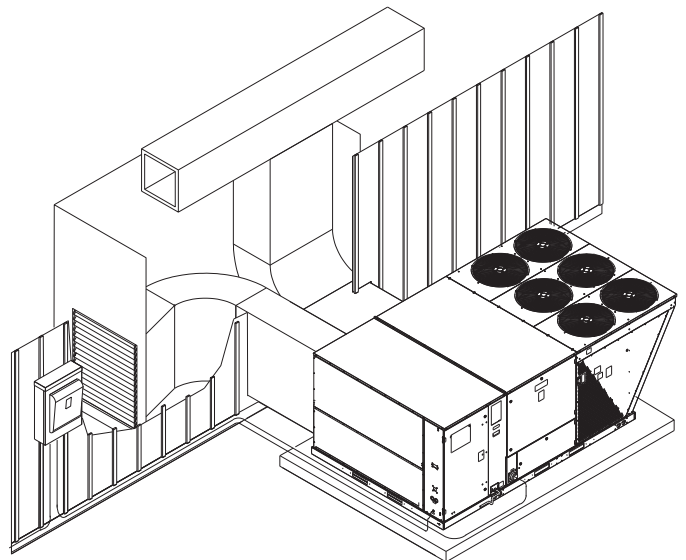

ST-A1125-30

FIGURE 11

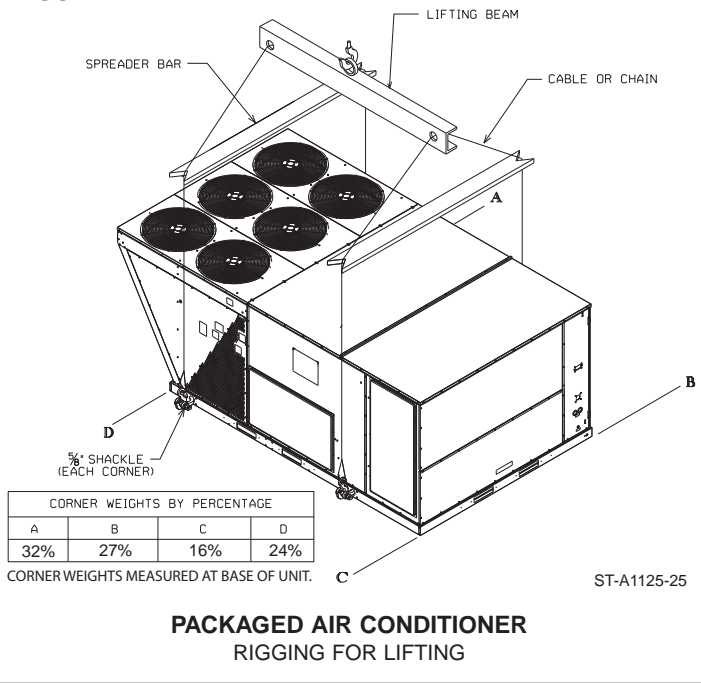



1. Provide 80" minimum clearance at the front of the unit to facilitate removal of the drain pan and return air filters. Provide 18" minimum clearance at all other sides of the unit.
2. Provide 60" minimum clearance between top of unit and maximum 3 foot overhang.
3. Unit is design certified for application on combustible flooring with 0" minimum clearance.
4. See Figure 9 for illustration of minimum installation-service clearances.

D. ROOFTOP INSTALLATION

1. Before locating the unit on the roof, make sure that the strength of the roof and beams is adequate at that point to support the weight involved. This is very important and user's responsibility.
2. For rigging and roofcurb details, see Figures 11 and 12. Use field-furnished spreaders.
3. For roofcurb assembly, see Roofcurb Installation Instructions.
4. If the roofcurb is not used, provisions for disposing of condensate water runoff must be provided.
5. The unit should be placed on a solid and level roofcurb or platform of adequate strength. See Figure 13.
6. The location of the unit on the roof should be such as to provide proper access for inspection and servicing.

IMPORTANT: If unit will not be put into service immediately, cover supply and return openings to prevent excessive condensation.

FIGURE 12

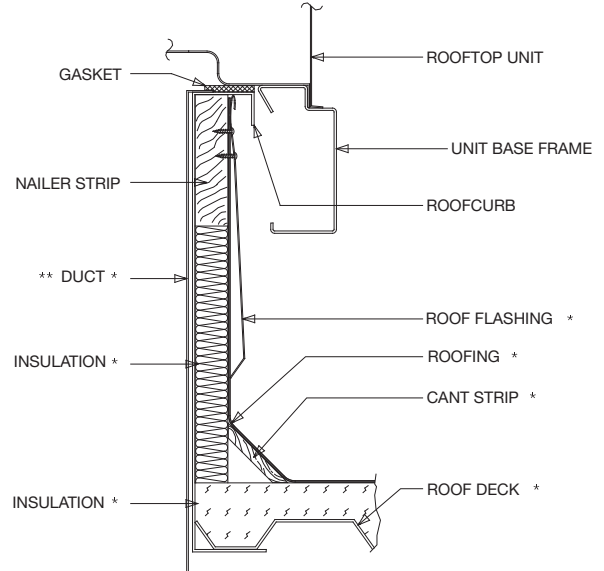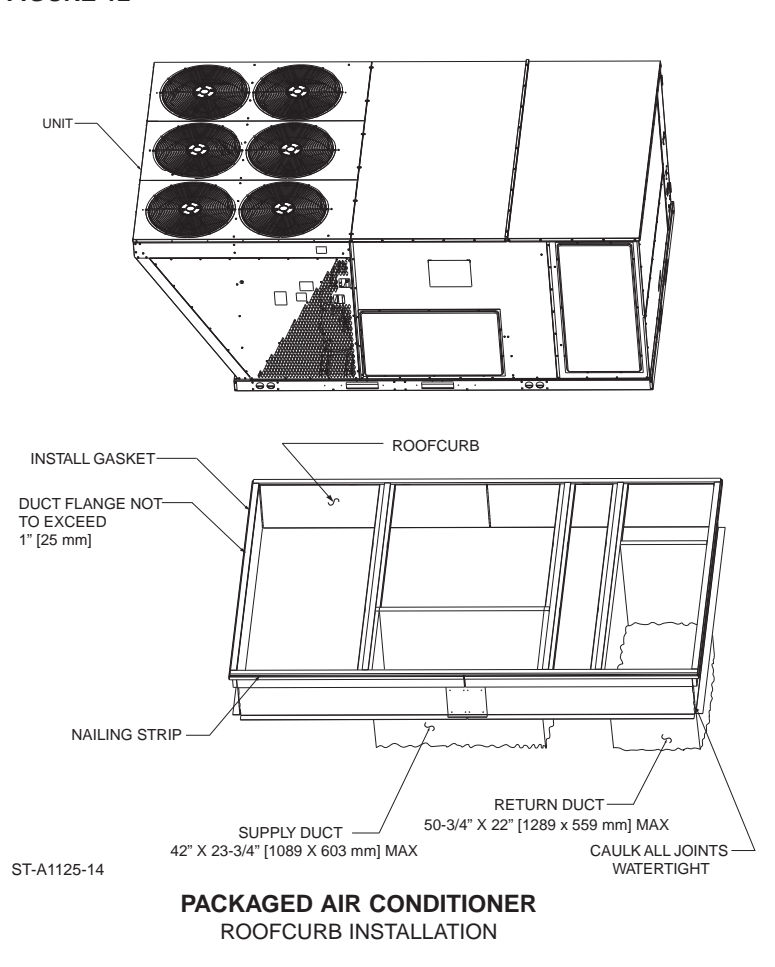

* BY CONTRACTOR
 ** FOR INSTALLATION OF DUCT AS SHOWN, USE RECOMMENDED DUCT SIZES FROM ROOFCURB INSTALLATION INSTRUCTIONS. FOR DUCT FLANGE ATTACHMENT TO UNIT, SEE UNIT INSTALLATION INSTRUCTIONS FOR RECOMMENDED DUCT SIZES.

ST-A0888-02

VI. DUCTWORK

Ductwork should be fabricated by the installing contractor in accordance with local codes and NFPA90A. Industry manuals may be used as a guide when sizing and designing the duct system - contact Air Conditioning Contractors of America, 2800 Shirlington Road, Suite 300, Arlington, VA 22206, <http://www.acca.org>.

The unit should be placed as close to the space to be air conditioned as possible allowing clearance dimensions as indicated. Ducts should be run as directly as possible to supply and return outlets. Use of non-flammable waterproof flexible connectors on both supply and return connections at the unit to reduce noise transmission is recommended.

It is preferable to install the unit on the roof of the structure if the registers or diffusers are located on the wall or in the ceiling. A slab installation could be considered when the registers are low on a wall or in the floor.

On ductwork exposed to outside air conditions of temperature and humidity, use a minimum of 2" of insulation and a vapor barrier. Distribution system in attic, furred space or crawl space should be insulated with at least 2" of insulation with vapor barrier. One-half to 1" thickness of insulation is usually sufficient for ductwork inside the air conditioned space.

Balancing dampers should be provided for each branch duct in the supply system. Ductwork should be properly supported from the structure.

When installing ductwork, consider the following items:



1. Noncombustible flexible connectors should be used between ductwork and unit to reduce noise and vibration transmission into the ductwork.
2. When auxiliary heaters are installed, use noncombustible flexible connectors and clearance to combustible material of 0" for the first 3 feet of discharge duct. Clearance to unit top and side is 0".

VII. FILTERS

This unit is provided with 8 - 20" x 25" x 2" disposable filters. When replacing filters, ensure they are inserted fully to the back to prevent bypass. See Figure 8.

Recommended supplier of this filter is Glassfloss Industries, Inc. or

AAF International
 215 Central Avenue
 P.O. Box 35690
 Louisville, KY 40232
 Phone: 1-800-501-3146
 Part #: 54-42541-04 (20" x 25" x 2")

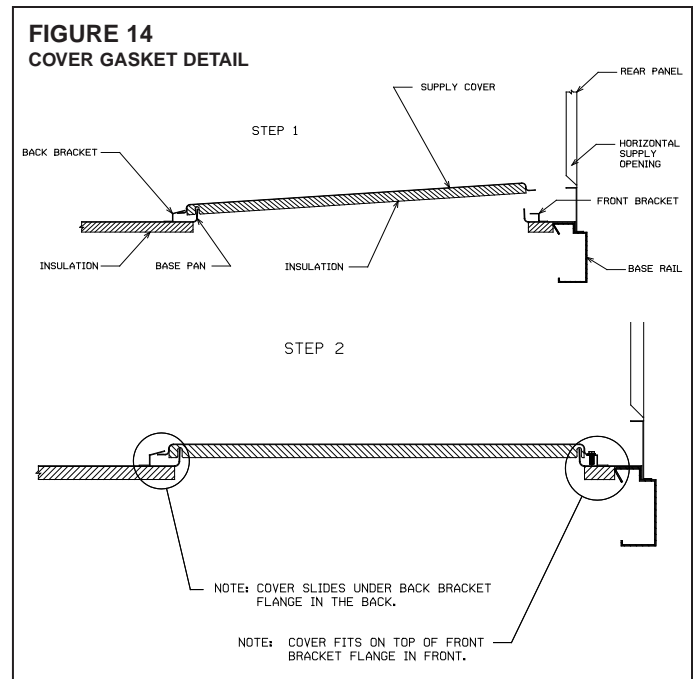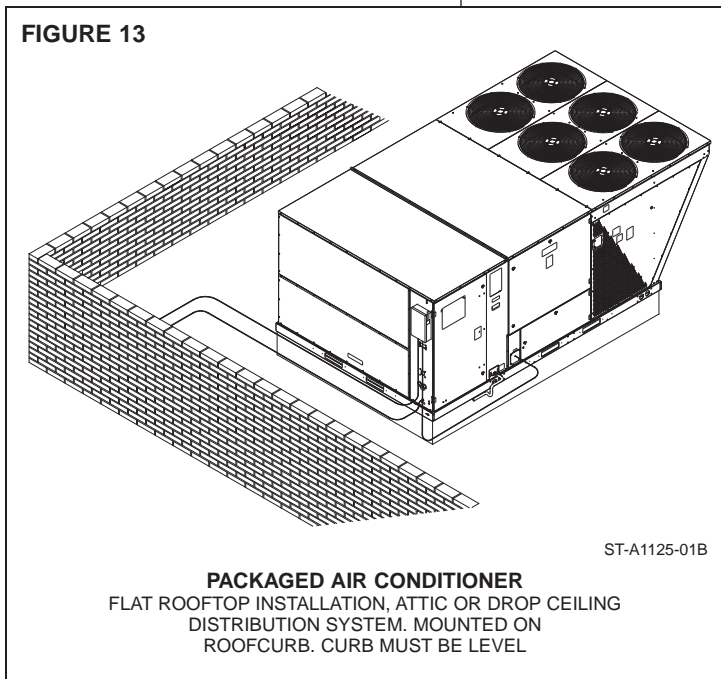

VIII. COVER PANEL INSTALLATION/ CONVERSION PROCEDURE

DOWNFLOW TO HORIZONTAL

1. Remove the screws and covers from the outside of the supply and return sections. Also remove and discard cover plate. See Figure 3.
2. Install the covers over the bottom supply and return openings, painted side up, inserting the **leading flange under the bracket provided**. Place the **back flange to top of the front bracket provided**. See Figure 14.
3. Secure the return and supply cover to front bracket with two (2) screws.

IX. CONDENSATE DRAIN

IMPORTANT: Install a condensate trap to ensure proper condensate drainage. See Figure 15.

The condensate drain pan has a threaded female 1 inch NPT (11.5 TPI) connection. Consult local codes or ordinances for specific requirements of condensate drain piping and disposal.

- To use the removable drain pan feature of this unit, some of the condensate line joints should be assembled for easy removal and cleaning.
- Use a thin layer of Teflon tape or paste on drain pan connections and install only hand tight.
- Do not over tighten drain pan connections as damage to the drain pan may occur.
- Drain line **MUST NOT** block service access panels.
- Drain line must be no smaller than drain pan outlet and adequately sized to accommodate the condensate discharge from the unit.
- Drain line should slope away from unit a minimum of 1/8" per foot to ensure proper drainage.
- Drain line must be routed to an acceptable drain or outdoors in accordance with local codes.
- Do not connect condensate drain line to a closed sewer pipe.
- Drain line may need insulation or freeze protection in certain applications.



X. ELECTRICAL WIRING

Field wiring must comply with the National Electrical Code* and local ordinances that may apply.

*C.E.C. in Canada

A. POWER WIRING

1. This unit incorporates single-point electrical connections for the unit and electric heat accessory.

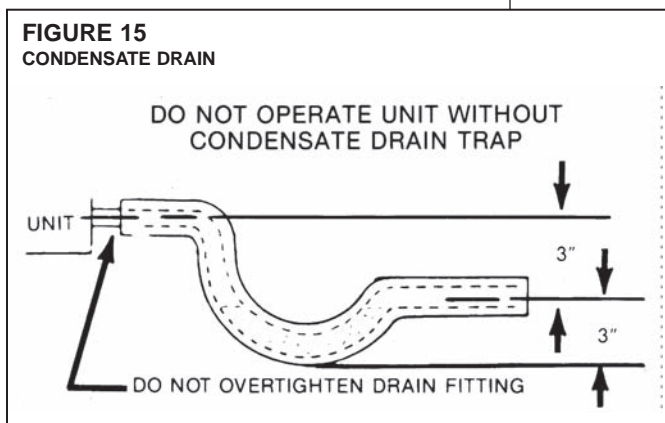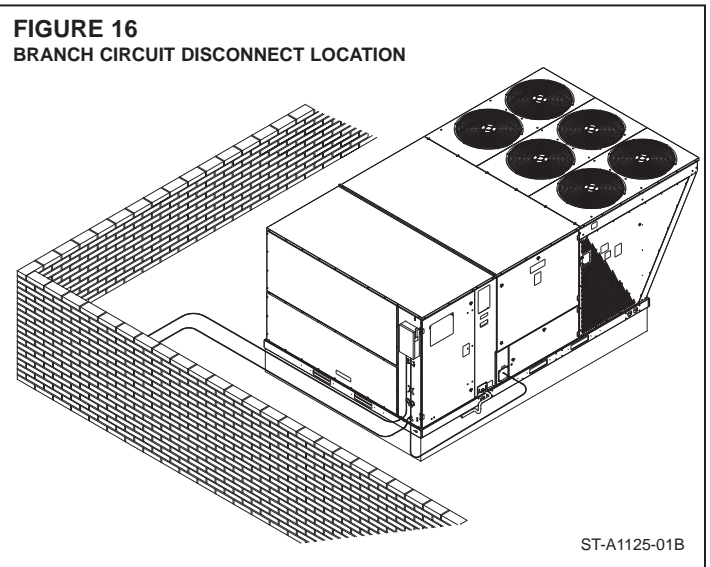

2. It is important that proper electrical power is available to the unit. Voltage should not vary more than 10% from the values marked on the unit rating plate. Phase voltages must be balanced within 3%.
3. Install a branch circuit disconnect within sight of the unit. See Figure 16. Use the unit rating plate or Tables A, B, C, and D to determine the required size.
4. The branch circuit wire must be sized in accordance with the National Electrical Code (C.E.C. in Canada) and local ordinances that may apply using the minimum circuit ampacity found on the unit rating plate.
5. Field-installed power wiring must be run through grounded rain-tight conduit attached to the unit power entry panel and connected as follows:

UNITS WITHOUT ELECTRIC HEAT - Connect power wiring to the power terminal block located on the left side of the electric heat compartment. Connect the ground wire to the adjacent ground lug.

UNITS WITH FACTORY INSTALLED ELECTRIC HEAT - Connect power wiring to the power terminal block located on the electric heater kit. Connect the ground wire to the adjacent ground lug. DO NOT connect aluminum wiring directly to the electric heater terminal block. Wiring to the unit contactors is factory-connected.

6. For field installation of an electric heater kit, follow the instructions below. Refer to the information supplied with the kit.
 - a. Removing screws as required, open heater access door and detach adjacent power entry panel.
 - b. Remove unit contactor wires (1L1, 1L2, 1L3) from unit terminal block on the left side of the electric heat compartment. Remove and discard the terminal block and the adjacent ground lug.
 - c. Remove the heater kit block-off panel and install the heater kit in its place using the screws previously removed.
 - d. Connect the unit contactor wires (1L1, 1L2, 1L3) to the compressor fuse block on the heater kit.
 - e. Re-install the power entry panel & run conduit and the proper size field wiring through the opening in the panel.
 - f. Connect field wiring to the power terminal block located on the electric heater kit. Connect ground wire to the adjacent ground lug.
 - g. Connect heater kit control plug to the receptacle on the control wiring harness.
 - h. Close heater access door and secure with screws previously removed.

B. CONTROL WIRING (Class II)

1. Low voltage wiring should not be run in conduit with power wiring.
 2. Control wiring is routed through the 7/8" hole in the unit side panel. See Figure 7. Use a minimum #18 AWG thermostat wire. For wire lengths exceeding 50', use #16 AWG thermostat wire. Connect the control wiring to the low voltage terminal block located below the unit control box.
 3. Recommended thermostats can be found in the thermostat specifications catalog T11-001.
 4. Figure 18 shows representative low voltage connection diagrams. Read your thermostat installation instructions for any special requirements for your specific thermostat.
- NOTE — Units installed in Canada require that an outdoor thermostat (30,000 min. cycles of endurance) be installed and be wired with C.E.C. Class I wiring.

D. INTERNAL WIRING

1. A diagram of the internal wiring of this unit is located on the inside of the electrical access panel. If any of the original wire, as supplied with the appliance must be replaced, the wire gauge and insulation must be the same as original wiring.

E. THERMOSTAT/HUMIDITY SENSOR

The HumidiDry™ System requires both a thermostat (or temperature sensor) and a humidity sensor. Both devices should be mounted on an inside wall about five feet above the floor in a location where it will not be affected by unconditioned air, sun, or drafts from open doors or other sources. READ installation instructions in heat pump thermostat package CAREFULLY because each has some different wiring requirements.


See Section XVI for humidity sensor information.

▲ WARNING

THE UNIT MUST BE PERMANENTLY GROUNDED. A GROUNDING LUG IS PROVIDED IN THE ELECTRIC HEAT ACCESS AREA FOR A GROUND WIRE. FAILURE TO GROUND THIS UNIT CAN RESULT IN FIRE OR ELECTRICAL SHOCK CAUSING PROPERTY DAMAGE, SEVERE PERSONAL INJURY OR DEATH.

FIGURE 17

STANDARD WIRING

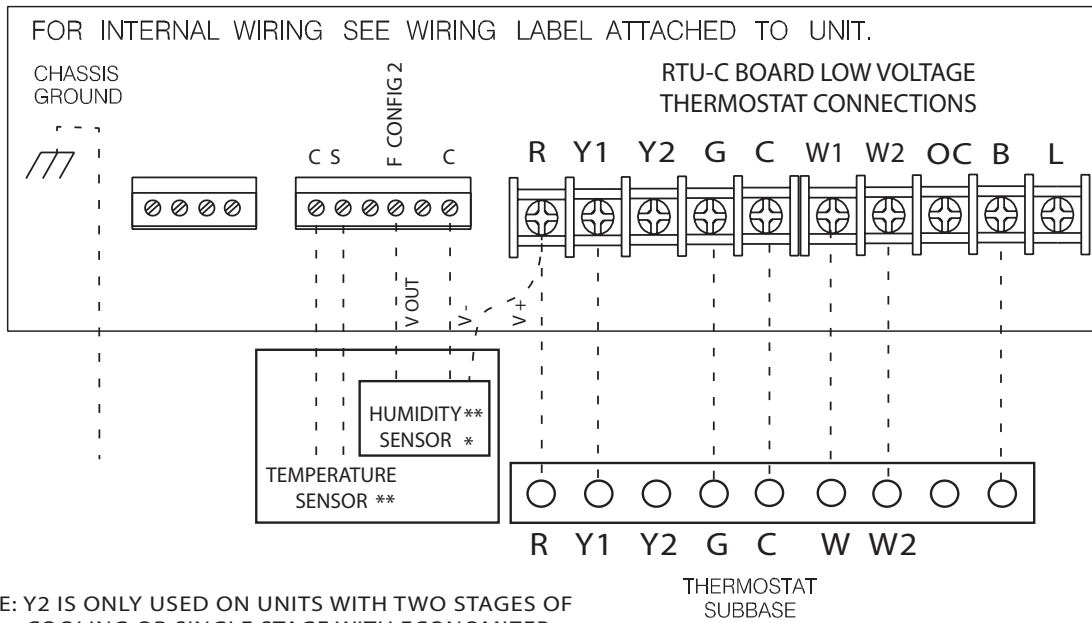

NOTE: Y2 IS ONLY USED ON UNITS WITH TWO STAGES OF COOLING OR SINGLE STAGE WITH ECONOMIZER.

W2 ONLY USED ON UNITS WITH TWO STAGES OF GAS HEAT

* REPRESENTS HUMIDITY SENSOR RHC-ZNS4

** REPRESENTS HUMIDITY AND TEMPERATURE SENSOR RHC-ZNS5

- - - 24 VOLT CONTROL WIRING.

ST-A1141-16-01

XI. INDOOR AIR FLOW DATA

Belt-drive blower models have motor sheaves set for proper CFM at a typical external static. See airflow tables for blower performance.

XII. CRANKCASE HEAT (OPTIONAL)

Crankcase heat is not required on scroll type compressors, but may be desirable under certain conditions. Wires have been provided for the addition of crankcase heaters (see wiring diagrams).

FIGURE 18


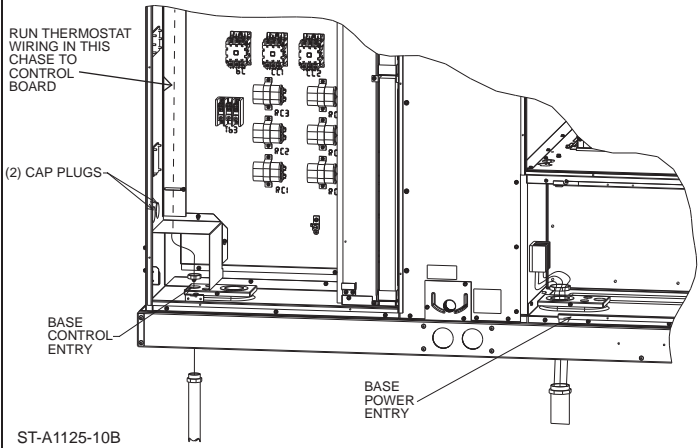


FIGURE 19

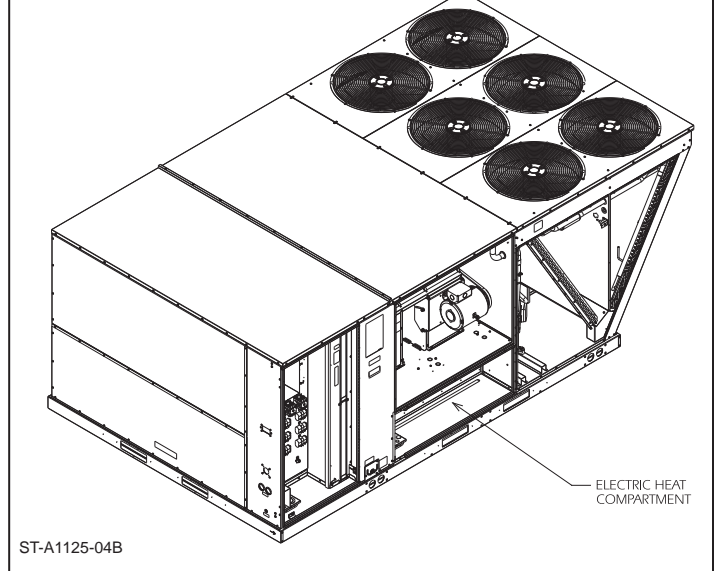

AIRFLOW PERFORMANCE — 15 TON [52.7kW] — 60 Hz — SIDEFLOW

Air Flow CFM [L/s]	Capacity 15 tons [52.7kW]																			
	External Static Pressure — Inches of Water [kPa]																			
	0.1 [0.2]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]
4800 [2265]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5000 [2359]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5200 [2454]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5400 [2548]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5600 [2643]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5800 [2737]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6000 [2831]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6200 [2926]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6400 [3020]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6600 [3114]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6800 [3209]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
7000 [3303]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
7200 [3398]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

NOTE: L-Drive left of bold line, M-Drive right of bold line

	R						S					
Drive Package	3 [2237.1]						5 [3728.5]					
Motor H.P. [W]	BK105H						BK105H					
Blower Sheave	1VP-44						1VP-56					
Motor Sheave	—						—					
Turns Open	1	2	3	4	5	6	1	2	3	4	5	6
RPM	716	689	655	624	593	560	888	860	826	795	761	727

NOTES: 1. Factory sheave settings are shown in bold type.

2. Do not set motor sheave below minimum turns open shown.

3. Re-adjustment of sheave required to achieve rated airflow at ARI minimum External Static Pressure

4. Drive data shown is for horizontal airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

COMPONENT AIRFLOW RESISTANCE — 15 TON [52.7kW]

CFM [L/s]	Resistance — Inches of Water [kPa]												
	4800 [2265]	5000 [2359]	5200 [2454]	5400 [2548]	5600 [2643]	5800 [2737]	6000 [2831]	6200 [2926]	6400 [3020]	6600 [3114]	6800 [3209]	7000 [3303]	7200 [3398]
Wet Coil	0.03 [0.1]	0.04 [0.1]	0.05 [0.1]	0.06 [0.1]	0.06 [0.1]	0.07 [0.2]	0.08 [0.2]	0.09 [0.2]	0.10 [0.2]	0.10 [0.2]	0.11 [0.3]	0.12 [0.3]	0.13 [0.3]
Downflow	0.05 [0.1]	0.05 [0.1]	0.05 [0.1]	0.05 [0.1]	0.05 [0.1]	0.05 [0.1]	0.05 [0.1]	0.06 [0.1]	0.06 [0.1]	0.06 [0.1]	0.07 [0.2]	0.08 [0.2]	0.08 [0.2]
Downflow Economizer RA Damper Open	0.09 [0.2]	0.10 [0.2]	0.10 [0.2]	0.11 [0.3]	0.12 [0.3]	0.13 [0.3]	0.13 [0.3]	0.14 [0.4]	0.15 [0.4]	0.16 [0.4]	0.16 [0.4]	0.17 [0.4]	0.18 [0.4]
Horizontal Economizer RA Damper Open	0.00 [0.0]	0.01 [0.0]	0.01 [0.0]	0.02 [0.0]	0.02 [0.0]	0.03 [0.0]	0.03 [0.0]	0.04 [0.0]	0.04 [0.0]	0.05 [0.0]	0.05 [0.0]	0.06 [0.1]	0.06 [0.1]
Concentric Grill RXRN-AD80 or RXRN-AD81 & Transition RXMC-CJ07	0.21 [0.05]	0.25 [0.06]	0.28 [0.07]	0.32 [0.08]	0.35 [0.09]	0.39 [0.10]	0.43 [0.11]	0.46 [0.11]	0.50 [0.12]	0.54 [0.13]	0.57 [0.14]	0.61 [0.15]	0.64 [0.16]

AIRFLOW CORRECTION FACTORS — 15 TON [52.7kW]

CFM	4800	5000	5200	5400	5600	5800	6000	6200	6400	6600	6800	7000	7200
[L/s]	[2265]	[2359]	[2454]	[2548]	[2643]	[2737]	[2831]	[2926]	[3020]	[3114]	[3209]	[3303]	[3398]
Total MBH	0.97	0.97	0.98	0.98	0.99	1.00	1.00	1.01	1.02	1.02	1.03	1.03	1.04
Sensible MBH	0.87	0.90	0.92	0.94	0.97	0.99	1.02	1.04	1.06	1.09	1.11	1.14	1.16
Power kW	0.98	0.98	0.99	0.99	0.99	1.00	1.00	1.00	1.01	1.01	1.01	1.02	1.02

NOTE: Multiply correction factor times gross performance data — resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE — 25 TON [87.9kW] — 60 Hz — SIDEFLOW

Air Flow CFM [L/s]		External Static Pressure — Inches of Water [kPa]																			
		0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]
8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]
8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]	8200 [3869]
8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]	8400 [3964]
8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]	8600 [4058]
8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]	8800 [4153]
9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]	9000 [4247]
9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]	9200 [4341]
9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]	9400 [4436]
9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]	9600 [4530]
9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]	9800 [4624]
10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]	10000 [4719]
10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]	10200 [4813]
10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]	10400 [4908]
10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]	10600 [5002]
10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]	10800 [5096]
11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]	11000 [5191]
11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]	11200 [5285]
11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]	11400 [5379]
11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]	11600 [5474]
11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]	11800 [5568]
12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]	12000 [5663]

NOTE: L-Drive left of bold line, M-Drive right of bold line, N-Drive right of double line.

Drive Package	R	S					
Motor H.P. [W]	7.5 [5592.7]	10 [7457.0]					
Blower Sheave	BK130H	BK120H					
Motor Sheave	1VP-71	1VP-75					
Turns Open	1	2	3	4	5	6	
RPM	922	894	870	843	818	791	
				1041	1010	987	
				954	929		

- NOTES: 1. Factory sheave settings are shown in bold type.
 2. Do not set motor sheave below minimum turns open shown.
 3. Re-adjustment of sheave required to achieve rated airflow at ARI minimum External Static Pressure
 4. Drive data shown is for horizontal airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

COMPONENT AIRFLOW RESISTANCE — 25 TON [87.9kW]

CFM [L/s]	Resistance — Inches of Water [kPa]											
	8000 [3775]	8400 [3964]	8800 [4153]	9200 [4341]	9600 [4530]	10000 [4719]	10400 [4908]	10800 [5096]	11200 [5285]	11600 [5474]	12000 [5663]	
Wet Coil	0.07 [0.02]	0.09 [0.02]	0.10 [0.02]	0.12 [0.03]	0.13 [0.03]	0.15 [0.04]	0.16 [0.04]	0.18 [0.05]	0.19 [0.05]	0.21 [0.06]	0.22 [0.05]	
Downflow	0.12 [0.03]	0.14 [0.04]	0.16 [0.04]	0.19 [0.05]	0.22 [0.05]	0.25 [0.06]	0.29 [0.07]	0.33 [0.08]	0.37 [0.09]	0.42 [0.10]	0.46 [0.11]	
Downflow Economizer RA Damper Open	0.22 [0.05]	0.24 [0.06]	0.26 [0.06]	0.28 [0.07]	0.30 [0.07]	0.32 [0.08]	0.34 [0.08]	0.37 [0.09]	0.41 [0.10]	0.44 [0.10]	0.48 [0.11]	
Horizontal Economizer RA Damper Open	0.09 [0.02]	0.10 [0.02]	0.11 [0.03]	0.12 [0.03]	0.13 [0.03]	0.14 [0.04]	0.15 [0.04]	0.16 [0.04]	0.17 [0.04]	0.18 [0.05]	0.19 [0.05]	
Concentric Grill RXRN-AD88 & Transition RXMC-CL09	0.17 [0.04]	0.23 [0.06]	0.30 [0.07]	0.36 [0.09]	0.43 [0.11]	0.50 [0.12]	0.56 [0.14]	0.63 [0.16]	0.69 [0.17]	0.76 [0.19]	0.82 [0.20]	

AIRFLOW CORRECTION FACTORS — 25 TON [87.9kW]

CFM [L/s]	8000 [3775]	8400 [3964]	8800 [4153]	9200 [4341]	9600 [4530]	10000 [4719]	10400 [4908]	10800 [5096]	11200 [5285]	11600 [5474]	12000 [5663]
Total MBH	0.97	0.98	0.99	0.99	1.00	1.01	1.02	1.03	1.03	1.04	1.05
Sensible MBH	0.89	0.92	0.95	0.98	1.01	1.04	1.08	1.11	1.14	1.17	1.20
Power kW	0.99	0.99	1.00	1.00	1.00	1.01	1.01	1.01	1.02	1.02	1.02

NOTE: Multiply correction factor times gross performance data — resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

XIII. PRE-START CHECK

1. Is unit properly located and slightly slanted toward indoor condensate drain?
 2. Is ductwork insulated, weatherproofed, with proper spacing to combustible materials?
 3. Is air free to travel to and from outdoor coil? (See Figure 5.)
 4. Is the wiring correct, tight, and according to unit wiring diagram?
 5. Is unit grounded?
 6. Are field supplied air filters in place and clean?
 7. Do the outdoor fan and indoor blower turn freely without rubbing, and are they tight on the motor shafts?
-

XIV. STARTUP

1. Turn thermostat to "OFF," turn "on" power supply at disconnect switch.
 2. Turn temperature setting as high as it will go.
 3. Turn fan switch to "ON."
 4. Indoor blower should run. Be sure it is running in the right direction.
 5. Turn fan switch to "AUTO." Turn system switch to "COOL" and turn temperature setting below room temperature. Unit should run in cooling mode.
 6. Is outdoor fan operating correctly in the right direction?
 7. Is compressor running correctly.
Record the following after the unit has run some time.
 - A. Operating Mode _____
 - B. Discharge Pressures (High) _____ PSIG
 - C. Vapor Pressure at Compressors (Low) _____ PSIG
 - D. Vapor Line Temperature at Compressors _____ °F.
 - E. Indoor Dry Bulb _____ °F.
 - F. Indoor Wet Bulb _____ °F.
 - G. Outdoor Dry Bulb _____ °F.
 - H. Outdoor Wet Bulb _____ °F.
 - I. Voltage at Contactor _____ Volts
 - J. Current at Contactors _____ Amps
 - K. Model Number _____
 - L. Serial Number _____
 - M. Location _____
 - N. Owner _____
 - O. Date _____
 8. Turn thermostat system switch to "HEAT." Unit compressors should stop. Raise temperature setting to above room temperature. Unit should run in heating mode and auxiliary heaters, if installed, should come on.
 9. Check the refrigerant charge using the instructions located on unit charging chart. Replace service port caps. Service port cores are for system access only and will leak if not tightly capped.
 10. Adjust discharge air grilles and balance system.
 11. Check ducts for condensation and air leaks.
 12. Check unit for tubing and sheet metal rattles.
 13. Instruct the owner on operation and maintenance.
 14. Leave "INSTALLATION" and "USE AND CARE" instructions with owner
-

XV. OPERATION

COOLING MODE

With thermostat in the cool mode, fan auto and the room temperature higher than the thermostat setting:

- A. Indoor blower contactor is energized through thermostat contact (G).
- B. Compressor contactors are energized through thermostat contacts (Y1) & (Y2) and pressure controls.
- C. Economizer enthalpy control (if installed) controls operation of first-stage cooling and positions fresh air damper to maintain mixed air temperature. Second-stage cooling operates normally as required by second stage of thermostats.
- D. The system will continue in cooling operation as long as all safety controls are closed, until the thermostat is satisfied.

HEATING MODE

With thermostat in the heat mode, fan auto and the room temperature lower than the thermostat setting the indoor blower contactor is energized through thermostat contact (G).

▲ WARNING

ONLY ELECTRIC HEATER KITS SUPPLIED BY THIS MANUFACTURER AS DESCRIBED IN THIS PUBLICATION HAVE BEEN DESIGNED, TESTED, AND EVALUATED BY A NATIONALLY RECOGNIZED SAFETY TESTING AGENCY FOR USE WITH THIS UNIT. USE OF ANY OTHER MANUFACTURED ELECTRIC HEATERS INSTALLED WITHIN THIS UNIT MAY CAUSE HAZARDOUS CONDITIONS RESULTING IN PROPERTY DAMAGE, FIRE, BODILY INJURY OR DEATH.

XVI. HUMIDIDRY™ SYSTEM

The HumidiDry™ system controls both cooling and humidity loads. In addition to two stages of cooling, the unit includes two stages of reheat. A temperature sensor or thermostat relates a low cooling demand (Y1) or high cooling demand (Y2) to the RTU-C. A separate humidity sensor sends the actual indoor relative humidity to the RTU-C via a 0-10 VDC signal. The RTU-C considers a relative humidity level 2%-5% above the humidity setpoint as a “low humidity demand” (H1). The RTU-C considers a relative humidity level greater than 5% above the humidity setpoint as a “high humidity demand” (H2). The RTU-C determines the unit mode of operation based on the Y1, Y2, H1 and H2 (Table A). Low reheat is only initiated when there is a humidity call (H1 or H2) and no cooling call (Y1 or Y2). In this mode the unit provides essentially “neutral air” (supply air is within +1°F and -5°F of return air temperature). High reheat is only used when there is a high humidity demand (H2) with a low cooling demand (Y1).

See RTU-C I&O manual for reheat unit setup and for thermostat/sensor combinations.

HUMIDITY SENSOR

An indoor relative humidity sensor (not included with the unit) is required for reheat operation. Available accessory Humidity sensor models are: RHC-ZNS4 (Room Relative Humidity Sensor – for use with a standard thermostat) and RHC-ZNS5 (Room Temperature and Relative Humidity Sensor – for use with a BAS system). Mount sensor per thermostat/humidity sensor section requirements. See wiring diagram (Figure 17).

REFRIGERANT SOLENOID VALVES

The reheat refrigerant system is part of System 1 only. Three refrigerant solenoid valves (discharge, liquid and reheat) are used to change operation from Cooling Mode to Reheat Mode. The Discharge Solenoid Valve (DSV) is located in the outdoor section (front side of unit) and is a Normally Closed (N.C.) valve. The Liquid Solenoid Valve (LSV) is located in the liquid line in the blower section and is a Normally Open (N.O.) valve. The Reheat Solenoid Valve (RSV) is near the bottom of the reheat coil (between the evaporator coil and the blower) and is normally open.

OPERATION

During the Cooling mode the RSV is the only valve energized (closed position), LSV is open, DSV is closed. The refrigeration cycle is standard cooling, reheat coil is bypassed.

System 2 operates during High Cooling or High Reheat modes but is not part of the reheat circuit (always operates in standard cooling).

During Low Reheat or High Reheat modes the LSV is energized (closed position), DSV is energized (open position), RSV is open. Some hot gas bypasses the condenser coil and creates a warm two phase mix that enters the reheat coil. See Table A for Modes of Operation including compressor operation, fan speed, thermostat/humidistat calls for each mode. See Blower VFD section (above) for VFD operation.

TABLE A

Two Stage HumidiDry™ – Modes of Operation				
Mode	Compressor 1	Compressor 2	Fan	Notes
High Cool	Cool	Cool	High	Operates with (Y2) call, ignores (H1/H2)
High Reheat	Reheat	Cool	High	Operates with (Y1 & Y2)
Low Reheat	Reheat	Off	Low	Operates with (H1 only) or (H2 only)
Low Cool	Cool	Off	Low	Operates with (Y1) or (Y1 & H1), Factory set point
Notes Definitions:				
Y1	Single stage cooling operation			
Y2	Two stage cooling operation			
H1	Space is above humidity set point by more than 2% and less than or equal to 5%.			
H2	Space is above humidity set point by more than 5%.			

TABLE B

OFMC	
Factory Settings	
Unit	Setpoint
090	95°F
120	90°F
180	100°F
240	95°F
300	90°F

XVII. VARIABLE FREQUENCY DRIVE (VFD)

No adjustments of the VFD are required for installation or operation of this unit.

Location: Control Section (front left) of the unit.

VFD Model

Schneider Altivar 212 (factory programmed).


Replacement

The VFD is horsepower and voltage specific therefore; replacement must be the same model as the existing. A preprogrammed VFD is recommended and available from ProStock. A non-programmed Schneider Altivar 212 may be used but must be programmed exactly per the included VFD programming guide for safe and proper function.

Operation

The purpose of the VFD is to allow low airflow in Fan Only (G), Low Reheat and First Stage Cooling (Y1) operation of a two stage unit. Unit air balancing should be performed at High Airflow (100% at RTU-C, 60Hz at VFD) by adjusting the blower motor sheave. High Airflow always occurs during a W1, W2, or Y2 call. For air balancing, without heating or cooling, the fan only speed can be temporarily increased to 100% by adjustment through the RTU-C keypad. To meet ASHRAE 90.1-2010 and for best performance, First Stage Cool and Fan Only speeds are factory set at 50% airflow (30 Hz at VFD). Both of these speeds are independently adjustable at the RTU-C. The VFD display will indicate an equivalent value in Hz (i.e. Low Cool adjusted to 60% at RTU-C will display as 36Hz at the VFD). A 20 second (adjustable at the VFD) ramp-up or ramp-down is used whenever the blower speed is increased or decreased. Low speed blower operation first ramps to 75%, to close fan proving switch, before ramping to the desired speed. Since the VFD operates on 24VDC control voltage, a blower relay (with 24VAC across the coil) is used to turn the VFD on. Blower speeds are changed via Modbus communication from the RTU-C.

FIGURE 20

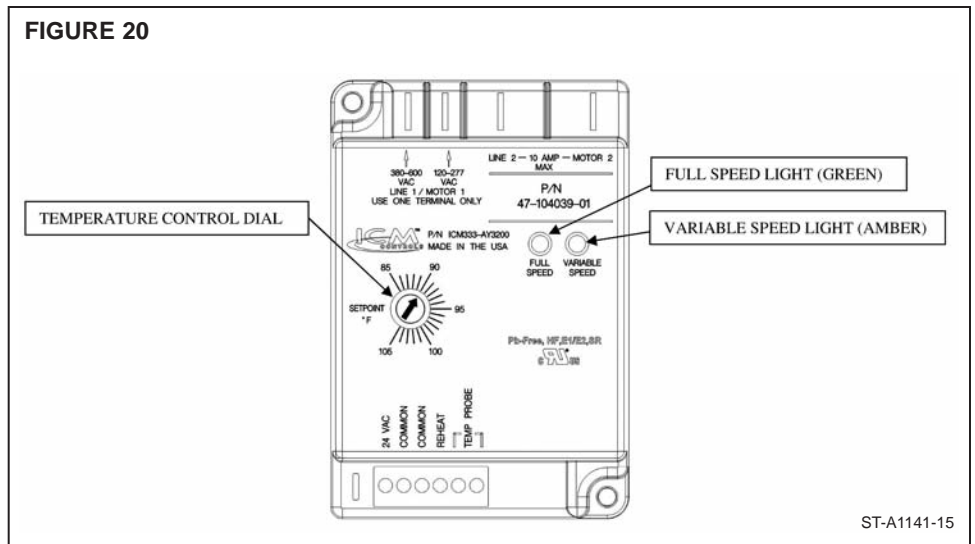

ST-A1141-15

XVIII. OUTDOOR FAN MOTOR CONTROLLER (OFMC)

Location: Control Section (front left) of the unit.

During Low Reheat Mode the OFMC slows the outdoor fans to increase the discharge pressure/temperature to maintain an optimized amount of reheat required to provide neutral air to the occupied space. The OFMC is located in the control box section. On 15-25 ton units the OFMC slows fans during both Low and High Reheat Modes (circuit 1 fans only). The factory setting for the outdoor fan motor controller is unit specific (Table B). The setpoint temperature will provide neutral air +1 to -5°F from the entering air temperature (example if the entering or return air temperature is 75°F the leaving or supply air temperature will be 76° to 70°F during the reheat mode. If field adjustment is required to raise or lower the leaving air temperature this may be accomplished by turning the temperature control dial on the OFMC (Figure 20). Turning the dial to a higher temperature setting will increase the leaving or supply air temperature and turning the dial to a lower setting will reduce the leaving or supply temperature. During cooling modes the OFMC will operate at full speed (green light -Figure 20). During reheat modes the OFMC will typically operate at variable speed

(amber light – Figure 20) but can change to full speed or off (no lights) depending on the reheat capacity required. During high reheat, the 7½ and 10 ton models must operate the OFMC at full speed to prevent excessive head pressure on system 2.

XIX. AUXILIARY HEAT

In the heating mode, the thermostat will energize one or more supplementary resistance heaters.

REPLACEMENT PARTS

Contact your local distributor for a complete parts list.

CHARGE INFORMATION

Refer to the appropriate charge chart on the unit, or in this booklet.

TROUBLESHOOTING

Refer to the troubleshooting chart included in this manual.

WIRING DIAGRAMS

Refer to the appropriate wiring diagram included in this manual.

XX. HEATER KIT CHARACTERISTICS
TABLE C. AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION
(15, 17.5, 20 & 25 TON MODELS)

208/240 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION														
Separate Power Supply For Both Unit And Heater Kit														
RHEEM Model Number	Single Power Supply For Both Unit And Heater Kit							Heater Kit						
	Heater Kit							Air Conditioner						
	No. of Sequence Steps	Rated Heater kW @ 208/240 V	Heater KBTU/Hr @ 208/240 V	Heater Amp. @ 208/240 V	Unit Min. Ckt Ampacity @ 208/240 V	Over Current Protective Device Size Min./Max. @ 208 V	Min. Ckt Ampacity 208/240V	Max. Fuse Size 208/240V	Min. Ckt Ampacity 208/240V	Over Current Protective Device Size Min./Max. @ 208 V	Min./Max. @ 208 V	Min./Max. @ 240 V	Min. Ckt Ampacity 208/240V	Over Current Protective Device Size Min./Max. @ 240 V
RLNL-G180CR	No Heat	—	—	—	78/78	90/100	90/100	—	—	—	—	78/78	90/100	90/100
	CE20C	14.4/19.2	49.13/65.5	40/46.2	78/78	90/100	90/100	50/58	50/60	50/58	50/60	78/78	90/100	90/100
	CE40C	28.8/38.3	98.25/130.66	79.9/92.2	115/130	125/125	150/150	100/116	100/125	100/116	100/125	78/78	90/100	90/100
	CE60C	43.2/57.5	147.38/196.16	119.9/138.3	165/188	175/175	200/200	150/173	150/175	150/173	150/175	78/78	90/100	90/100
	CE75C	54/71.9	184.22/245.29	149.8/172.8	202/231	225/225	250/250	188/217	200/225	188/217	200/225	78/78	90/100	90/100
RLNL-G240CR	No Heat	—	—	—	101/101	110/125	110/125	—	—	—	—	101/101	110/125	110/125
	CE20C	14.4/19.2	49.13/65.5	40/46.2	101/101	110/125	110/125	50/58	50/60	50/58	50/60	101/101	110/125	110/125
	CE40C	28.8/38.3	98.25/130.66	79.9/92.2	119/134	125/125	150/150	100/116	100/125	100/116	100/125	101/101	110/125	110/125
	CE60C	43.2/57.5	147.38/196.16	119.9/138.3	169/192	175/175	200/200	150/173	150/175	150/173	150/175	101/101	110/125	110/125
	CE75C	54/71.9	184.22/245.29	149.8/172.8	206/235	225/225	250/250	188/217	200/225	188/217	200/225	101/101	110/125	110/125
RLNL-G300CR	No Heat	—	—	—	147/147	175/175	175/175	—	—	—	—	147/147	175/175	175/175
	CE20C	14.4/19.2	49.13/65.5	40/46.2	147/147	175/175	175/175	50/58	50/60	50/58	50/60	147/147	175/175	175/175
	CE40C	28.8/38.3	98.25/130.66	79.9/92.2	147/147	175/175	175/175	100/116	100/125	100/116	100/125	147/147	175/175	175/175
	CE60C	43.2/57.5	147.38/196.16	119.9/138.3	181/204	200/200	225/225	150/173	150/175	150/173	150/175	147/147	175/175	175/175
	CE75C	54/71.9	184.22/245.29	149.8/172.8	218/247	225/225	250/250	188/217	200/225	188/217	200/225	147/147	175/175	175/175
RLNL-G180CS	No Heat	—	—	—	81/81	90/100	90/100	—	—	—	—	81/81	90/100	90/100
	CE20C	14.4/19.2	49.13/65.5	40/46.2	81/81	90/100	90/100	50/58	50/60	50/58	50/60	81/81	90/100	90/100
	CE40C	28.8/38.3	98.25/130.66	79.9/92.2	119/134	125/125	150/150	100/116	100/125	100/116	100/125	81/81	90/100	90/100
	CE60C	43.2/57.5	147.38/196.16	119.9/138.3	169/192	175/175	200/200	150/173	150/157	150/173	150/157	81/81	90/100	90/100
	CE75C	54/71.9	184.22/245.29	149.8/172.8	206/235	225/225	250/250	188/217	200/225	188/217	200/225	81/81	90/100	90/100
RLNL-G240CS	No Heat	—	—	—	109/109	125/125	125/125	—	—	—	—	109/109	125/125	125/125
	CE20C	14.4/19.2	49.13/65.5	40/46.2	109/109	125/125	125/125	50/58	50/60	50/58	50/60	109/109	125/125	125/125
	CE40C	28.8/38.3	98.25/130.66	79.9/92.2	129/145	150/150	150/150	100/116	100/125	100/116	100/125	109/109	125/125	125/125
	CE60C	43.2/57.5	147.38/196.16	119.9/138.3	179/202	200/200	225/225	150/173	150/157	150/173	150/157	109/109	125/125	125/125
	CE75C	54/71.9	184.22/245.29	149.8/172.8	217/245	225/225	250/250	188/217	200/225	188/217	200/225	109/109	125/125	125/125
RLNL-G300CS	No Heat	—	—	—	149/149	175/175	175/175	—	—	—	—	149/149	175/175	175/175
	CE20C	14.4/19.2	49.13/65.5	40/46.2	149/149	175/175	175/175	50/58	50/60	50/58	50/60	149/149	175/175	175/175
	CE40C	28.8/38.3	98.25/130.66	79.9/92.2	149/151	175/175	175/175	100/116	100/125	100/116	100/125	149/149	175/175	175/175
	CE60C	43.2/57.5	147.38/196.16	119.9/138.3	186/209	200/200	225/225	150/173	150/157	150/173	150/157	149/149	175/175	175/175
	CE75C	54/71.9	184.22/245.29	149.8/172.8	223/252	225/225	300/300	188/217	200/225	188/217	200/225	149/149	175/175	175/175

XX. HEATER KIT CHARACTERISTICS

TABLE C (CONTINUED). AUXILIARY HEATER KITS CHARACTERISTICS AND APPLICATION (15, 20 & 25 TON MODELS)


480 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION														
Separate Power Supply For Both Unit And Heater Kit														
RHEEM Model Number	Single Power Supply For Both Unit And Heater Kit						Separate Power Supply For Both Unit And Heater Kit							
	Heater Kit			Air Conditioner			Heater Kit			Air Conditioner				
	No. of Sequence Steps	Rated Heater kW @ 480 V	Heater KBTU/Hr @ 480 V	Heater Amp. @ 480 V	Unit Min. Ckt Ampacity @ 480 V	Over Current Protective Device Size Min./Max. @ 480 V	Min. Ckt. Ampacity 480V	Max. Fuse Size 480V	Min. Circuit Ampacity 480V	Over Current Protective Device Size Min./Max. @ 480 V	Min. Ckt. Ampacity 480V	Max. Fuse Size 480V	Min. Circuit Ampacity 480V	Over Current Protective Device Size Min./Max. @ 480 V
RLNL-G180DR	No Heat	—	—	—	38	45/45	—	—	38	45/45	—	—	38	45/45
	CE20D	19.2	65.5	23.1	38	45/45	—	—	38	45/45	—	—	38/0	45/45
	CE40D	38.4	131	46.2	64	70/70	—	—	58	45/45	—	—	38/0	45/45
	CE60D	57.6	196.5	69.3	93	100/100	—	—	87	45/45	—	—	38/0	45/45
	CE75D	72	245.63	86.6	114	125/125	—	—	109	45/45	—	—	38/0	45/45
RLNL-G240DR	No Heat	—	—	—	52	60/60	—	—	52	60/60	—	—	52	60/60
	CE20D	19.2	65.5	23.1	52	60/60	—	—	29	60/60	—	—	52/0	60/60
	CE40D	38.4	131	46.2	67	70/70	—	—	58	60/60	—	—	52/0	60/60
	CE60D	57.6	196.5	69.3	95	100/100	—	—	87	60/60	—	—	52/0	60/60
	CE75D	72	245.63	86.6	117	125/125	—	—	109	60/60	—	—	52/0	60/60
RLNL-G300DR	No Heat	—	—	—	60	70/70	—	—	60	70/70	—	—	60	70/70
	CE20D	19.2	65.5	23.1	60	70/70	—	—	29	70/70	—	—	60/0	70/70
	CE40D	38.4	131	46.2	70	70/70	—	—	58	70/70	—	—	60/0	70/70
	CE60D	57.6	196.5	69.3	99	100/100	—	—	87	70/70	—	—	60/0	70/70
	CE75D	72	245.63	86.6	121	125/125	—	—	109	70/70	—	—	60/0	70/70
RLNL-G180DS	No Heat	—	—	—	40	45/50	—	—	40	45/50	—	—	40	45/50
	CE20D	19.2	65.5	23.1	40	45/50	—	—	29	45/50	—	—	40/0	45/50
	CE40D	38.4	131	46.2	67	70/70	—	—	58	45/50	—	—	40/0	45/50
	CE60D	57.6	196.5	69.3	95	100/100	—	—	87	45/50	—	—	40/0	45/50
	CE75D	72	245.63	86.6	117	125/125	—	—	109	45/50	—	—	40/0	45/50
RLNL-G240DS	No Heat	—	—	—	56	60/70	—	—	56	60/70	—	—	56	60/70
	CE20D	19.2	65.5	23.1	56	60/70	—	—	29	60/70	—	—	56/0	60/70
	CE40D	38.4	131	46.2	70	70/70	—	—	58	60/70	—	—	56/0	60/70
	CE60D	57.6	196.5	69.3	99	100/100	—	—	87	60/70	—	—	56/0	60/70
	CE75D	72	245.63	86.6	121	125/125	—	—	109	60/70	—	—	56/0	60/70
RLNL-G300DS	No Heat	—	—	—	63	70/80	—	—	63	70/80	—	—	63	70/80
	CE20D	19.2	65.5	23.1	63	70/80	—	—	29	70/80	—	—	63/0	70/80
	CE40D	38.4	131	46.2	74	80/80	—	—	58	70/80	—	—	63/0	70/80
	CE60D	57.6	196.5	69.3	103	110/110	—	—	87	70/80	—	—	63/0	70/80
	CE75D	72	245.63	86.6	124	125/125	—	—	109	70/80	—	—	63/0	70/80

TROUBLE SHOOTING CHART

▲ WARNING

DISCONNECT ALL POWER TO UNIT BEFORE SERVICING. CONTACTOR MAY BREAK ONLY ONE SIDE. FAILURE TO SHUT OFF POWER CAN CAUSE ELECTRICAL SHOCK RESULTING IN PERSONAL INJURY OR DEATH.

SYMPTOM	POSSIBLE CAUSE	REMEDY
Unit will not run	<ul style="list-style-type: none"> • Power off or loose electrical connection • Thermostat out of calibration-set too high • Defective contactor • Blown fuses • Transformer defective • High pressure control open (if provided) • Interconnecting low voltage wiring damaged 	<ul style="list-style-type: none"> • Check for correct voltage at compressor contactor in control box • Reset • Check for 24 volts at contactor coil - replace if contacts are open • Replace fuses • Check wiring-replace transformer • Reset-also see high head pressure remedy- • Replace thermostat wiring
Condenser fan runs, compressor doesn't	<ul style="list-style-type: none"> • Run capacitor defective (single phase only) • Loose connection • Compressor stuck, grounded or open motor winding open internal overload. • Low voltage condition 	<ul style="list-style-type: none"> • Replace • Check for correct voltage at compressor - check & tighten all connections • Wait at least 2 hours for overload to reset. If still open, replace the compressor. At compressor terminals, voltage must be within 10% of rating plate volts when unit is operating.
Insufficient cooling	<ul style="list-style-type: none"> • Improperly sized unit • Improper airflow • Incorrect refrigerant charge • Air, non-condensibles or moisture in system • Incorrect voltage 	<ul style="list-style-type: none"> • Recalculate load • Check - should be approximately 400 CFM per ton. • Charge per procedure attached to unit service panel. • Recover refrigerant, evacuate & recharge, add filter drier • At compressor terminals, voltage must be within 10% of rating plate volts when unit is operating.
Compressor short cycles	<ul style="list-style-type: none"> • Incorrect voltage • Defective overload protector • Refrigerant undercharge 	<ul style="list-style-type: none"> • At compressor terminals, voltage must be \pm 10% of nameplate marking when unit is operating. • Replace - check for correct voltage • Add refrigerant
Registers sweat	<ul style="list-style-type: none"> • Low evaporator airflow 	<ul style="list-style-type: none"> • Increase speed of blower or reduce restriction - replace air filter
High head-low vapor pressures	<ul style="list-style-type: none"> • Restriction in liquid line, expansion device or filter drier • TXV does not open 	<ul style="list-style-type: none"> • Remove or replace defective component • Replace TXV
High head-high or normal vapor pressure - Cooling mode	<ul style="list-style-type: none"> • Dirty condenser coil • Refrigerant overcharge • Condenser fan not running • Air or non-condensibles in system 	<ul style="list-style-type: none"> • Clean coil • Correct system charge • Repair or replace • Recover refrigerant, evacuate & recharge
Low head-high vapor pressures	<ul style="list-style-type: none"> • Defective Compressor valves 	<ul style="list-style-type: none"> • Replace compressor
Low vapor - cool compressor - iced evaporator coil	<ul style="list-style-type: none"> • Low evaporator airflow • Operating below 65°F outdoors • Moisture in system • Dirty evaporator coil, bent fins 	<ul style="list-style-type: none"> • Increase speed of blower or reduce restriction - replace air filter • Add Low Ambient Kit • Recover refrigerant - evacuate & recharge - add filter drier • Clean evaporator coil, straighten fins
High vapor pressure	<ul style="list-style-type: none"> • Excessive load • Defective compressor 	<ul style="list-style-type: none"> • Recheck load calculation • Replace
Fluctuating head & vapor pressures	<ul style="list-style-type: none"> • TXV hunting • Air or non-condensibles in system 	<ul style="list-style-type: none"> • Check TXV bulb clamp - check air distribution on coil - replace TXV • Recover refrigerant, evacuate & recharge
Gurgle or pulsing noise at expansion device or liquid line	<ul style="list-style-type: none"> • Air or non-condensibles in system 	<ul style="list-style-type: none"> • Recover refrigerant, evacuate & recharge

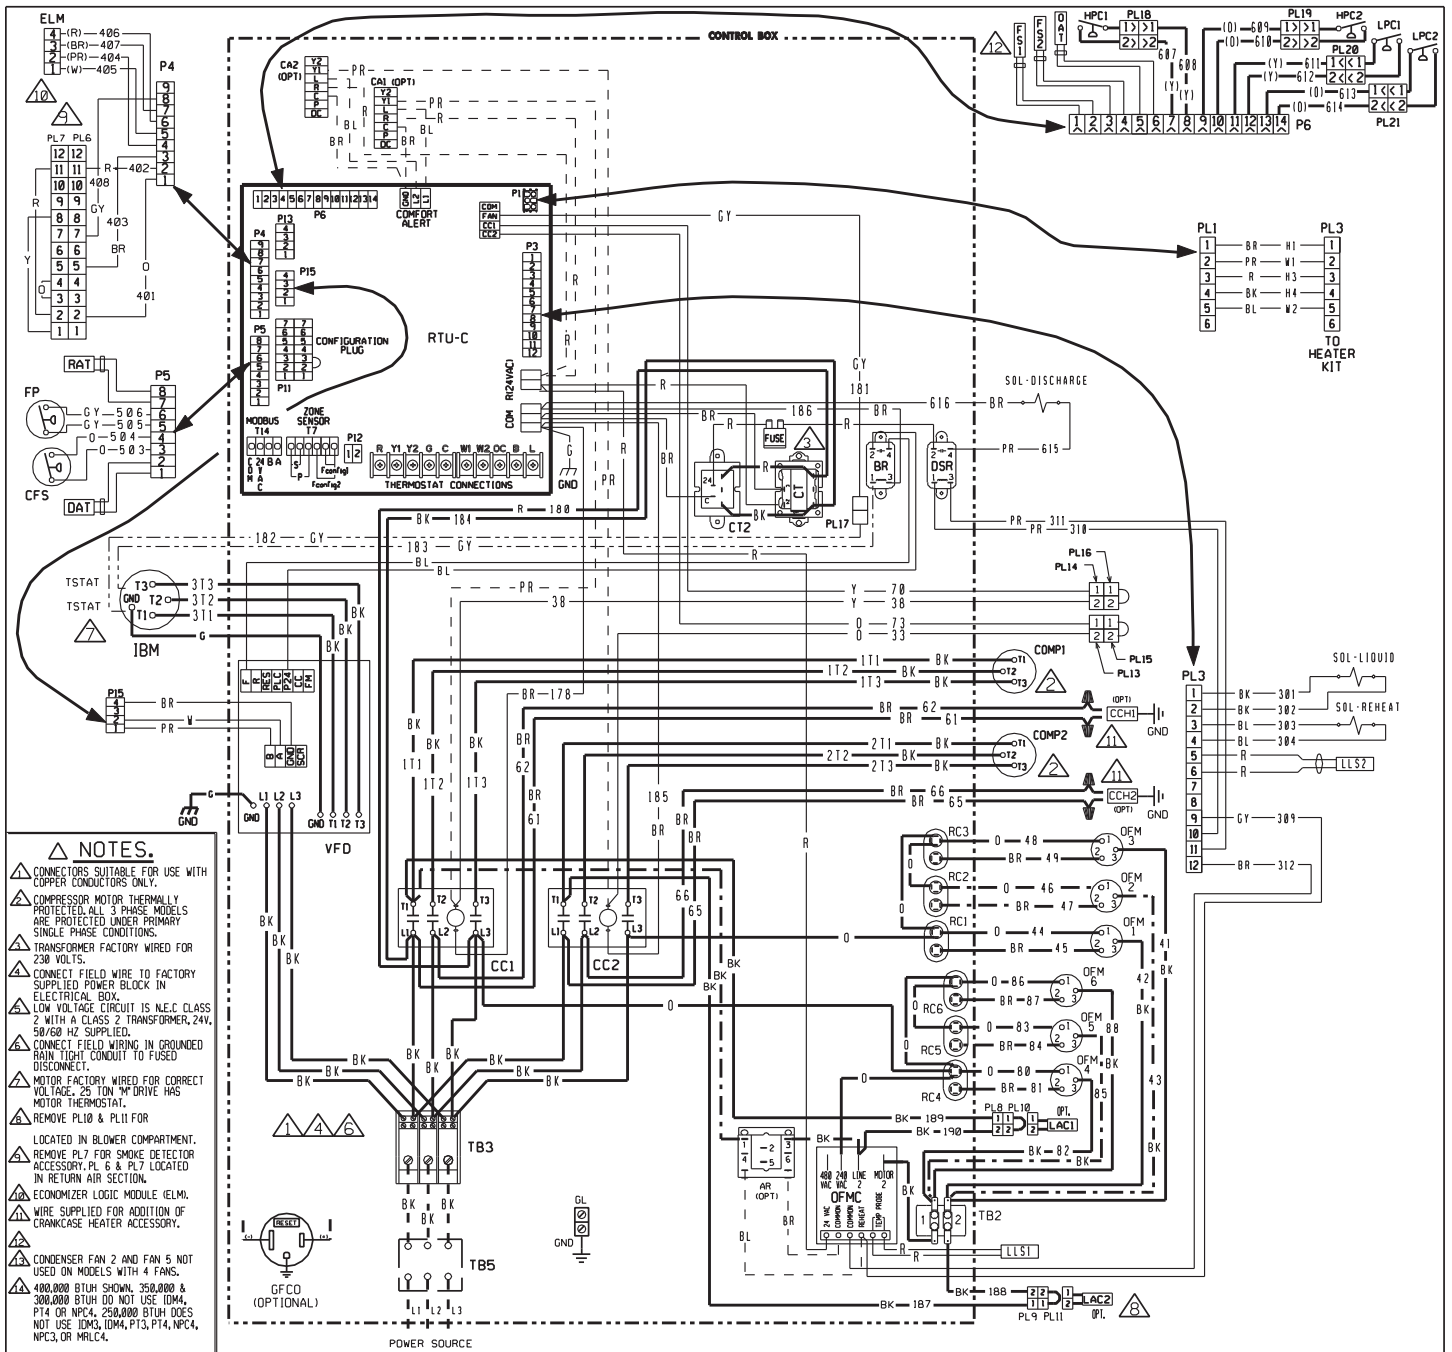

- NOTES.**
- △ CONNECTORS SUITABLE FOR USE WITH COPPER CONDUCTORS ONLY.
 - △ COMPRESSOR MOTOR THERMALLY PROTECTED. ALL 3 PHASE MODELS ARE PROTECTED UNDER PRIMARY SINGLE PHASE CONDITIONS.
 - △ TRANSFORMER FACTORY WIRED FOR 230 VOLTS.
 - △ CONNECT FIELD WIRE TO FACTORY SUPPLIED POWER BLOCK IN ELECTRICAL BOX.
 - △ LOW VOLTAGE CIRCUIT IS N.E.C. CLASS 2 WITH A CLASS 2 TRANSFORMER, 24V, 50/60 HZ SUPPLIED.
 - △ CONNECT FIELD WIRING IN GROUNDED RAIN TIGHT CONDUIT TO FUSED DISCONNECT.
 - △ MOTOR FACTORY WIRED FOR CORRECT VOLTAGE. 25 TON W/ DRIVE HAS MOTOR THERMOSTAT.
 - △ REMOVE PL10 & PL11 FOR LOCATED IN BLOWER COMPARTMENT. REMOVE PL7 FOR SMOKE DETECTOR ACCESSORY. PL 6 & PL7 LOCATED IN RETURN AIR SECTION.
 - △ ECONOMIZER LOGIC MODULE (ELM). WIRE SUPPLIED FOR ADDITION OF CRANKCASE HEATER ACCESSORY.
 - △ CONDENSER FAN 2 AND FAN 5 NOT USED ON MODELS WITH 4 FANS.
 - △ 180,000 BTUH SHOWN. 350,000 & 500,000 BTUH DO NOT USE IDM4, P14 OR NPC4. 250,000 BTUH DOES NOT USE IDM3, IDM4, P13, P14, NPC4, NPC3, OR MRLC4.

COMPONENT CODE

AR	ACCESSORY RELAY	HPC	HIGH PRESSURE CONTROL
CA	BLOWER RELAY	IBM	INDOOR BLOWER MOTOR BELT DRIVE
CC	COMFORT ALERT MODULE	LAC	LOW AMBIENT COOLING CONTROL
CC1	COMPRESSOR CONTACTOR	LC	LIMIT CONTROL
CCH	CRANKCASE HEATER	LLS	LIQUID LINE SENSOR
CFS	CLOGGED FILTER SWITCH	LPC	LOW PRESSURE CONTROL
COMP	COMPRESSOR	OAT	OUTSIDE AIR SENSOR
CT	CONTROL TRANSFORMER	OFM	OUTDOOR FAN MOTOR
DAT	DISCHARGE AIR SENSOR	OFMC	OUTDOOR FAN MOTOR CONTROLLER
DSR	DISCHARGE SOLENOID RELAY	PL	PLUG
DISC	DISCONNECT SWITCH	PL	RETURN AIR SENSOR
FP	FAN PROVING	RC	RUN CAPACITOR
FS	FREEZE SENSOR	RTU-C	ROOFTOP UNIT CONTROL
GFCC	GROUND FAULT CONVENIENCE OUTLET	TB	TERMINAL BLOCK
GL	GROUND LUG	VFD	VARIABLE FREQUENCY DRIVE
GND	GROUND	W	WIRE NUT

WIRING INFORMATION

LINE VOLTAGE
 -FACTORY STANDARD
 -FACTORY OPTION
 -FIELD INSTALLED

LOW VOLTAGE
 -FACTORY STANDARD
 -FACTORY OPTION
 -FIELD INSTALLED

REPLACEMENT WIRE
 -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)

WARNING
 -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., AND LOCAL CODES AS APPLICABLE.


WIRE COLOR CODE

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

WIRING DIAGRAM REHEAT MODELS
 208-230/460V 3 PH, 60 HZ.
 ROOFTOP W/RTU-C

DR. BY	APP. BY	DATE	DWG. NO.	REV
MCB		10-21-11	90-103079-05	01

RTU-C
1186-100

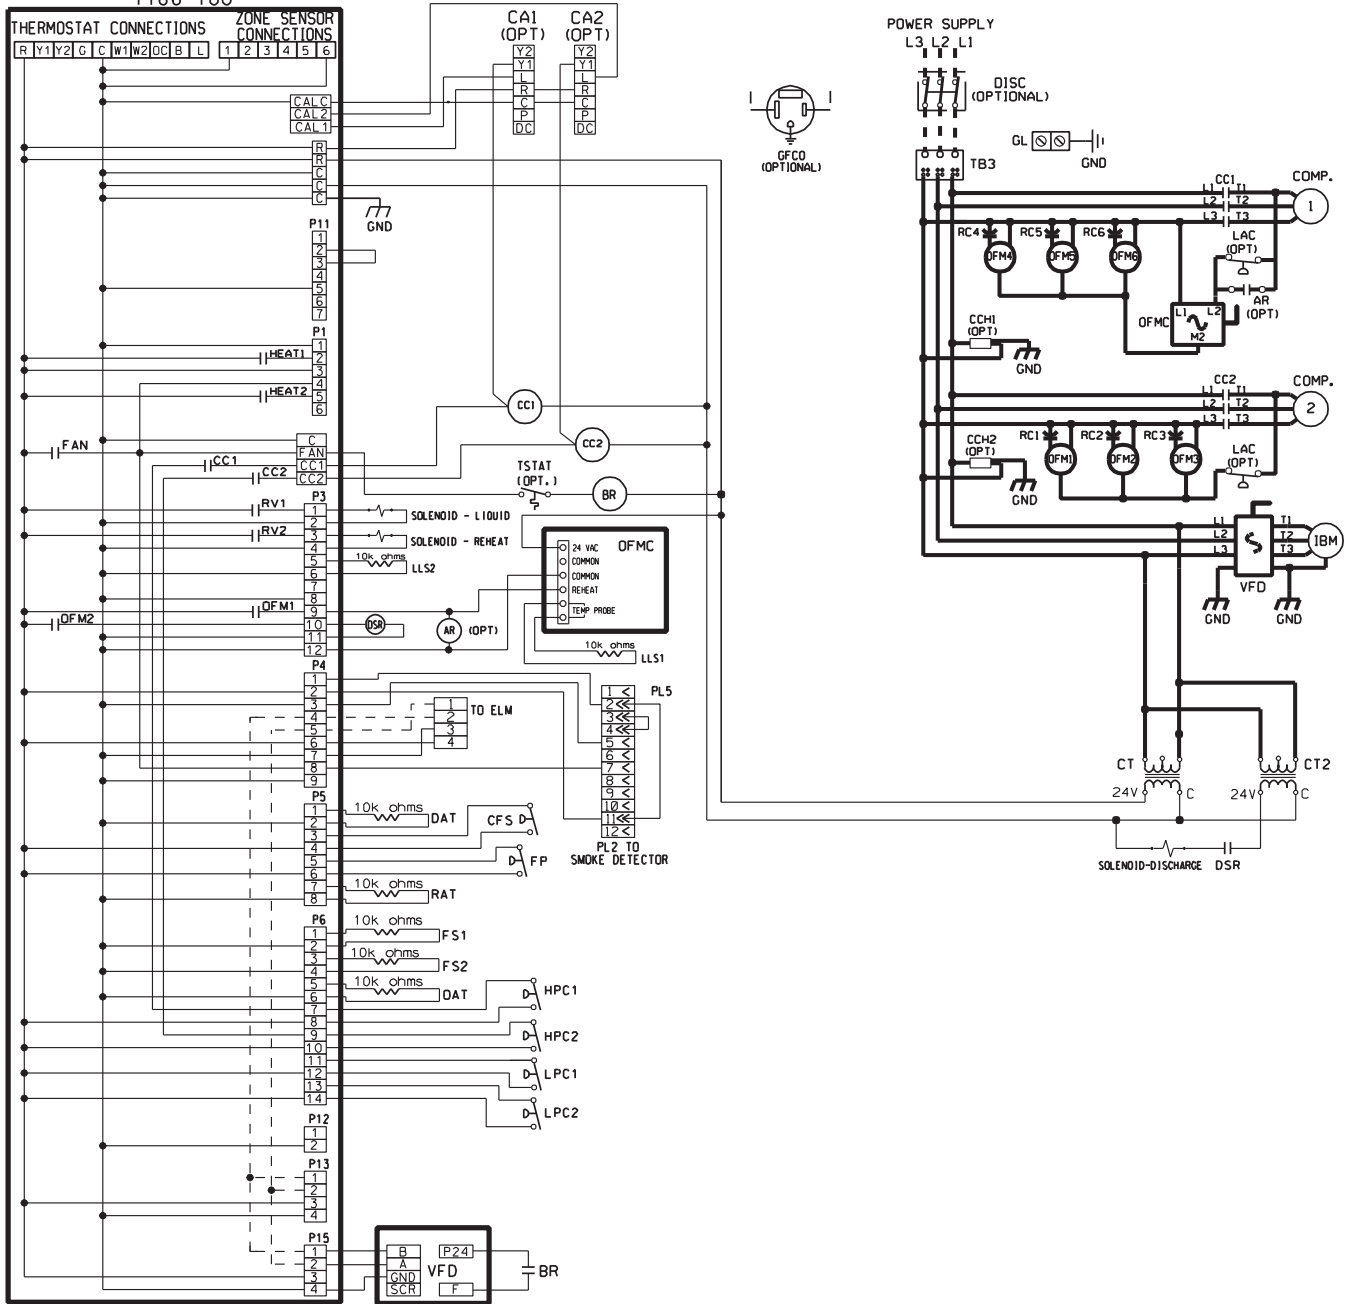

COMPONENT CODE

AR	ACCESSORY RELAY	HPC	HIGH PRESSURE CONTROL
BR	BLOWER RELAY	IBM	INDOOR BLOWER MOTOR BELT DRIVE
CA	COMFORT ALERT MODULE	IFC	INTEGRATED FURNACE CONTROL
CC	COMPRESSOR CONTACTOR	LAC	LOW AMBIENT COOLING CONTROL
CCH	CRANKCASE HEATER	LC	LIMIT CONTROL
CFS	CLOGGED FILTER SWITCH	LLS	LIQUID LINE SENSOR
COMP	COMPRESSOR	LPC	LOW PRESSURE CONTROL
CT	CONTROL TRANSFORMER	OAT	OUTSIDE AIR SENSOR
DSR	DISCHARGE SOLENOID RELAY	OFM	OUTDOOR FAN MOTOR
DISC	DISCONNECT SWITCH	OFMC	OUTDOOR FAN MOTOR CONTROLLER
FP	FAN PROVING	PL	PLUG
FS	FREEZE SENSOR	RAT	RETURN AIR SENSOR
GFCD	GROUND FAULT CONVENIENCE OUTLET	RC	RUN CAPACITOR
GL	GROUND LUG	RTU-C	ROOFTOP UNIT CONTROL
GND	GROUND	TB	TERMINAL BLOCK
		VFD	VARIABLE FREQUENCY DRIVE
		W	WIRE NUT

WIRING INFORMATION

LINE VOLTAGE
 -FACTORY STANDARD —————
 -FACTORY OPTION - - - - -
 -FIELD INSTALLED - - - - -
 -FIELD INSTALLED - - - - -
 LOW VOLTAGE
 -FACTORY STANDARD —————
 -FACTORY OPTION - - - - -
 -FIELD INSTALLED - - - - -
 REPLACEMENT WIRE
 -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)
 WARNING
 -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

WIRING SCHEMATIC
 REHEAT 180/240/300
 208-230/460V 3 PH, 60 HZ.
 ROOFTOP W/RTU-C



DR. BY	APP. BY	DATE	DWG. NO.	REV
MCB		10-21-11	90-103263-05	01

RLNL SERIES – 15 TON

SYSTEM CHARGE CHART - REFRIGERANT 410A 15 TON, CIRCUITS 1 & 2

- CAUTION: 1. BOTH COMPRESSORS MUST BE OPERATING BEFORE CHECKING REFRIGERANT CHARGE.
2. RETURN AIR TEMPERATURE MUST BE WITHIN COMFORT CONDITIONS BEFORE FINAL REFRIGERANT CHECK!

- INSTRUCTIONS: 1. MEASURE PRESSURE AT COMPRESSOR SUCTION AND DISCHARGE.
2. MEASURE OUTDOOR AMBIENT TO UNIT.
3. PLACE (X) ON CHART WHERE SUCTION AND DISCHARGE INTERSECT.
4. IF (X) IS BELOW OUTDOOR AMBIENT LINE, ADD CHARGE AND REPEAT STEPS 1-3.
5. IF (X) IS ABOVE OUTDOOR AMBIENT LINE, RECOVER EXCESS CHARGE AND REPEAT STEPS 1-3.

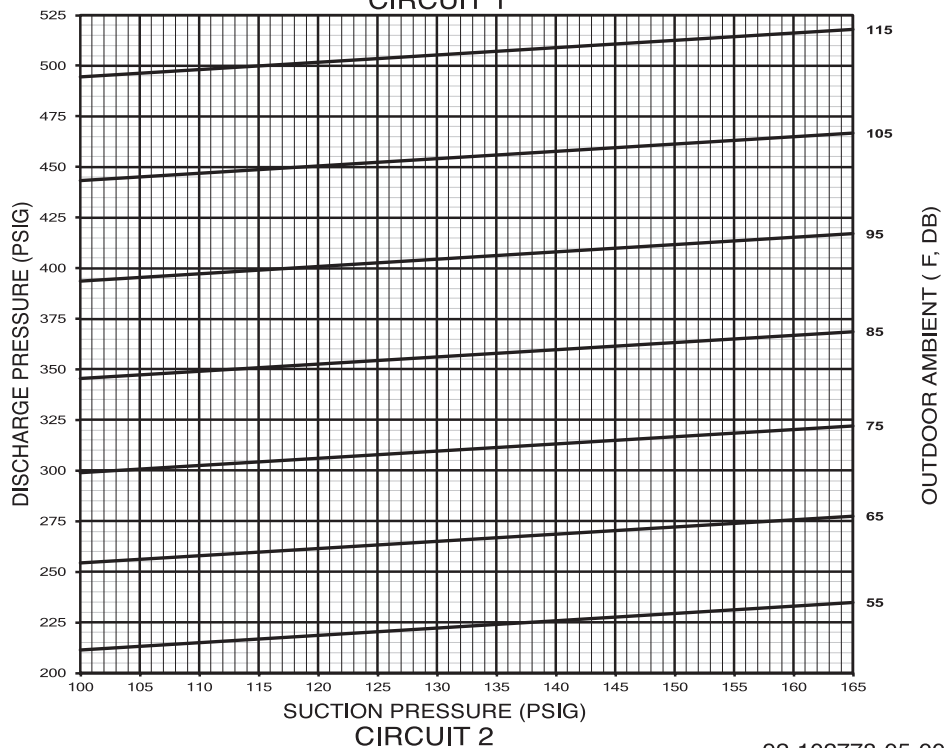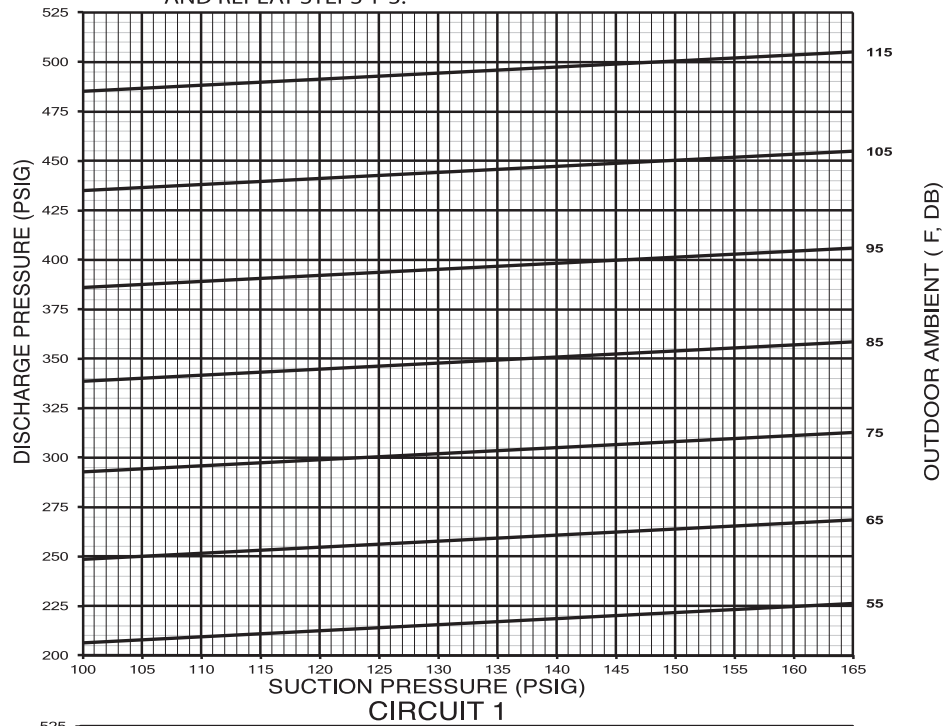



92-102778-05-00

RLNL SERIES – 20 TON

SYSTEM CHARGE CHART - REFRIGERANT 410A 20 TON, CIRCUITS 1 & 2

- CAUTION:**
1. BOTH COMPRESSORS MUST BE OPERATING BEFORE CHECKING REFRIGERANT CHARGE.
 2. RETURN AIR TEMPERATURE MUST BE WITHIN COMFORT CONDITIONS BEFORE FINAL REFRIGERANT CHECK!

- INSTRUCTIONS:**
1. MEASURE PRESSURE AT COMPRESSOR SUCTION AND DISCHARGE.
 2. MEASURE OUTDOOR AMBIENT TO UNIT.
 3. PLACE (X) ON CHART WHERE SUCTION AND DISCHARGE INTERSECT.
 4. IF (X) IS BELOW OUTDOOR AMBIENT LINE, ADD CHARGE AND REPEAT STEPS 1-3.
 5. IF (X) IS ABOVE OUTDOOR AMBIENT LINE, RECOVER EXCESS CHARGE AND REPEAT STEPS 1-3.

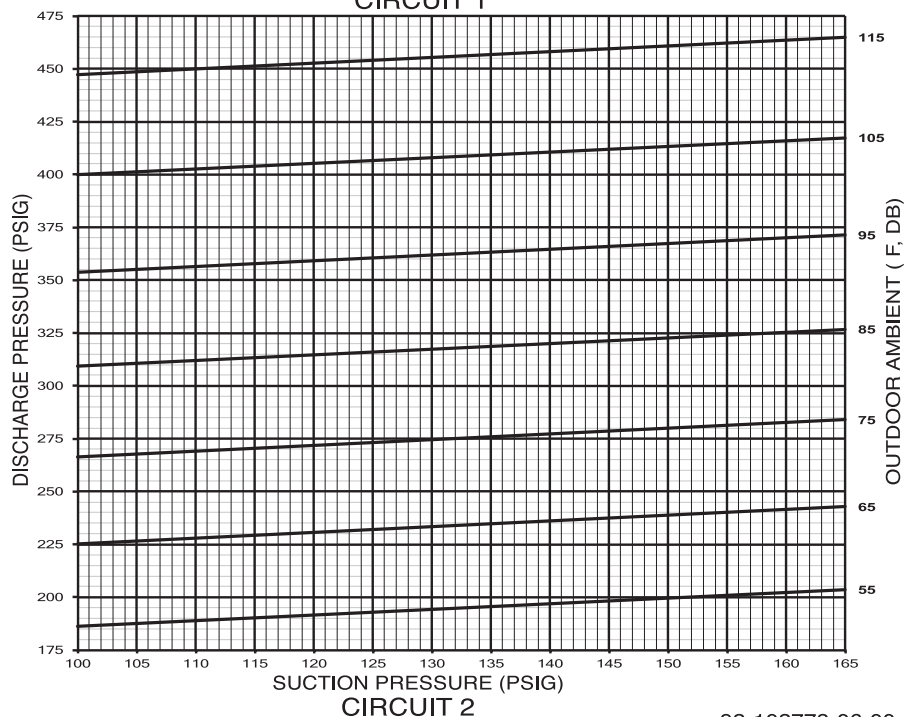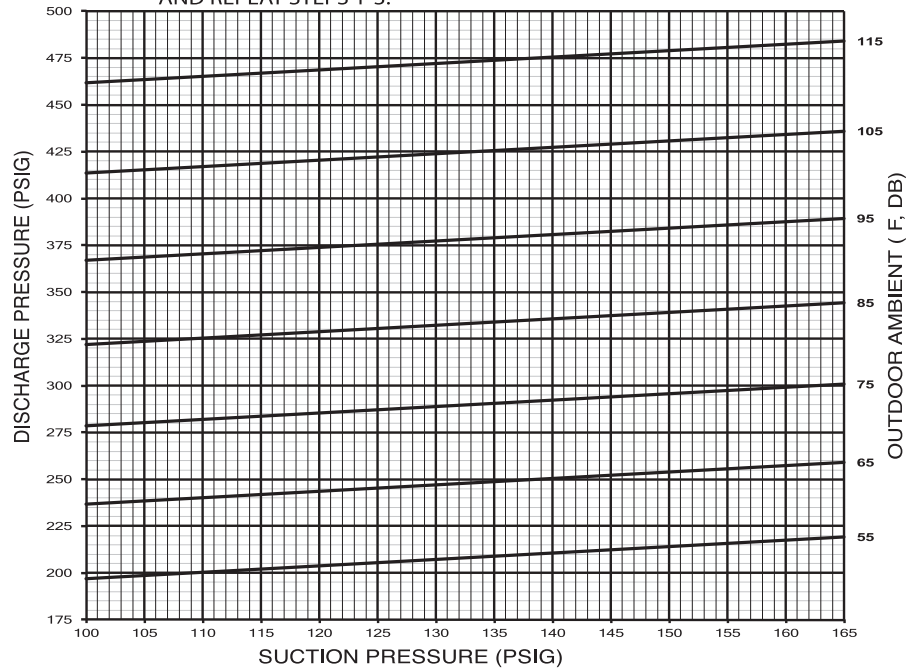



92-102778-06-00

RLNL SERIES – 25 TON

SYSTEM CHARGE CHART - REFRIGERANT 410A 25 TON, CIRCUITS 1 & 2

- CAUTION:**
1. BOTH COMPRESSORS MUST BE OPERATING BEFORE CHECKING REFRIGERANT CHARGE.
 2. RETURN AIR TEMPERATURE MUST BE WITHIN COMFORT CONDITIONS BEFORE FINAL REFRIGERANT CHECK!

- INSTRUCTIONS:**
1. MEASURE PRESSURE AT COMPRESSOR SUCTION AND DISCHARGE.
 2. MEASURE OUTDOOR AMBIENT TO UNIT.
 3. PLACE (X) ON CHART WHERE SUCTION AND DISCHARGE INTERSECT.
 4. IF (X) IS BELOW OUTDOOR AMBIENT LINE, ADD CHARGE AND REPEAT STEPS 1-3.
 5. IF (X) IS ABOVE OUTDOOR AMBIENT LINE, RECOVER EXCESS CHARGE AND REPEAT STEPS 1-3.

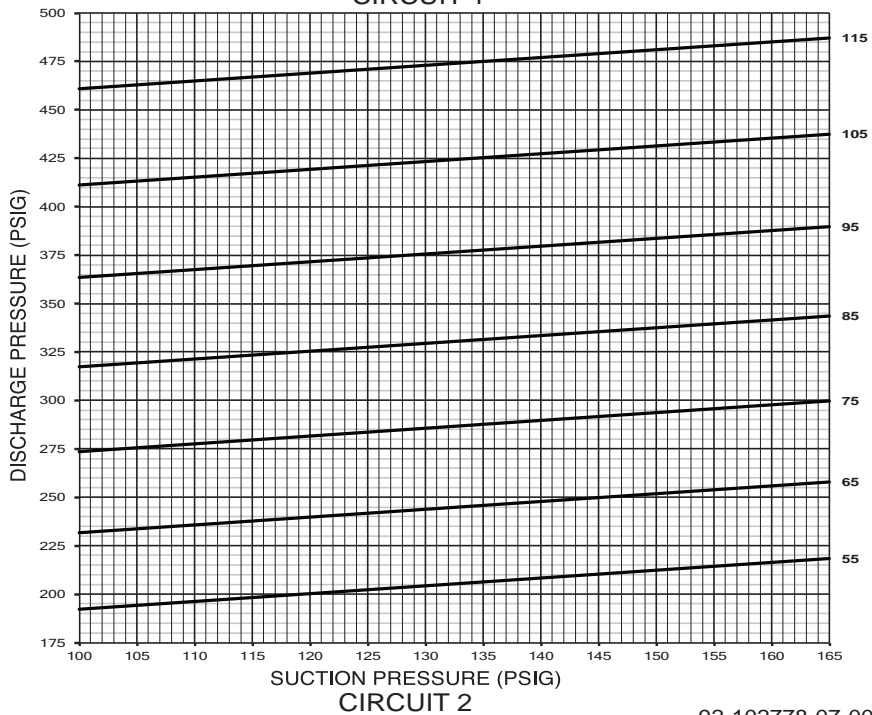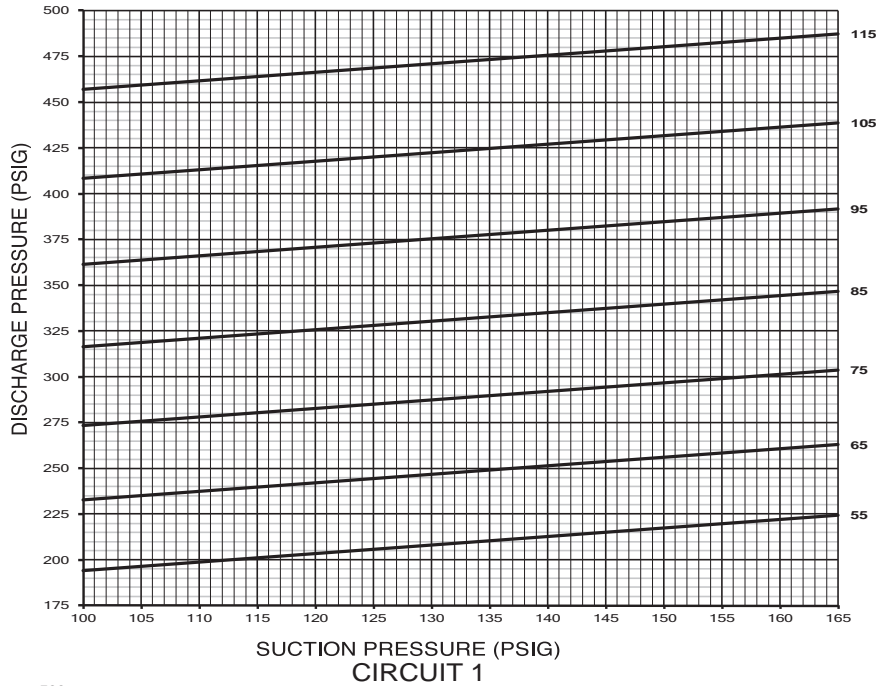

92-102778-07-00

