

HORIZONTAL INSTALLATION OF DUCT COVERS, 3 - 12.5 TON INSTALLATION INSTRUCTIONS

© 2013 **DAIKIN COMPANY, L.P.**

5151 San Felipe, Suite 500, Houston, TX 77056

www.daikincomfort.com

P/N: IOD-7006 Date: June 2013



CAUTION

EDGES MAY BE SHARP. IT IS RECOMMENDED PROTECTIVE GLOVES BE WORN WHEN INSTALLING THE DUCT COVERS.

1. Remove supply and return duct cover panels from the end of the unit. Save all washered screws.
2. According to the model size, remove (6 or 8) factory supplied panel clips that are secured to the base pan, behind the filter access panel.
3. With the insulated side of the panel facing up, attach the clips as shown in Figure 1A for 3 - 6 ton models and Figure 1B for 7.5 - 12.5 ton models.

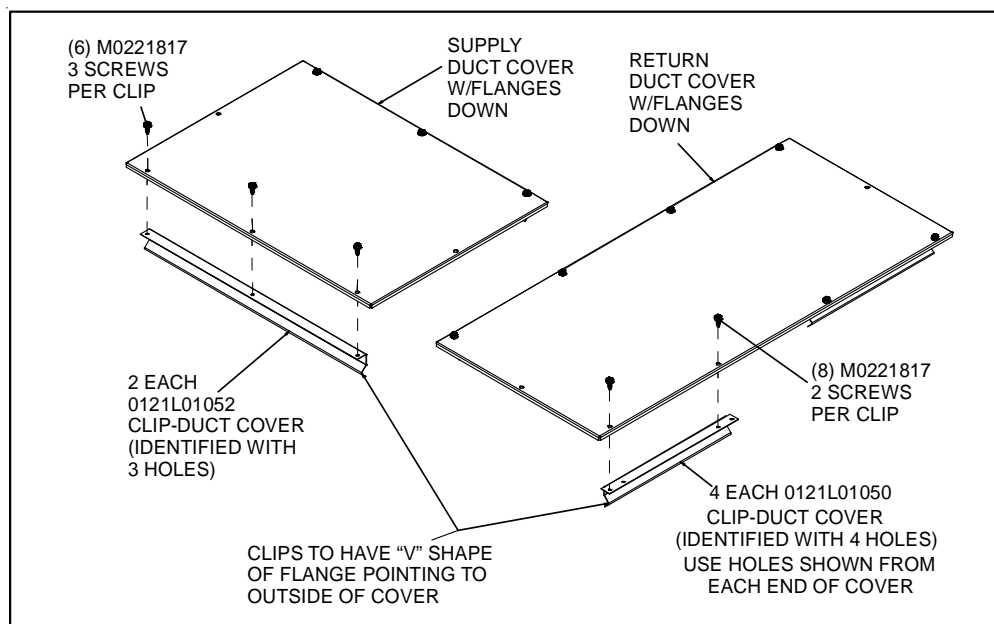


Figure 1A (3-6 Ton Models)

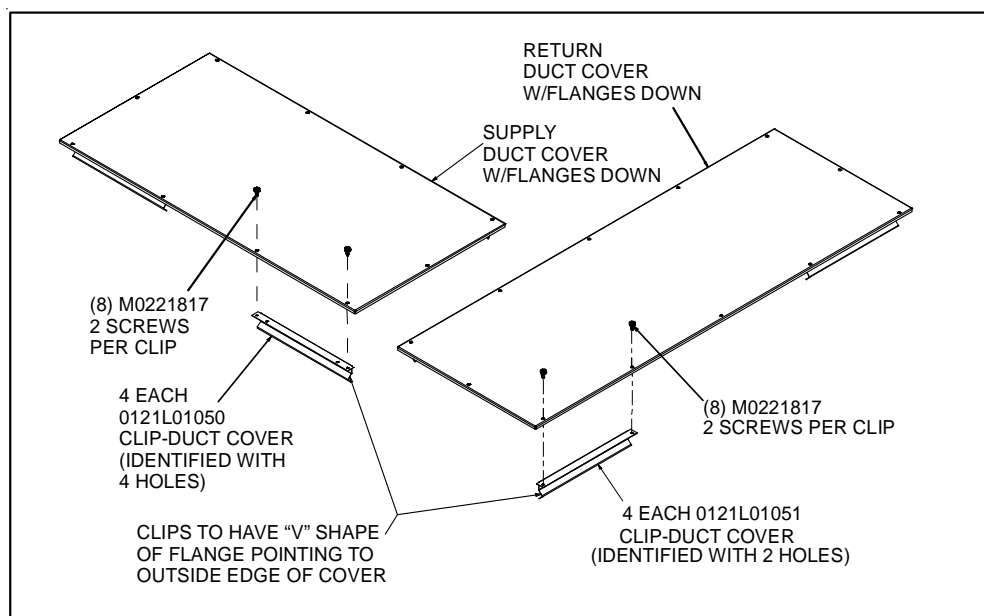


Figure 1B (7.5-12.5 Ton Models)

NOTE: The clips containing (4) holes per clip are for the supply air panel.



4. Place the provided gasket material completely around the perimeter of the clip side on both panels, as shown in Figure 2.

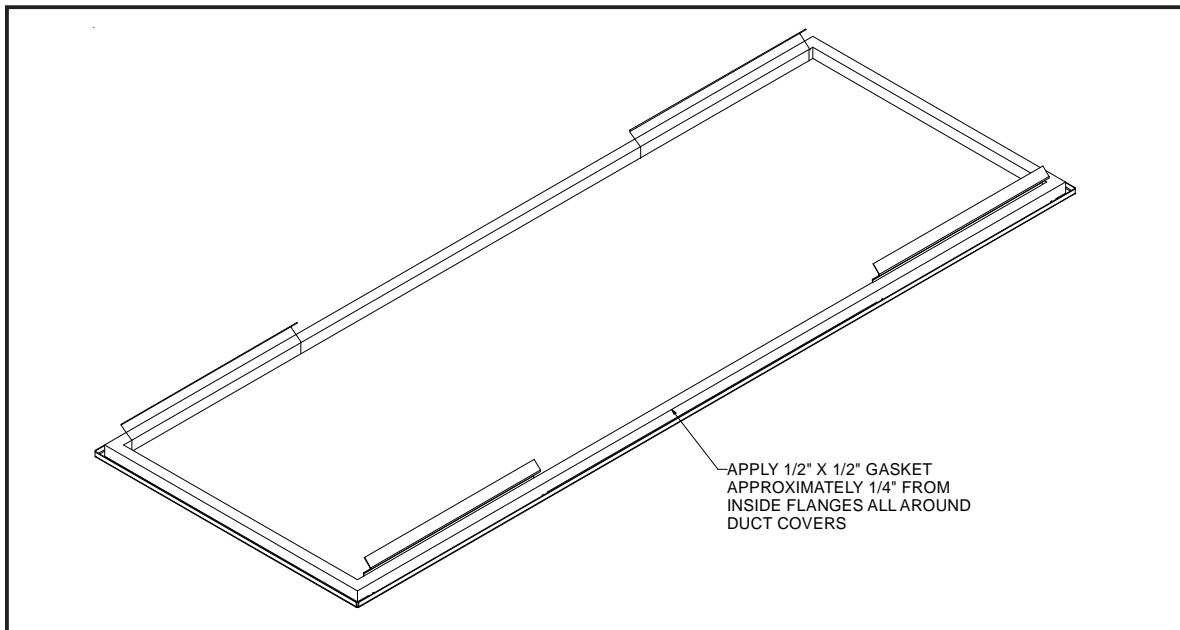


Figure 2

5. Place the assembled panels over the supply and return duct openings in the base pan and push down to snap panels into places, as shown in Figure 3.

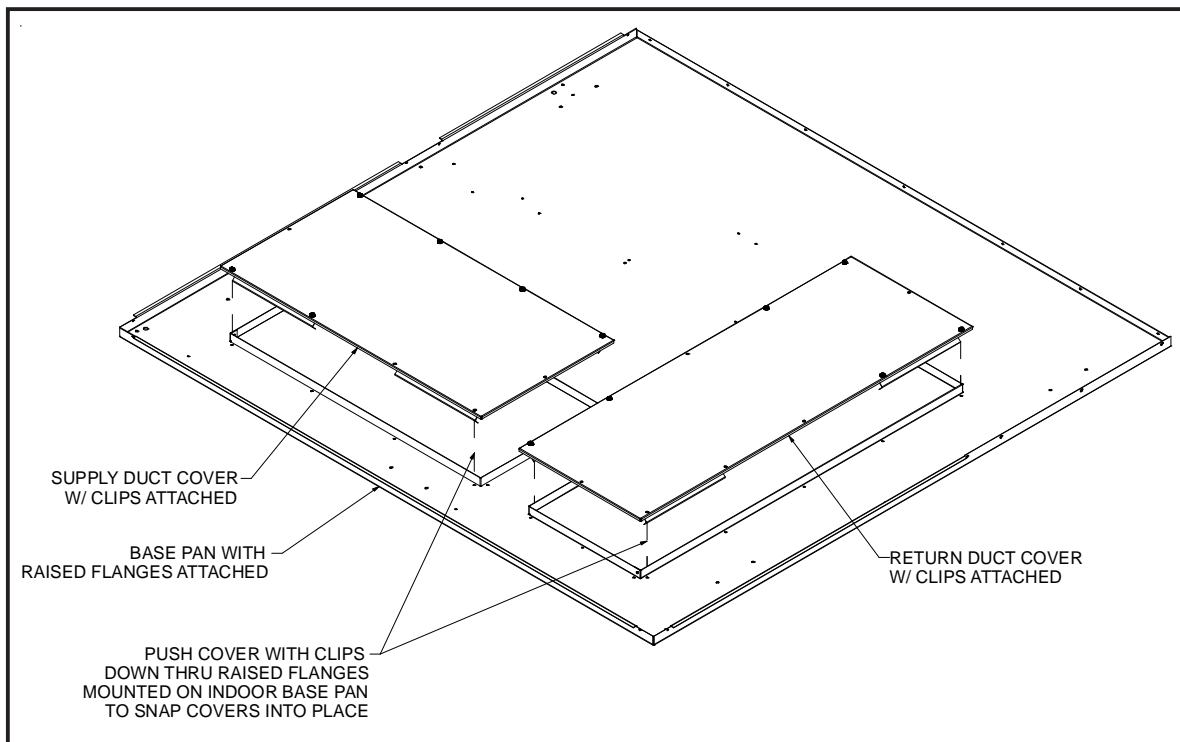


Figure 3

6. Ensure the panel is evenly seated on the flanges around the duct openings and the gasket is creating a good seal.

NOTE: SPECIFICATIONS AND PERFORMANCE DATA LISTED HEREIN ARE SUBJECT TO CHANGE WITHOUT NOTICE

© 2013 **DAIKIN COMPANY, L.P.**

www.daikincomfort.com