



SECTION PROPERTIES			X-X AXIS			Y-Y AXIS		
CHNL P/N	WT/FT LBS.	AREA SQ. IN.	I _x in ⁴	S _x in ³	R _x in	I _y in ⁴	S _y in ³	R _y in
FS-200	1.88	.553	.182	.199	.574	.234	.289	.651
FS-201	3.76	1.105	.925	.569	.915	.469	.577	.651

I = Moment of Inertia S = Section Modulus R = Radius of Gyration

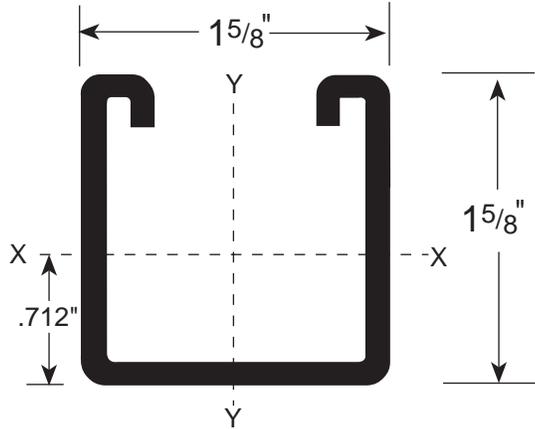

FS-200

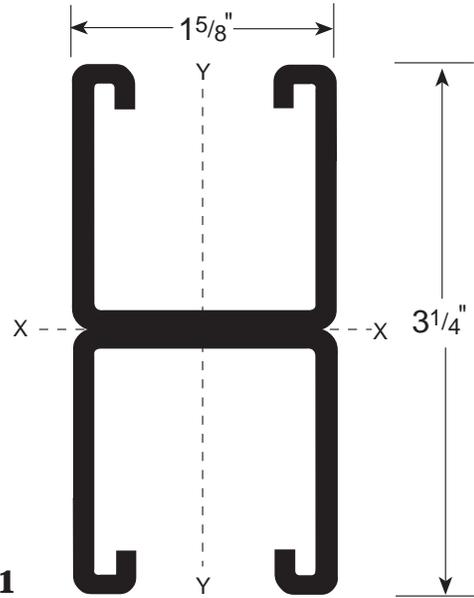

FS-201

CHANNEL FINISH: • PLAIN (PL) • PRE-GALVANIZED (PG) • GREEN (GR)
 • HOT-DIPPED GALVANIZED (HD) • ALUMINUM (AL) • STAINLESS (ST4) TYPE 304
 • PVC Coated • STAINLESS (ST6) TYPE 316

STANDARD LENGTH: 20 FT. • 10 FT.

ALLOWABLE BEAM LOADS — Span In Inches

CHNL P/N	Stress	24"	30"	36"	42"	48"	60"	72"	84"	96"	108"	120"
FS-200	1/240	1,660 ***	1,330 ***	1,110 ***	950 ***	830 760	660 490	550 340	480 250	420 190	370 150	330 120
FS-201	1/240	2,550* ***	2,550* ***	2,550* ***	2,550* ***	2,370 ***	1,900 ***	1,580 ***	1,360 1,260	1,190 960	1,050 760	950 620

- TOTAL STATIC LOAD in LBS.
- Upper line is MAXIMUM ALLOWABLE UNIFORM LOAD creating 25,000 PSI Bending Stress about the X-Axis based on SIMPLE BEAM condition.
- Lower line shows TOTAL UNIFORM LOAD which produces a deflection of 1/240th of the SPAN, (i.e.: 1/2" Def. for 120" Span)
- Multiply values in upper line by 0.5 to obtain ALLOWABLE CENTER CONCENTRATED LOAD at 25,000 PSI Stress. Deflection by 0.8.
- * Load limited by spot weld shear.
- For punched channel, reduce weld limited loads by 0.75 due to 4" weld spacing.
- *** Load controlled by 25,000 PSI design stress.

ALLOWABLE COLUMN LOADS — Unsupported Height of Column in Inches

CHNL P/N	24"	30"	36"	42"	48"	60"	72"	84"	96"	108"	120"
FS-200	9,050	8,090	7,185	6,370	5,650	4,470	3,615	3,040	2,615	2,285	2,015
FS-201	21,995	21,445	20,840	20,045	19,170	17,220	15,105	12,940	10,820	8,820	7,145

- COLUMN LOADS are allowable axial loads applied at the section centroid. Loads applied at the slot face must be reduced for Eccentricity.
- ALLOWABLE COLUMN LOADS shown are based upon an effective length factor K = 0.8 standard engineering practice required for evaluation of other conditions.