

TECHNICAL & SERVICE MANUAL

CITY MULTI Series Ceiling Suspended R410A / R22

 Indoor unit
[Model names]

[Service Ref.]

PCFY-P15NKMU-E

PCFY-P15NKMU-E

PCFY-P24NKMU-E

PCFY-P24NKMU-E


PCFY-P30NKMU-E

PCFY-P30NKMU-E

PCFY-P36NKMU-E

PCFY-P36NKMU-E
Note:

- This manual describes only service data of the indoor units.
- RoHS compliant products have <G> mark on the spec name plate.

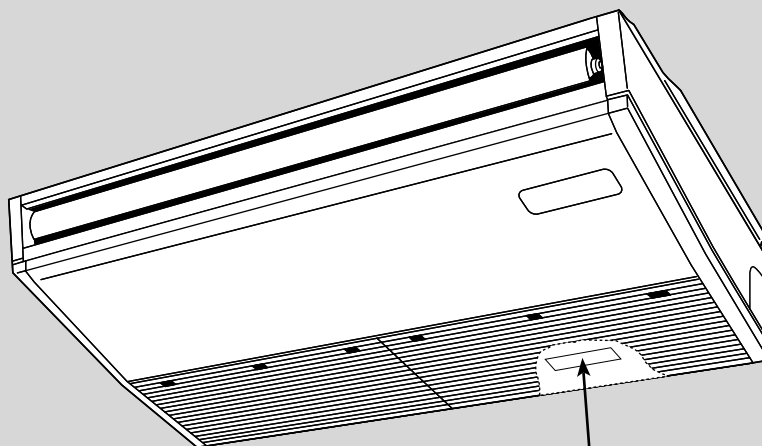

INDOOR UNIT


 Model name
indication

CONTENTS

1. PART NAMES AND FUNCTIONS	2
2. SPECIFICATION	4
3. OUTLINES AND DIMENSIONS	8
4. WIRING DIAGRAM	11
5. REFRIGERANT SYSTEM DIAGRAM	12
6. MICROPROCESSOR CONTROL	13
7. TROUBLESHOOTING	20
8. DISASSEMBLY PROCEDURE	29

PARTS CATALOG (OCB450)


CITY MULTI

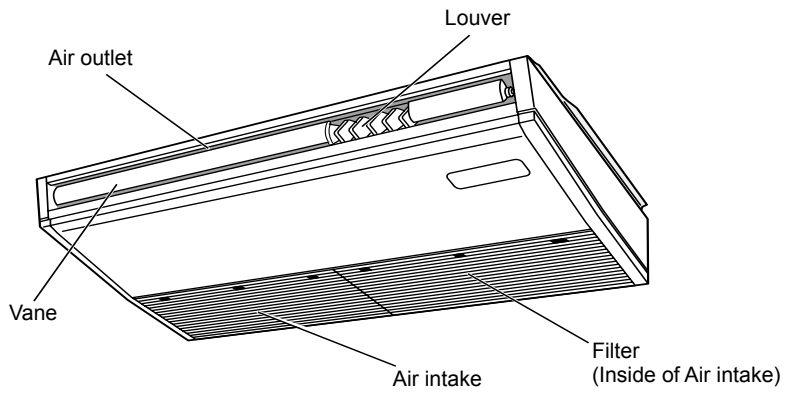• Indoor unit

• Wired remote controller

Display Section

For purposes of this explanation, all parts of the display are shown as lit. During actual operation, only the relevant items will be lit.

Identifies the current operation
Shows the operating mode, etc.
*Multilanguage display is available.

“Centrally Controlled” indicator
Indicates that operation from the remote controller has been prohibited by a master controller.

“Timer is Off” indicator
Indicates that the timer is off.

Temperature Setting
Shows the target temperature.

Day-of-Week
Shows the current day of the week.

Time/Timer Display
Shows the current time, unless the simple or Auto Off timer is set.
If the simple or Auto Off timer is set, the time to be switched off is shown.

“Sensor” indication
Displayed when the remote controller sensor is used.


“Locked” indicator
Indicates that remote controller buttons have been locked.

“Clean The Filter” indicator
To be displayed on when it is time to clean the filter.

Timer indicators
The indicator comes on if the corresponding timer is set.

Fan Speed indicator
Shows the selected fan speed.

Ventilation indicator
Appears when the unit is running in Ventilation mode.

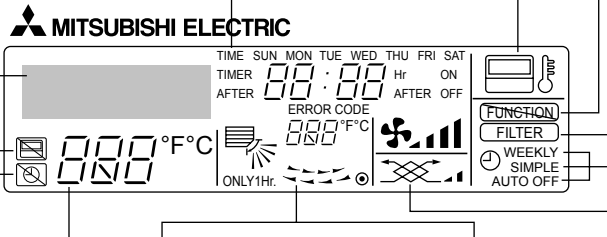

Up/Down Air Direction indicator
The indicator shows the direction of the outcoming airflow.

Room Temperature display
Shows the room temperature. The room temperature display range is 46–102°F. The display blinks if the temperature is less than 46°F or 102°F or more.

“One Hour Only” indicator
Displayed if the airflow is set to Low or downward during COOL or DRY mode. (Operation varies according to model.)
The indicator goes off in one hour, at which time the airflow direction also changes.

Louver display
Indicates the action of the swing louver. Does not appear if the louver is not running.

(Power On indicator)
Indicates that the power is on.

Operation Section

Temperature setting buttons



Timer Menu button (Monitor/Set button)

Mode button (Return button)

Set Time buttons



Timer On/Off button (Set Day button)

ON/OFF button

Fan Speed button

Filter button (<Enter> button)

Test Run button

Check button (Clear button)



Airflow Up/Down button

Louver button (▽ Operation button)

▽ To return operation number

Ventilation button (△ Operation button)

△ To go to next operation number

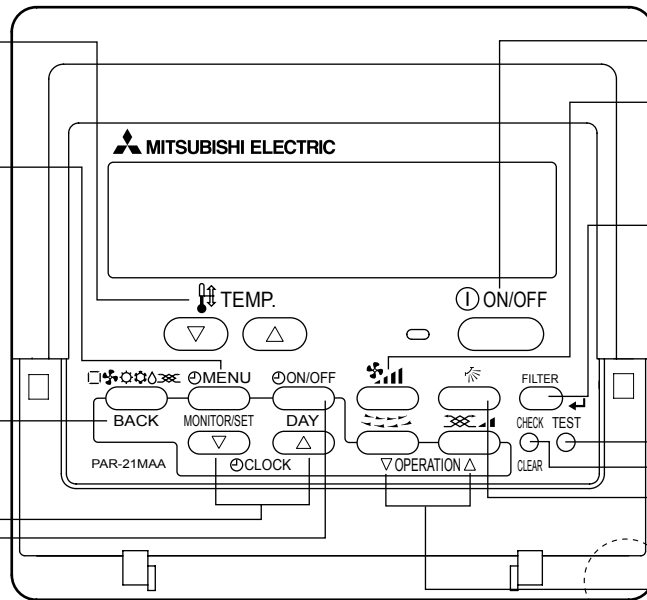

Built-in temperature sensor

Note:

- “PLEASE WAIT” message
This message is displayed for approximately 3 minutes when power is supplied to the indoor unit or when the unit is recovering from a power failure.
- “NOT AVAILABLE” message
This message is displayed if an invalid button is pressed (to operate a function that the indoor unit does not have).
If a single remote controller is used to operate multiple indoor units simultaneously that are different types, this message will not be displayed as far as any of the indoor units is equipped with the function.

2-1. SPECIFICATIONS

Model		PCFY-P15NKMU-E	PCFY-P24NKMU-E	PCFY-P30NKMU-E	PCFY-P36NKMU-E	
Power source		1-phase 208/230V 60Hz				
Cooling capacity (Nominal)	*1 kW	4.4	7.0	8.8	10.6	
	*1 Btu/h	15,000	24,000	30,000	36,000	
	Power input kW	0.03	0.04	0.09	0.11	
	Current input A	0.35	0.41	0.83	0.97	
Heating capacity (Nominal)	*2 kW	5.0	7.9	10.0	11.7	
	*2 Btu/h	17,000	27,000	34,000	40,000	
	Power input kW	0.03	0.04	0.09	0.11	
	Current input A	0.35	0.41	0.83	0.97	
External finish		MUNSELL (6.4Y 8.9/0.4)				
External dimensions H x W x D		mm	230×960×680	230×1280×680	230×1600×680	
		in.	9-1/16×37-13/16×26-3/4	9-1/16×50-3/8×26-3/4	9-1/16×63×26-3/4	
Net weight		kg (lb)	24 (53)	32 (71)	36 (79)	
Heat exchanger		Cross fin (Aluminum fin and copper tube)				
FAN	Type x quantity		Sirocco fan × 2	Sirocco fan × 3	Sirocco fan × 4	
	External static press.	Pa	0			
		mmH ₂ O	0			
	Motor type		DC motor			
	Motor output kW		0.090	0.095	0.160	
	Driving mechanism		Direct-driven by motor			
	Airflow rate (Low-Mid2-Mid1-High)	m ³ /min	10-11-12-13	14-15-16-18	20-22-25-28	21-24-27-31
L/s		167-183-200-217	233-250-267-300	333-367-417-467	350-400-450-517	
cfm		353-388-424-459	494-530-565-636	703-777-883-989	742-847-953-1095	
Noise level (Low-Mid2-Mid1-High) (measured in anechoic room)		dB <A>	29-32-34-36	31-33-35-37	34-37-40-43	36-39-42-44
Insulation material		Polyeter sheet				
Air filter		PP honeycomb				
Protection device		Fuse				
Refrigerant control device		LEV				
Connectable outdoor unit		R410A, R22 CITY MULTI				
Diameter of refrigerant pipe	Liquid (R410A) (R22)	mm(in.)	ø6.35 (ø1/4) Flare	ø9.52 (ø3/8) Flare	ø9.52 (ø3/8) Flare	ø9.52 (ø3/8) Flare
			ø6.35 (ø1/4) Flare	ø9.52 (ø3/8) Flare	ø9.52 (ø3/8) Flare	ø9.52 (ø3/8) Flare
	Gas (R410A) (R22)	mm(in.)	ø12.7 (ø1/2) Flare	ø15.88 (ø5/8) Flare	ø15.88 (ø5/8) Flare	ø15.88 (ø5/8) Flare
			ø12.7 (ø1/2) Flare	ø15.88 (ø5/8) Flare	ø15.88 (ø5/8) Flare	ø19.05(ø3/4) Flare*3
Field drain pipe size		mm(in.)	O.D. 26mm (1)			
Standard attachment	Document		Installation Manual, Instruction Book			
	Accessory		Drain joint socket			
Optional parts	Drain pump kit		PAC-SH83DM-E	PAC-SH84DM-E		
	High efficiency filter		PAC-SH88KF-E	PAC-SH89KF-E	PAC-SH90KF-E	
	External heater adapter		PAC-YU25HT			
	i-see Sensor		PAC-SH91MK-E			
	Wireless remote controller with i-see Sensor		PAR-SA92MW-E			
	Wireless remote controller kit		PAR-SL93B-E			
Remarks	Installation	Details on foundation work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual.				
Note :	*1 Nominal cooling conditions		*2 Nominal heating conditions		*3 Connect the joint (purchased locally) for R22	
	Indoor : 80°FDB/67°FWB (26.7°CDB/19.4°CWB)		70°FDB(21°CDB)		Unit converter kcal/h = kW × 860 Btu/h = kW × 3,412 cfm = m ³ /min × 35.31 lb = kg/0.4536 *Above specification data is subject to rounding variation.	
	Outdoor : 95°FDB (35°CDB)		47°FDB/43°FWB (8.3°CDB/6.1°CWB)			
	Pipe length : 25 ft. (7.6 m)		25 ft. (7.6 m)			
	Level difference : 0 ft (0 m)		0 ft (0 m)			
* Due to continuing improvement, above specification may be subject to change without notice.						


2-2. ELECTRICAL PARTS SPECIFICATIONS

Service Ref. Parts name	Symbol	PCFY-P15NKMU-E	PCFY-P24NKMU-E	PCFY-P30NKMU-E PCFY-P36NKMU-E
Room temperature thermistor	TH21	Resistance 30°F/15.8kΩ, 50°F/9.6kΩ, 70°F/6.0kΩ, 80°F/4.8kΩ, 90°F/3.9kΩ, 100°F/3.2kΩ		
Liquid pipe thermistor	TH22	Resistance 30°F/15.8kΩ, 50°F/9.6kΩ, 70°F/6.0kΩ, 80°F/4.8kΩ, 90°F/3.9kΩ, 100°F/3.2kΩ		
Gas pipe thermistor	TH23	Resistance 30°F/15.8kΩ, 50°F/9.6kΩ, 70°F/6.0kΩ, 80°F/4.8kΩ, 90°F/3.9kΩ, 100°F/3.2kΩ		
Fuse (Indoor controller board)	FUSE	250V 6.3A		
Fan motor	MF	8-pole OUTPUT 90W	8-pole OUTPUT 95W	8-pole OUTPUT 160W
Vane motor	MV	MSBPC20 DC12V 300Ω/phase		
Drain-pump (Option)	DP	INPUT 10.8W 24ℓ/Hr		
Drain float switch	FS	Open / Short detection DC 5V		
Linear expansion valve	LEV	DC12V Stepping motor drive Port dimension ø3.2 (0~2000pulse) EFM-40YGME	DC12V Stepping motor drive Port dimension ø5.2 (0~2000pulse) EFM-80YGME	
Power supply terminal block	TB2	(L1, L2, GR) Rated to 330V 30A*		
Transmission terminal block	TB5	(M1, M2, S) Rated to 250V 20A *		
MA remote controller terminal block	TB15	(1, 2) Rated to 250V 10A *		

*Note : Refer to WIRING DIAGRAM for the supplied voltage.

2-3. SOUND LEVEL

PCFY-P•NKMU-E

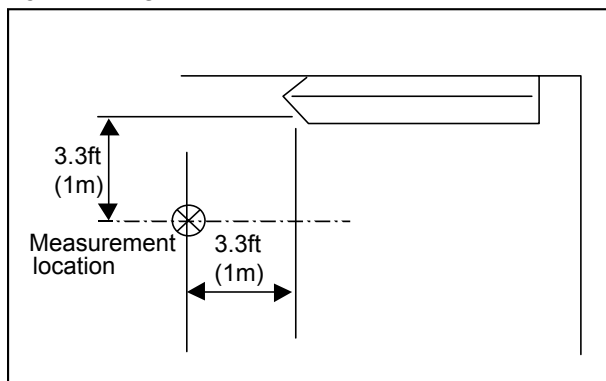

* Measured in anechoic room.


Sound level at anechoic room : Low-Mid2-Mid1-High

Service Ref.	Sound level dB (A)
PCFY-P15NKMU-E	29-32-34-36
PCFY-P24NKMU-E	31-33-35-37
PCFY-P30NKMU-E	34-37-40-43
PCFY-P36NKMU-E	36-39-42-44

2-4. NC CURVES


PCFY-P15NKMU-E

External static pressure : 0Pa
Power source : 208V, 230V, 60Hz

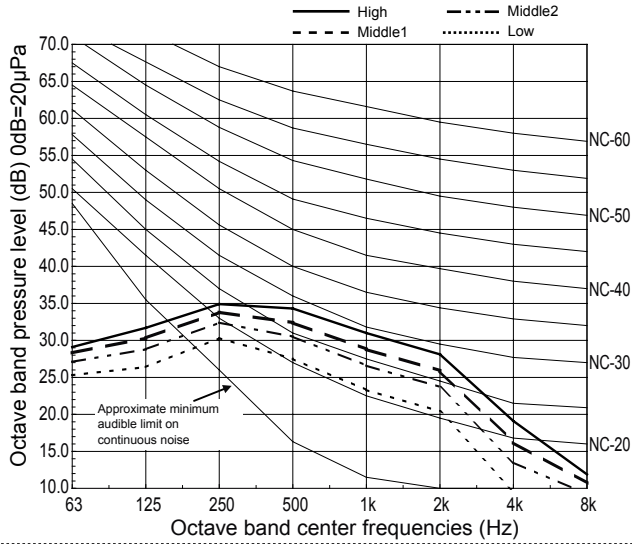


PCFY-P24NKMU-E

External static pressure : 0Pa
Power source : 208V, 230V, 60Hz

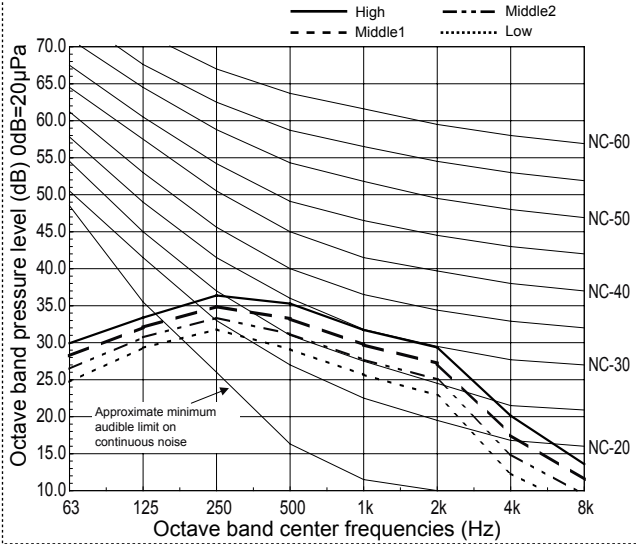


PCFY-P30NKMU-E

External static pressure : 0Pa
Power source : 208V, 230V, 60Hz

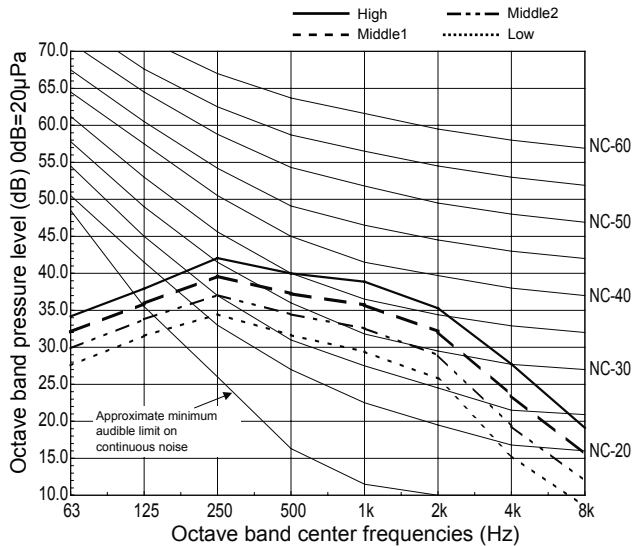


PCFY-P36NKMU-E

External static pressure : 0Pa
Power source : 208V, 230V, 60Hz

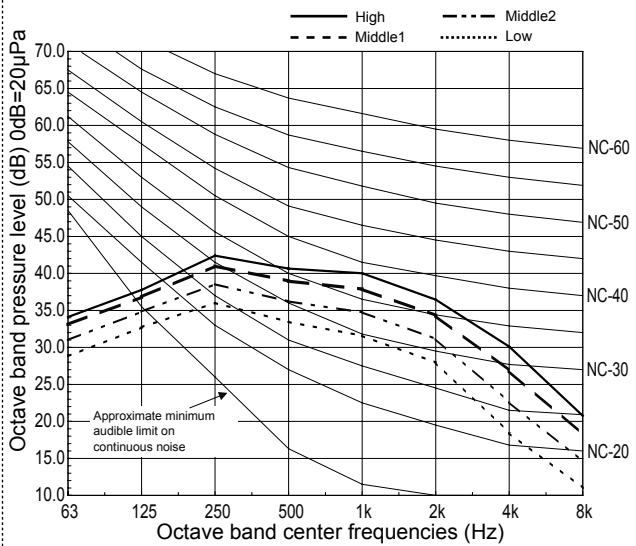


2-5. FRESH AIR INTAKE AMOUNT & STATIC PRESSURE CHARACTERISTICS

■ PCFY-P15NKMU-E

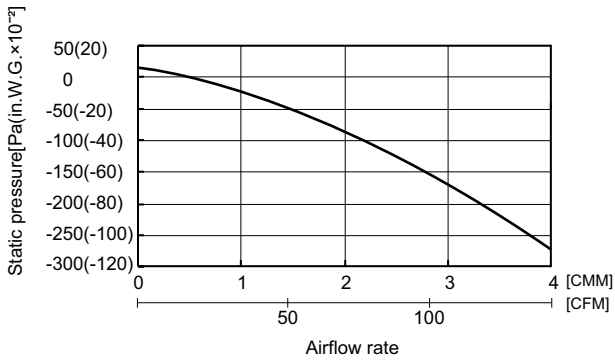


How to read curves

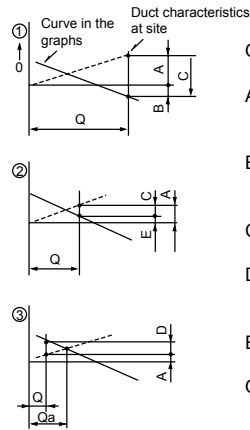


- Q...Designed amount of fresh air intake <CMM(CFM)>
- A...Static pressure loss of fresh air intake duct system with airflow amount Q <Pa(in.W.G.x10⁻²)>
- B...Forced static pressure at air conditioner inlet with airflow amount Q <Pa(in.W.G.x10⁻²)>
- C...Static pressure of booster fan with airflow amount Q <Pa(in.W.G.x10⁻²)>
- D...Static pressure loss increase amount of fresh air intake duct system for airflow amount Q <Pa(in.W.G.x10⁻²)>
- E...Static pressure of indoor unit with airflow amount Q <Pa(in.W.G.x10⁻²)>
- Qa...Estimated amount of fresh air intake without D <CMM(CFM)>

■ PCFY-P24NKMU-E

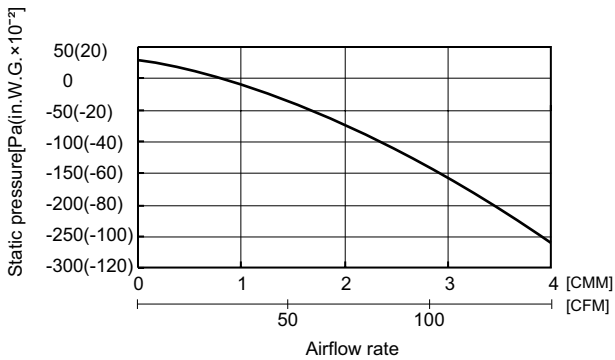


■ PCFY-P30, 36NKMU-E

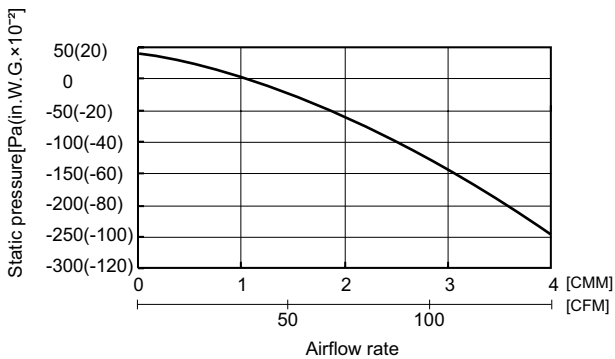





PCFY-P15NKMU-E

Unit : inch(mm)

[FRONT VIEW]

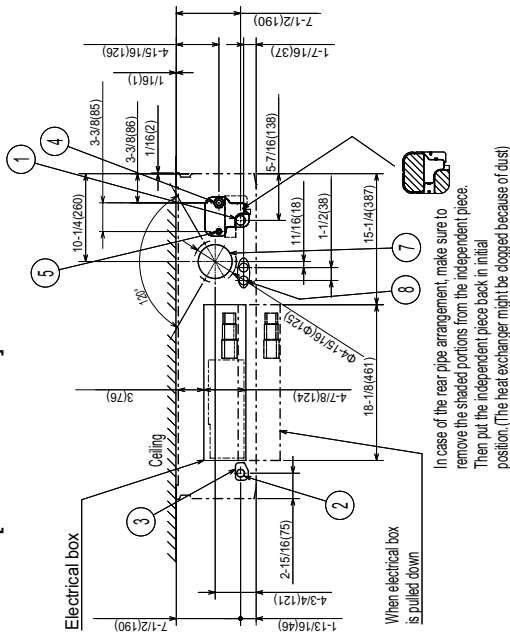

In case of the rear pipe arrangement, make sure to remove the shaded portions from the independent piece. Then put the independent piece back in initial position. (The heat exchanger might be clogged because of dust)

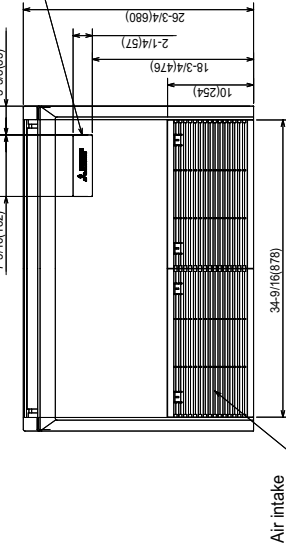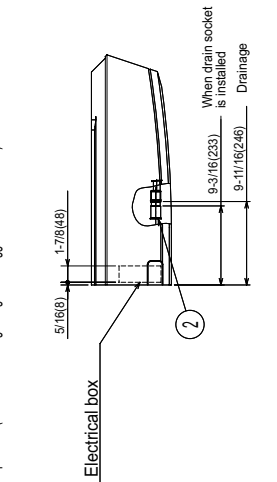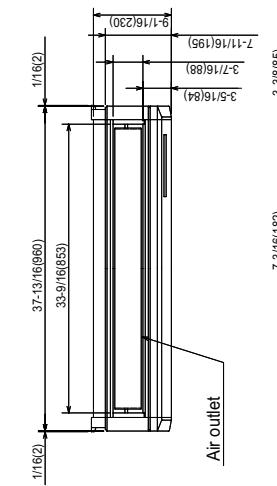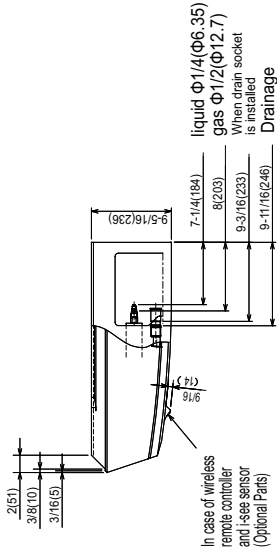




- ① Drainage pipe connection (1(26mm) I.D.)
 - ② Drainage pipe connection (for the left arrangement)
 - ③ Knock out hole for left drain-piping arrangement
 - ④ Refrigerant-pipe connection (gas pipe side/flared connection)
 - ⑤ Refrigerant-pipe connection (liquid pipe side/flared connection)
 - ⑥ Knock out hole for upper drain pipe arrangement
 - ⑦ Knock out hole for fresh air intake $\Phi 3-15/16(\Phi 100)$
 - ⑧ Knock out hole for wiring arrangement $\Phi 7/8(\Phi 22)$
- Accessory...Drain socket (1(26mm) I.D.)

- NOTES.
- 1. Use M10 or W38 screw for anchor bolt.
 - 2. Please be sure when installing the drain lift up mechanism (option parts), refrigerant pipe will be only upward.

PCFY-P30, 36NKMU-E

Unit : inch(mm)

- NOTES.**
1. Use M10 or W3/8 screw for anchor bolt.
 2. Please be sure when installing the drain lift up mechanism (option parts), refrigerant pipe will be only upward.

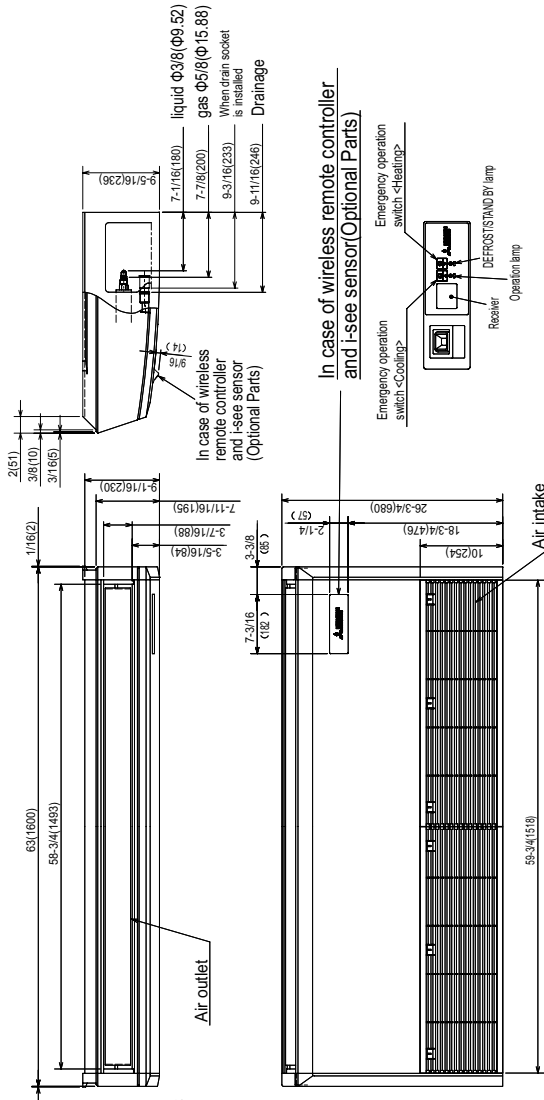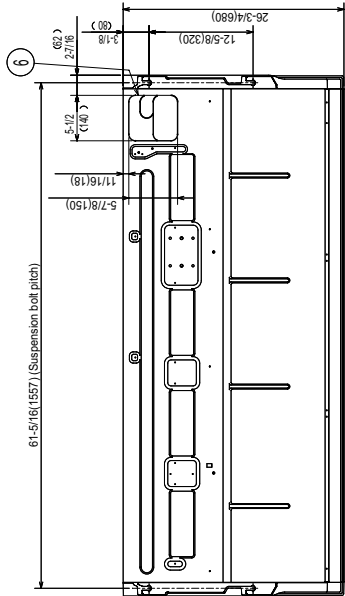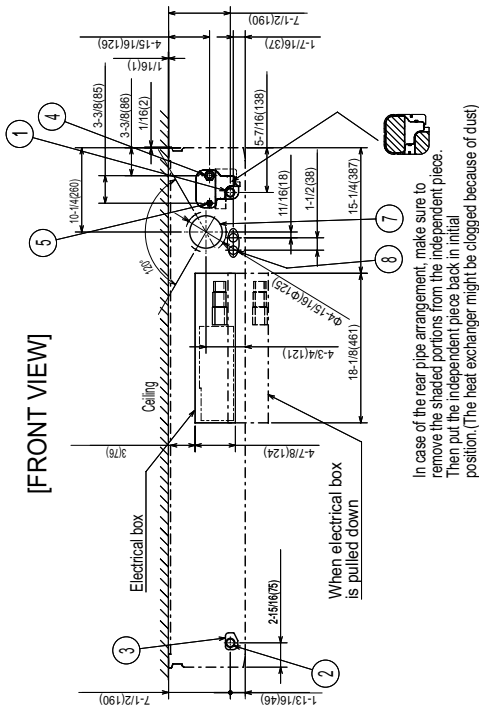

- 1 Drainage pipe connection (1(26mm)) I.D.)
 - 2 Drainage pipe connection (for the left arrangement)
 - 3 Knock out hole for left drain-piping arrangement
 - 4 Refrigerant-pipe connection (gas pipe side/flared connection)
 - 5 Refrigerant-pipe connection (liquid pipe side/flared connection)
 - 6 Knock out hole for upper drain pipe arrangement
 - 7 Knock out hole for fresh air intake $\Phi 3-15/16$ (95.14)
 - 8 Knock out hole for wiring arrangement $\Phi 7/8$ (22.23)
- Accessory... Drain socket (1(26mm)) I.D.)

4

WIRING DIAGRAM


PCFY-P15, 24, 30, 36NKMU-E

[LEGEND]

SYMBOL	NAME	SYMBOL	NAME
I. B	INDOOR CONTROLLER BOARD	TH22	THERMISTOR
CN24	CONNECTOR	EXTERNAL HEATER	PIPE TEMP. DETECTION / LIQUID (32°F/15KΩ, 77°F/5.4KΩ Detect)
CN27	CONNECTOR	DAMPER	PIPE TEMP. DETECTION / GAS (32°F/15KΩ, 77°F/5.4KΩ Detect)
CN32	CONNECTOR	REMOTE SWITCH	
CN51	CONNECTOR	CENTRALLY CONTROL	
CN52	CONNECTOR	REMOTE INDICATION	
DSA	SURGE ABSORBER	A. B	ADDRESS BOARD
FUSE	FUSE (T6.3AL250V)	SWA	SWITCH
SW2	SWITCH	SWC	SWITCH
SW3	SWITCH	SW1	SWITCH
SW4	SWITCH	SW11	SWITCH
SWE	SWITCH	SW12	SWITCH
X1	AUX. RELAY	SW14	SWITCH
ZNR01,02	VARIATOR	OPTIONAL PARTS	
LEV	LINEAR EXPANSION VALVE	W.B	PCB FOR WIRELESS REMOTE CONTROLLER
MF	FAN MOTOR	BZ	BUZZER
MV	VANE MOTOR	LED1	LED (OPERATION INDICATION : GREEN)
MT	I-SEE SENSOR MOTOR(OPTIONAL PARTS)	LED2	LED (PREPARATION FOR HEATING : ORANGE)
TB2	TERMINAL BLOCK	RU	RECEIVING UNIT
TB5	BLOCK	SW1	EMERGENCY OPERATION (HEAT / DOWN)
TB15	BLOCK	SW2	EMERGENCY OPERATION (COOL / UP)
TH21	THERMISTOR	DP	DRAIN LIFT UP MECHANISM
		FS	DRAIN FLOAT SWITCH

LED on indoor board for service

Mark	Meaning	Function
LED1	Main power supply	Main Power supply (Indoor unit:208-230V) power on → lamp is lit
LED2	Power supply for MA-Remote controller	Power supply for MA-Remote controller on → lamp is lit

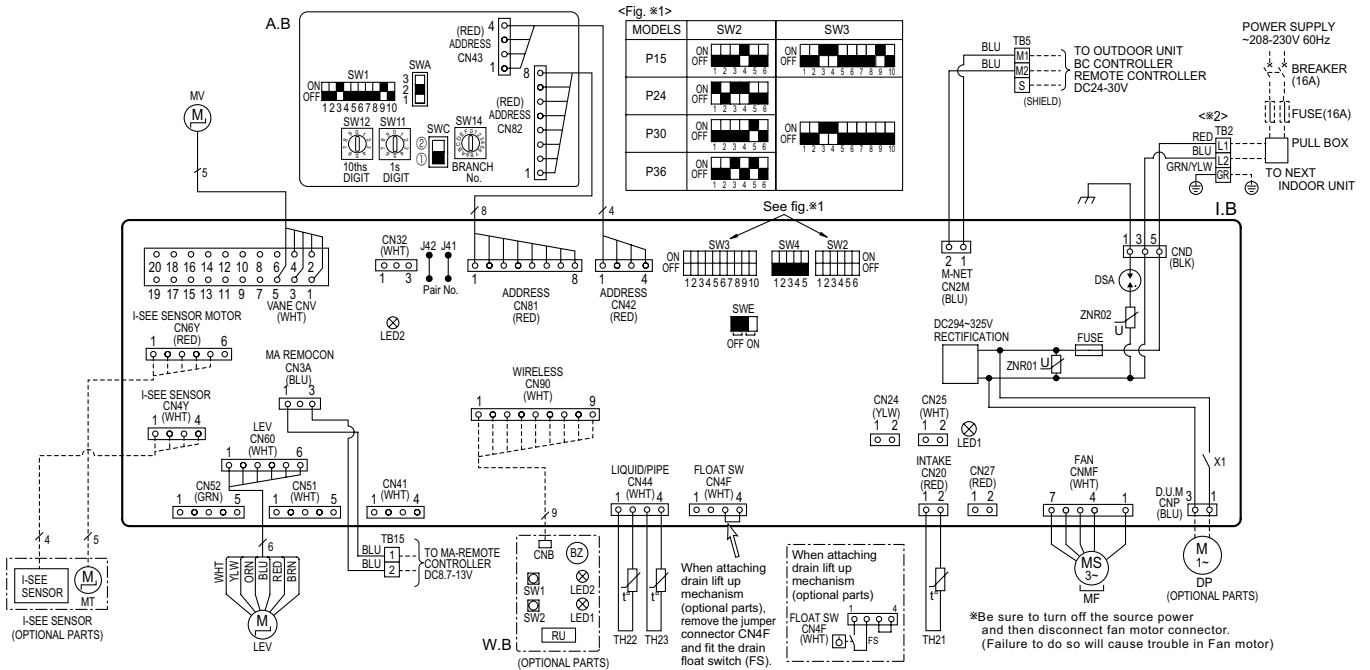

NOTES:

1. At servicing for outdoor unit, always follow the wiring diagram of outdoor unit.
2. In case of using MA-Remote controller, please connect to TB15. (Remote controller wire is non-polar.)
3. In case of using M-NET, please connect to TB5. (Transmission line is non-polar.)
4. Symbol [S] of TB5 is the shield wire connection.
5. Symbols used in wiring diagram above are, : terminal block, : connector.
6. The setting of the SW2 dip switches differs in the capacity. For the detail, refer to fig.*1.

<#2>Use copper supply wires.

5

REFRIGERANT SYSTEM DIAGRAM


PCFY-P15NKMU-E

PCFY-P24NKMU-E

PCFY-P30NKMU-E

PCFY-P36NKMU-E

← Refrigerant flow in cooling
 ← - - Refrigerant flow in heating

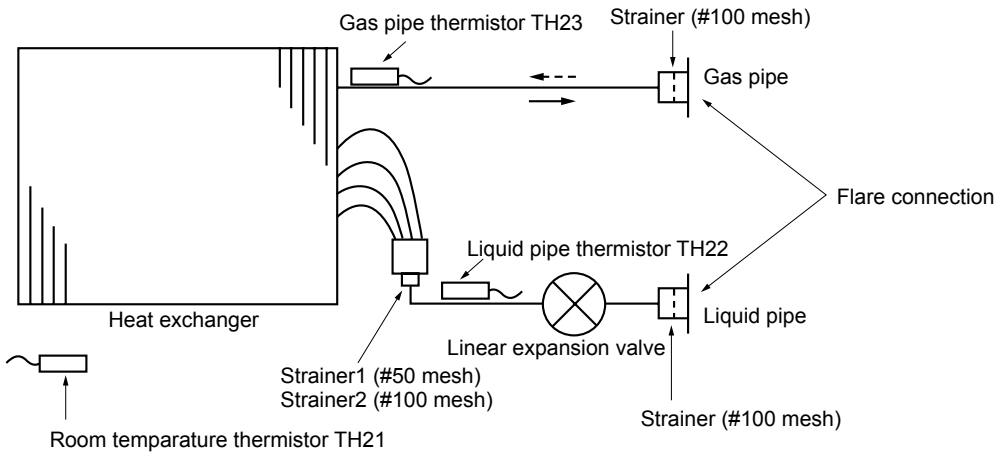

Unit : mm (inch)


Item	Service Ref.	PCFY-P24NKMU-E PCFY-P30NKMU-E PCFY-P36NKMU-E
	Gas pipe	PCFY-P15NKMU-E
Liquid pipe		ø9.52 (3/8)

6

MICROPROCESSOR CONTROL

INDOOR UNIT CONTROL

6-1. COOL OPERATION

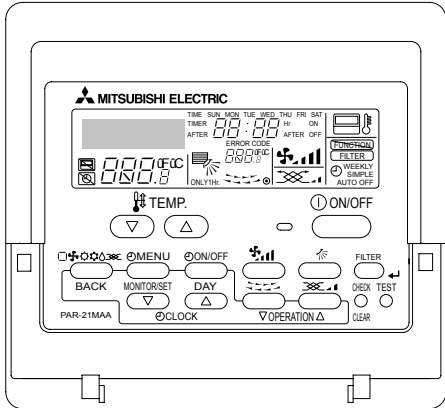

<How to operate>

- ① Press POWER ON/OFF button.
- ② Press the operation MODE button to display COOL.
- ③ Press the TEMP. button to set the desired temperature.


NOTE: The set temperature changes 2°F when the ∇ or Δ button is pressed one time. Cooling 67 to 87°F

Control modes	Control details	Remarks				
1. Thermoregulating function	<p>1-1. Thermoregulating function (Function to prevent restarting for 3 minutes)</p> <ul style="list-style-type: none"> • Room temperature \geq desired temperature + 2°F ...Thermo ON • Room temperature \leq desired temperature ...Thermo OFF 					
	<p>1-2. Anti-freezing control</p> <p>Detected condition : When the liquid pipe temp. (TH22) is 32°F or less in 16 minutes from compressors start up, anti-freezing control starts and the thermo OFF.</p> <p>Released condition : The timer which prevents reactivating is set for 3 minutes, and anti-freezing control is cancelled when any one of the following conditions is satisfied.</p> <ol style="list-style-type: none"> ① Liquid pipe temp. (TH22) turns 50°F or above. ② The condition of the thermo OFF has become complete by thermoregulating, etc. ③ The operation modes became mode other than COOL. ④ The operation stopped. 					
2. Fan	<p>By the remote controller setting (switch of 4 speeds+Auto)</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>Type</th> <th>Fan speed notch</th> </tr> </thead> <tbody> <tr> <td>4 speeds + Auto type</td> <td>[Low], [Med2], [Med1], [High], [Auto]</td> </tr> </tbody> </table> <p>When [Auto] is set, fan speed is changed depending on the value of: Room temperature - Desired temperature</p>	Type	Fan speed notch	4 speeds + Auto type	[Low], [Med2], [Med1], [High], [Auto]	
Type	Fan speed notch					
4 speeds + Auto type	[Low], [Med2], [Med1], [High], [Auto]					



Control modes	Control details	Remarks
3. Drain pump	<p>3-1. Drain pump control</p> <ul style="list-style-type: none"> • Drain pump is always ON during the COOL and DRY mode operation. (Regardless of the thermo ON/OFF) • When the operation mode has changed from the COOL or DRY to the others (including Stop), the drain pump will be kept on for 3 minutes, then turns OFF. <p>Float switch control</p> <ul style="list-style-type: none"> • Float switch control judges whether the sensor is in the air or in the water by turning the float switch ON/OFF. In the water: Detected that the float switch is ON for 15 seconds. In the air : Detected that the float switch is OFF for 15 seconds. 	
4. Vane (up/down vane change)	<p>(1) Initial setting: Start at COOL mode and horizontal vane.</p> <p>(2) Vane position: Horizontal → Downward A → Downward B → Downward C → Downward D → Swing → Auto</p> <p>(3) Restriction of the downward vane setting When setting the downward vane A, B, C or D in [Med1], [Med2], [Low] or [Auto] of the fan speed notch, the vane changes to horizontal position after 1 hour have passed.</p>	<p>· "ONLY 1 Hr" appears on the wired remote controller.</p>

6-2. DRY OPERATION

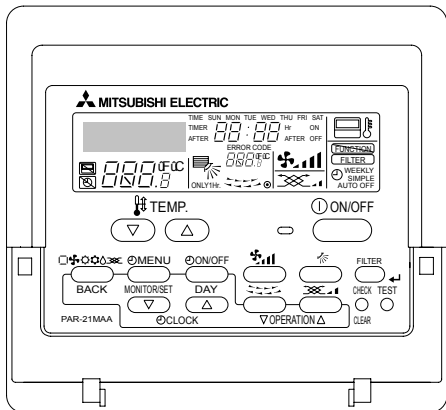


<How to operate>

- ① Press POWER ON/OFF button.
- ② Press the operation MODE button to display DRY.
- ③ Press the TEMP. button to set the desired temperature.

NOTE: The set temperature changes 2°F when the ∇ or \triangle button is pressed one time. Dry 67 to 87°F

Control modes	Control details	Remarks																															
1. Thermo regulating function	<p>1-1. Thermo regulating function (Function to prevent restarting for 3 minutes) Setting the Dry thermo by the thermo regulating signal and the room temperature (TH21). Dry thermo ON Room temperature \geq desired temperature + 2°F Dry thermo OFF Room temperature \geq desired temperature</p> <table border="1"> <thead> <tr> <th rowspan="2">Room temperature</th> <th colspan="2">3 min. passed since starting operation</th> <th rowspan="2">Dry thermo ON time (min)</th> <th rowspan="2">Dry thermo OFF time (min)</th> </tr> <tr> <th>Thermo regulating signal</th> <th>Room temperature (T1)</th> </tr> </thead> <tbody> <tr> <td rowspan="4">Over 64°F</td> <td rowspan="4">ON</td> <td>T1 \geq 83°F</td> <td>9</td> <td>3</td> </tr> <tr> <td>83°F > T1 \geq 79°F</td> <td>7</td> <td>3</td> </tr> <tr> <td>79°F > T1 \geq 75°F</td> <td>5</td> <td>3</td> </tr> <tr> <td>75°F > T1</td> <td>3</td> <td>3</td> </tr> <tr> <td></td> <td>OFF</td> <td>Unconditional</td> <td>3</td> <td>10</td> </tr> <tr> <td>Less than 64°F</td> <td colspan="4">Dry thermo OFF</td> </tr> </tbody> </table>	Room temperature	3 min. passed since starting operation		Dry thermo ON time (min)	Dry thermo OFF time (min)	Thermo regulating signal	Room temperature (T1)	Over 64°F	ON	T1 \geq 83°F	9	3	83°F > T1 \geq 79°F	7	3	79°F > T1 \geq 75°F	5	3	75°F > T1	3	3		OFF	Unconditional	3	10	Less than 64°F	Dry thermo OFF				
	Room temperature		3 min. passed since starting operation				Dry thermo ON time (min)	Dry thermo OFF time (min)																									
Thermo regulating signal		Room temperature (T1)																															
Over 64°F	ON	T1 \geq 83°F	9	3																													
		83°F > T1 \geq 79°F	7	3																													
		79°F > T1 \geq 75°F	5	3																													
		75°F > T1	3	3																													
	OFF	Unconditional	3	10																													
Less than 64°F	Dry thermo OFF																																
	<p>1-2. Freeze prevention control No control function</p>																																
2. Fan	<p>Indoor fan operation controlled depending on the compressor conditions.</p> <table border="1"> <thead> <tr> <th>Dry thermo</th> <th colspan="2">Fan speed notch</th> </tr> </thead> <tbody> <tr> <td>ON</td> <td colspan="2">[Low]</td> </tr> <tr> <td rowspan="2">OFF</td> <td>Excluding the following</td> <td>Stop</td> </tr> <tr> <td>Room temp. < 64°F</td> <td>[Low]</td> </tr> </tbody> </table> <p>Note: Remote controller setting is not acceptable.</p>	Dry thermo	Fan speed notch		ON	[Low]		OFF	Excluding the following	Stop	Room temp. < 64°F	[Low]																					
Dry thermo	Fan speed notch																																
ON	[Low]																																
OFF	Excluding the following	Stop																															
	Room temp. < 64°F	[Low]																															
3. Drain pump	Same control as COOL operation																																
4. Vane (up/down vane change)	Same control as COOL operation																																

6-3. FAN OPERATION

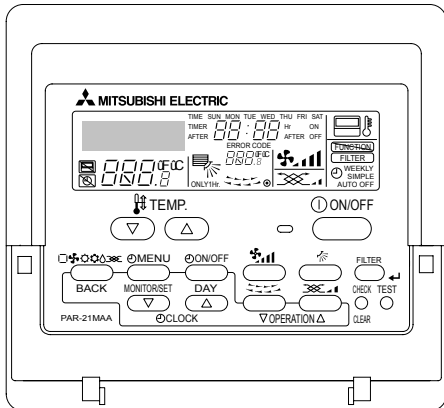


<How to operate>

- ① Press POWER ON/OFF button.
- ② Press the operation MODE button to display FAN.

Control modes	Control details	Remarks				
1. Fan	<p>Set by remote controller.</p> <table border="1"> <thead> <tr> <th>Type</th> <th>Fan speed notch</th> </tr> </thead> <tbody> <tr> <td>4 speeds + Auto type</td> <td>[Low], [Med2], [Med1], [High], [Auto]</td> </tr> </tbody> </table> <p>When [Auto] is set, fan speed becomes [Low].</p>	Type	Fan speed notch	4 speeds + Auto type	[Low], [Med2], [Med1], [High], [Auto]	
Type	Fan speed notch					
4 speeds + Auto type	[Low], [Med2], [Med1], [High], [Auto]					
2. Drain pump	<p>2-1. Drain pump control The drain pump turns ON for the specified amount of time when any of the following conditions is met:</p> <ol style="list-style-type: none"> ① ON for 3 minutes after the operation mode is switched from COOL or DRY to another operation mode (FAN). ② ON for 6 minutes after the float switch is submerged in the water when the float switch control judges the sensor is in the water. <p>2-2. Float switch control • Float switch control judges whether the sensor is in the air or in the water by turning the float switch ON/OFF. In the water : Detected that the float switch is ON for 15 seconds. In the air : Detected that the float switch is OFF for 15 seconds.</p>	· Same control as COOL operation				
3. Vane (up/down vane change)	Same as the control performed during the COOL operation, but with no restriction on the vane's downward blow setting					

6-4. HEAT OPERATION

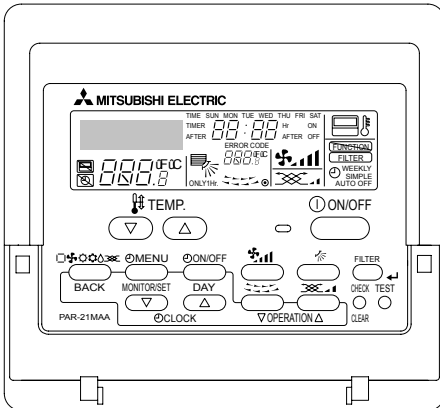

<How to operate>

- ① Press POWER ON/OFF button.
- ② Press the operation MODE button to display HEAT.
- ③ Press the TEMP. button to set the desired temperature.

NOTE: The set temperature changes 2°F when the ∇ or \triangle button is pressed one time. Heating 63 to 83°F.

<Display in HEAT operation>

[DEFROST]

The [DEFROST] symbol is only displayed during the defrost operation.


[STANDBY]

The [STANDBY] symbol is only displayed during the hot adjust mode.


Control modes	Control details	Remarks				
1. Thermoregulating function	1-1. Thermoregulating function (Function to prevent restarting for 3 minutes) <ul style="list-style-type: none"> • Room temperature \leq desired temperature -2°F ...Thermo ON • Room temperature \leq desired temperature ...Thermo OFF 					
2. Fan	<p>By the remote controller setting (switch of 4 speeds+Auto)</p> <table border="1" style="margin-left: 20px;"> <thead> <tr> <th>Type</th> <th>Fan speed notch</th> </tr> </thead> <tbody> <tr> <td>4 speeds + Auto type</td> <td>[Low], [Med2], [Med1], [High], [Auto]</td> </tr> </tbody> </table> <p>When [Auto] is set, fan speed is changed depending on the value of: Desired temperature - Room temperature Give priority to under-mentioned controlled mode</p> <p>2-1. Hot adjust mode 2-2. Residual heat exclusion mode 2-3. Thermo OFF mode (When the compressor off by the thermoregulating) 2-4. Cool air prevention mode (Defrosting mode)</p>	Type	Fan speed notch	4 speeds + Auto type	[Low], [Med2], [Med1], [High], [Auto]	
Type	Fan speed notch					
4 speeds + Auto type	[Low], [Med2], [Med1], [High], [Auto]					
	<p>2-1. Hot adjust mode</p> <p>The fan controller becomes the hot adjuster mode for the following conditions.</p> <ol style="list-style-type: none"> ① When starting the HEAT operation ② When the thermoregulating function changes from OFF to ON. ③ When release the HEAT defrosting operation <div style="text-align: center;"> </div> <p>A: Hot adjust mode starts. B: 5 minutes have passed since the condition A or the indoor liquid pipe temperature turned 95°F or more. C: 2 minutes have passed since the condition B. (Terminating the hot adjust mode)</p>	*1 "STAND BY" will be displayed during the hot adjust mode.				
	<p>2-2. Residual heat exclusion mode</p> <p>When the condition changes the auxiliary heater ON to OFF (thermoregulating or operation stop, etc), the indoor fan operates in [Low] mode for 1 minute.</p>	· This control is same for the model without auxiliary heater.				

To be continued on the next page.

From the preceding page

Control modes	Control details	Remarks
2. Fan	2-3. Thermo OFF mode When the thermoregulating function changes to OFF, the indoor fan operates in [Extra low].	
	2-4. Heat defrosting mode The indoor fan stops.	
3. Drain pump	3-1. Drain pump control The drain pump turns ON for the specified amount of time when any of the following conditions is met: ① ON for 3 minutes after the operation mode is switched from COOL or DRY to another operation mode (FAN). ② ON for 6 minutes after the float switch is submerged in the water when the float switch control judges the sensor is in the water.	
	3-2. Float switch control • Float switch control judges whether the sensor is in the air or in the water by turning the float switch ON/OFF. In the water: Detected that the float switch is ON for 15 seconds. In the air : Detected that the float switch is OFF for 15 seconds.	· Same control as COOL operation
4. Vane control (Up/down vane change)	(1) Initial setting: OFF → HEAT…[last setting] When the last setting is [Swing] … [Downward D] When changing the mode from exception of HEAT to HEAT operation …[Downward D] (2) Vane position: Horizontal →Downward A →Downward B →Downward C→Downward D→Swing→Auto  (3) Restriction of vane position ① The vane is horizontally fixed for the following modes. (The control by the remote controller is temporarily invalidated and control by the unit.) •Thermo OFF •Hot adjust [Extra low] mode •Heat defrost mode	

6-5. AUTO OPERATION [AUTOMATIC COOL/HEAT CHANGE OVER OPERATION]

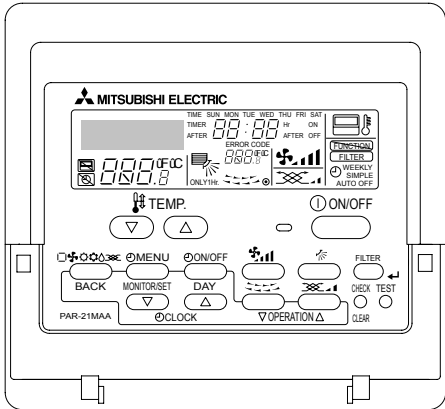

<How to operate>

- ① Press POWER ON/OFF button.
 - ② Press the operation MODE button to display AUTO.
 - ③ Press the TEMP. button to set the desired temperature.
- NOTE:** The set temperature changes 2°F when the ∇ or Δ button is pressed one time. Automatic 67 to 83°F

Control modes	Control details	Remarks
1. Initial value of operation mode	HEAT mode for room temperature < Desired temperature COOL mode for room temperature \geq Desired temperature	
2. Mode change	(1) HEAT mode \rightarrow COOL mode Room temperature \geq Desired temperature + 3°F. or 3 min. has passed (2) COOL mode \rightarrow HEAT mode Room temperature \geq Desired temperature - 3°F. or 3 min. has passed	
3. COOL mode	Same control as cool operation	
4. HEAT mode	Same control as heat operation	

6-6. WHEN UNIT IS STOPPED









Control modes	Control details	Remarks
1. Drain pump	1-1. Drain pump control The drain pump turns ON for the specified amount of time when any of the following conditions is met: ① ON for 3 minutes after the operation mode is switched from COOL or DRY to another operation mode (FAN). ② ON for 6 minutes after the float switch is submerged in the water when the float switch control judges the sensor is in the water.	
	1-2. Float switch control • Float switch control judges whether the sensor is in the air or in the water by turning the float switch ON/OFF. In the water : Detected that the float switch is ON for 15 seconds. In the air : Detected that the float switch is OFF for 15 seconds.	• Same control as COOL operation

7

TROUBLESHOOTING

7-1. HOW TO CHECK THE PARTS

PCFY-P15NKMU-E PCFY-P24NKMU-E PCFY-P30NKMU-E PCFY-P36NKMU-E

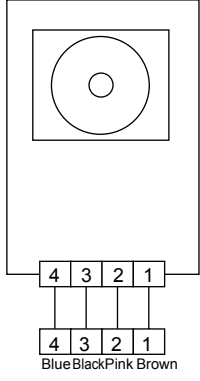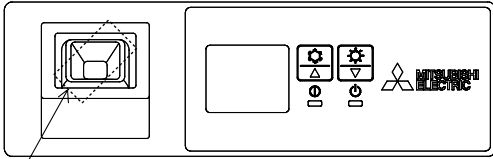Parts name	Check points														
Room temperature thermistor (TH21) Liquid pipe thermistor (TH22) Gas pipe thermistor (TH23)	Disconnect the connector then measure the resistance using a tester. (At the ambient temperature 50°F~86°F) <table border="1" style="margin-left: 20px;"> <tr> <th>Normal</th> <th>Abnormal</th> </tr> <tr> <td>4.3kΩ~9.6kΩ</td> <td>Open or short</td> </tr> </table> (Refer to the next page for a detail.)	Normal	Abnormal	4.3kΩ~9.6kΩ	Open or short										
Normal	Abnormal														
4.3kΩ~9.6kΩ	Open or short														
Vane motor (MV) 	Measure the resistance between the terminals using a tester. (At the ambient temperature of 68°F~86°F) <table border="1" style="margin-left: 20px;"> <tr> <th>Connector</th> <th>Normal</th> <th>Abnormal</th> </tr> <tr> <td>Red - Yellow</td> <td rowspan="4">300Ω</td> <td rowspan="4">Open or short</td> </tr> <tr> <td>Red - Blue</td> </tr> <tr> <td>Red - Orange</td> </tr> <tr> <td>Red - White</td> </tr> </table>	Connector	Normal	Abnormal	Red - Yellow	300Ω	Open or short	Red - Blue	Red - Orange	Red - White					
Connector	Normal	Abnormal													
Red - Yellow	300Ω	Open or short													
Red - Blue															
Red - Orange															
Red - White															
Drain pump (DP) (Option) 	Measure the resistance between the terminals using a tester. (Winding temperature 68°F) <table border="1" style="margin-left: 20px;"> <tr> <th>Normal</th> <th>Abnormal</th> </tr> <tr> <td>290Ω</td> <td>Open or short</td> </tr> </table>	Normal	Abnormal	290Ω	Open or short										
Normal	Abnormal														
290Ω	Open or short														
Drain float switch (FS) (Option) 	Measure the resistance between the terminals using a tester. <table border="1" style="margin-left: 20px;"> <tr> <th>State of moving part</th> <th>Normal</th> <th>Abnormal</th> </tr> <tr> <td>UP</td> <td>Short</td> <td>Other than short</td> </tr> <tr> <td>DOWN</td> <td>Open</td> <td>Other than open</td> </tr> </table> 	State of moving part	Normal	Abnormal	UP	Short	Other than short	DOWN	Open	Other than open					
State of moving part	Normal	Abnormal													
UP	Short	Other than short													
DOWN	Open	Other than open													
i-see sensor (Option) 	<ol style="list-style-type: none"> Turn on the indoor unit with the black plastic tape on the outside of i-see sensor controller board. i-see sensor rotates then pull out the connector of motor for i-see sensor. With electricity being turned on, measure the power voltage between connectors with tester.  <p style="text-align: center;">Black plastic tape</p> <table border="1" style="margin-left: 20px;"> <tr> <th colspan="3">i-see sensor (At the ambient temperature of 50°F~104°F)</th> </tr> <tr> <th>i-see sensor connector</th> <th>Normal</th> <th>Abnormal</th> </tr> <tr> <td>②(-)—④(+)</td> <td>DC 1.857V~ 3.132V</td> <td>Other than the normal</td> </tr> <tr> <td>①(+)—③(-)</td> <td>DC 0.939V~ 1.506V</td> <td>Other than the normal</td> </tr> </table> <p>NOTE : Be careful of handling such a static electricity.</p>	i-see sensor (At the ambient temperature of 50°F~104°F)			i-see sensor connector	Normal	Abnormal	②(-)—④(+)	DC 1.857V~ 3.132V	Other than the normal	①(+)—③(-)	DC 0.939V~ 1.506V	Other than the normal		
i-see sensor (At the ambient temperature of 50°F~104°F)															
i-see sensor connector	Normal	Abnormal													
②(-)—④(+)	DC 1.857V~ 3.132V	Other than the normal													
①(+)—③(-)	DC 0.939V~ 1.506V	Other than the normal													
Vane motor for i-see sensor (Option) 	Measure the resistance between the terminals using a tester. (At the ambient temperature of 68°F~86°F) <table border="1" style="margin-left: 20px;"> <tr> <th>Connector</th> <th>Normal</th> <th>Abnormal</th> </tr> <tr> <td>Red - Yellow</td> <td rowspan="4">250Ω</td> <td rowspan="4">Open or short</td> </tr> <tr> <td>Red - Blue</td> </tr> <tr> <td>Red - Orange</td> </tr> <tr> <td>Red - White</td> </tr> </table>	Connector	Normal	Abnormal	Red - Yellow	250Ω	Open or short	Red - Blue	Red - Orange	Red - White					
Connector	Normal	Abnormal													
Red - Yellow	250Ω	Open or short													
Red - Blue															
Red - Orange															
Red - White															
Linear expansion valve (LEV) 	Disconnect the connector then measure the resistance valve using a tester. <table border="1" style="margin-left: 20px;"> <tr> <th colspan="4">Normal</th> <th>Abnormal</th> </tr> <tr> <td>White-Red</td> <td>Yellow-Brown</td> <td>Orange-Red</td> <td>Blue-Brown</td> <td rowspan="2">Open or short</td> </tr> <tr> <td colspan="4" style="text-align: center;">200Ω ±10%</td> </tr> </table> Refer to 7-1-2.	Normal				Abnormal	White-Red	Yellow-Brown	Orange-Red	Blue-Brown	Open or short	200Ω ±10%			
Normal				Abnormal											
White-Red	Yellow-Brown	Orange-Red	Blue-Brown	Open or short											
200Ω ±10%															

7-1-1. Thermistor

<Thermistor characteristic graph>


Thermistor for lower temperature

Room temperature thermistor (TH21)
Liquid pipe temperature thermistor (TH22)
Gas pipe temperature thermistor (TH23)

Thermistor $R_0=15k\Omega \pm 3\%$
Fixed number of $B=3480 \pm 2\%$

$$R_t = 15 \exp \left\{ 3480 \left(\frac{1}{273 + (t-32)/1.8} - \frac{1}{273} \right) \right\}$$

30°F	15.8kΩ
50°F	9.6kΩ
70°F	6.0kΩ
80°F	4.8kΩ
90°F	3.9kΩ
100°F	3.2kΩ

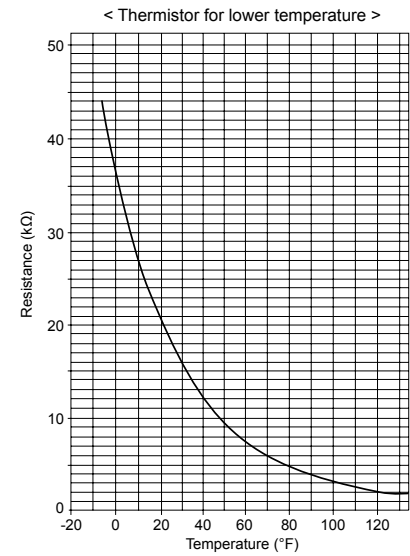


7-1-2. Linear expansion valve

① Operation summary of the linear expansion valve

- Linear expansion valve open/close through stepping motor after receiving the pulse signal from the indoor controller board.
- Valve position can be changed in proportion to the number of pulse signals.

<Connection between the indoor controller board and the linear expansion valve>

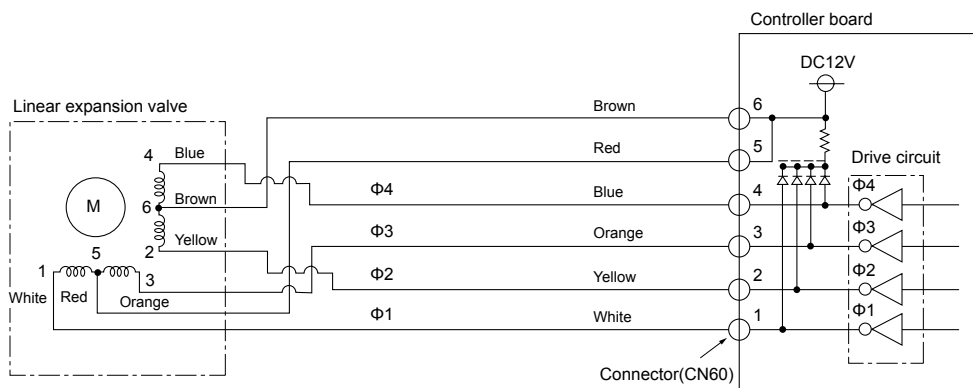

<Output pulse signal and the valve operation>


Output (Phase)	Output			
	1	2	3	4
Φ1	ON	OFF	OFF	ON
Φ2	ON	ON	OFF	OFF
Φ3	OFF	ON	ON	OFF
Φ4	OFF	OFF	ON	ON

Closing a valve : 1 → 2 → 3 → 4 → 1
 Opening a valve : 4 → 3 → 2 → 1 → 4
 The output pulse shifts in above order.



Note:

- When linear expansion valve operation stops, all output phase become OFF.
- At phase interruption or when phase does not shift in order, motor does not rotate smoothly and motor will lock and vibrate.
- When the switch is turned on, 2200 pulse closing valve signal will be sent till it goes to point ㉔ in order to define the valve position.
- When the valve moves smoothly, there is no sound or vibration occurring from the linear expansion valves, however, when the pulse number moves from ㉔ to ㉓ or when the valve is locked, more sound can be heard than in a normal situation.
- Sound can be detected by placing the ear against the screw driver handle while putting the screw driver tip to the linear expansion valve.

② Linear expansion valve operation

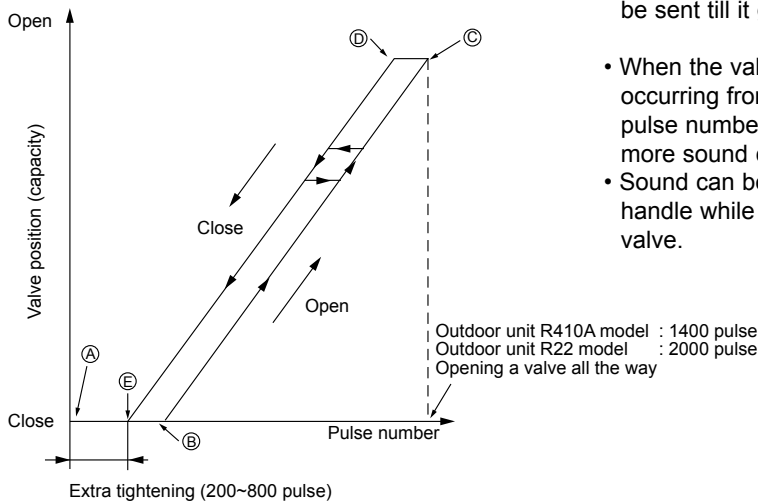

③ Trouble shooting

Symptom	Check points	Countermeasures
Operation circuit failure of the micro processor	Disconnect the connector on the controller board, then connect LED for checking.  When power is turned on, pulse signals will be output for 10 seconds. There must be some defects in the operation circuit if the LED does not light while the signals are output or keeps lighting even after the signals stop.	Exchange the indoor controller board at drive circuit failure.
Linear expansion valve mechanism is locked.	Motor will idle and make a ticking noise when the motor is operated while the linear expansion valve is locked. This ticking sound is the sign of the abnormality.	Exchange the linear expansion valve.
Short or breakage of the motor coil of the linear expansion valve	Measure the resistance between each coil (white-red, yellow-brown, orange-red, blue-brown) using a tester. It is normal if the resistance is in the range of 200Ω ±10%.	Exchange the linear expansion valve.
Valve does not close completely.	To check the linear expansion valve, operate the indoor unit in fan mode and at the same time operate other indoor units in cooling mode, then check the pipe temperature <liquid pipe temperature> of the indoor unit by the outdoor multi controller board operation monitor. During fan operation, linear expansion valve is closed completely and if there is any leaking, detecting temperature of the thermistor will go lower. If the detected temperature is much lower than the temperature indicated in the remote controller, it means the valve is not closed all the way.  It is not necessary to exchange the linear expansion valve, if the leakage is small and not affecting normal operation.	If large amount of refrigerant is leaked, exchange the linear expansion valve.
Wrong connection of the connector or contact failure	Check the color of lead wire and missing terminal of the connector.	Disconnect the connector at the controller board, then check the continuity.

7-1-3. DC Fan motor (fan motor/indoor controller circuit board)


Check method of DC fan motor (fan motor/indoor controller circuit board)

① Notes































- High voltage is applied to the connector (CNMF) for the fan motor. Pay attention to the service.
- Do not pull out the connector (CNMF) for the motor with the power supply on.
(It causes trouble of the indoor controller circuit board and fan motor.)

② Self check

Symptom : The indoor fan cannot turn around.

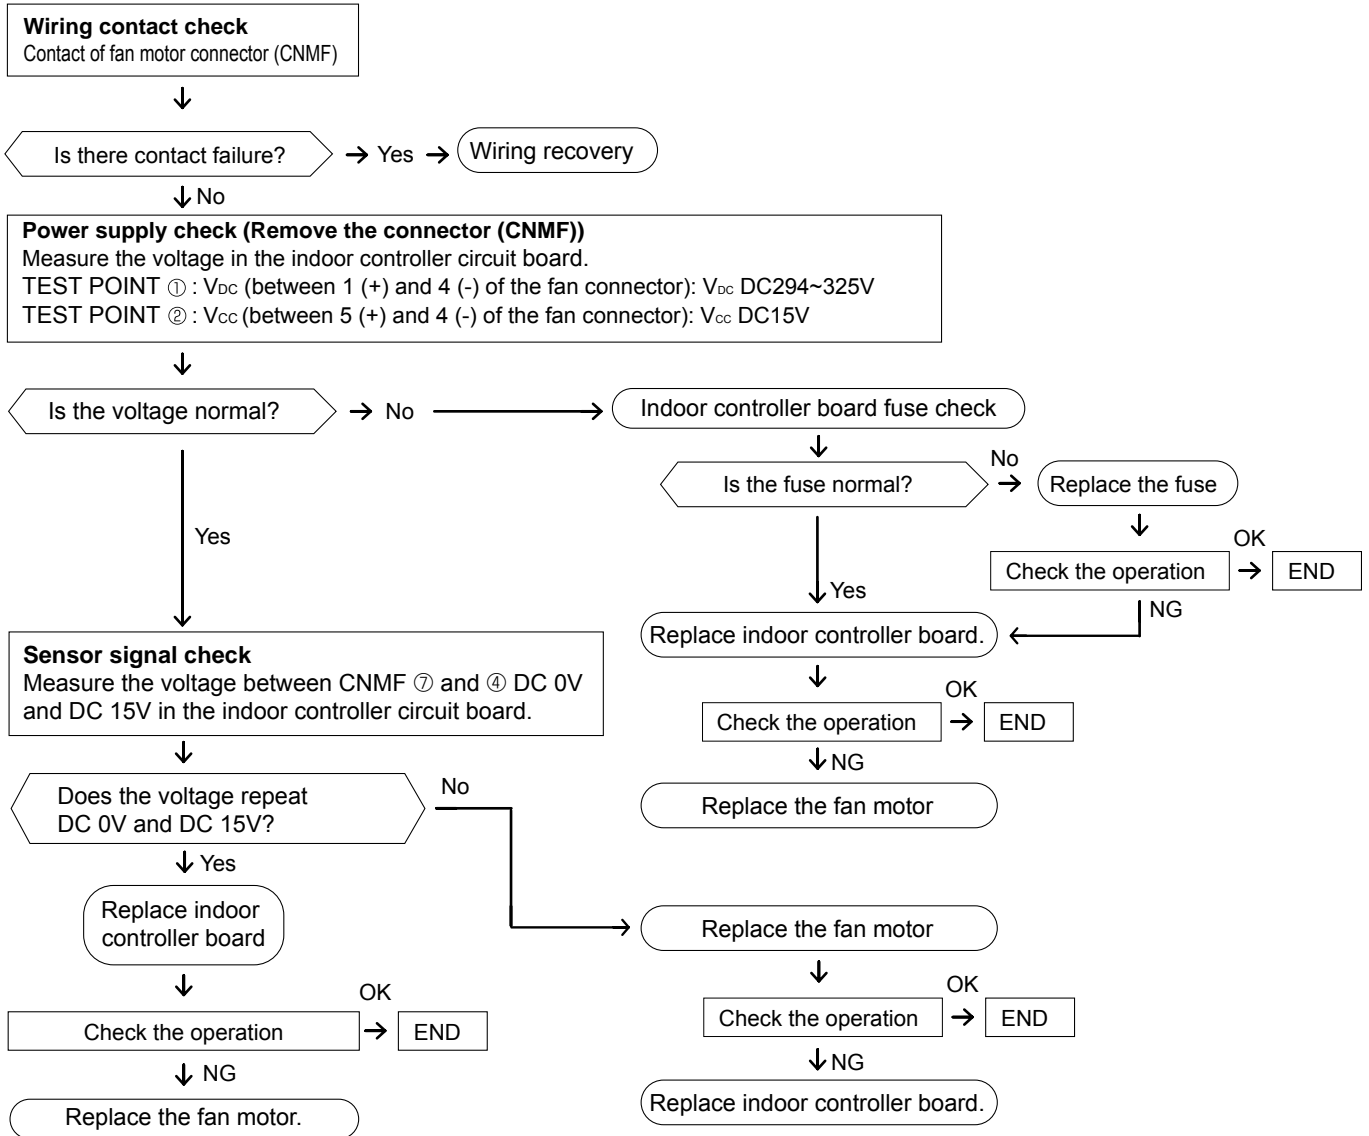










7-2. FUNCTION OF DIP SWITCH

Switch	Pole	Function	Operation by switch		Effective timing	Remarks															
			ON	OFF																	
SW1 Function setting	1	Thermistor <Room temperature detection> position	Built-in remote controller	Indoor unit	Under suspension	<div style="border: 1px solid black; padding: 5px;"> Address board <Initial setting> ON  OFF  Note : ※1 Fan operation at heating mode ※2 Thermo ON operation at heating mode ※3 <table border="1" style="font-size: small;"> <tr> <td>SW1-7</td> <td>SW1-8</td> <td></td> </tr> <tr> <td>OFF</td> <td>OFF</td> <td>Extra low</td> </tr> <tr> <td>ON</td> <td>OFF</td> <td>Low</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>Setting airflow</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>Stop</td> </tr> </table> </div>	SW1-7	SW1-8		OFF	OFF	Extra low	ON	OFF	Low	OFF	ON	Setting airflow	ON	ON	Stop
	SW1-7	SW1-8																			
	OFF	OFF	Extra low																		
	ON	OFF	Low																		
	OFF	ON	Setting airflow																		
	ON	ON	Stop																		
	2	Filter clogging detection	Provided	Not provided																	
	3	Filter cleaning	2,500 hr	100 hr																	
	4	Fresh air intake	Effective	Not effective																	
	5	Switching remote display	Thermo ON signal display	Indicating fan operation ON/OFF																	
6	Humidifier control	Always operated while the heat in ON※1	Operated depends on the condition ※2																		
7	Airflow set in case of Heat thermo OFF at heating mode	Low ※3	Extra low ※3																		
8		Setting air flow ※3	Depends on SW1-7																		
9	Auto restart function	Effective	Not effective																		
10	Power ON/OFF by breaker	Effective	Not effective																		
SW2 Capacity code setting	1~6	<table border="1" style="font-size: small;"> <tr> <th>Capacity</th> <th>SW 2</th> <th>Capacity</th> <th>SW 2</th> </tr> <tr> <td>P15</td> <td>ON  OFF </td> <td>P24</td> <td>ON  OFF </td> </tr> <tr> <td>P30</td> <td>ON  OFF </td> <td>P36</td> <td>ON  OFF </td> </tr> </table>	Capacity	SW 2	Capacity	SW 2	P15	ON  OFF 	P24	ON  OFF 	P30	ON  OFF 	P36	ON  OFF 			<div style="border: 1px solid black; padding: 5px;"> Indoor controller board Set while the unit is off. <Initial setting> Set for each capacity. </div>				
		Capacity	SW 2	Capacity	SW 2																
		P15	ON  OFF 	P24	ON  OFF 																
		P30	ON  OFF 	P36	ON  OFF 																
SW3 Function setting	1	Heat pump/Cooling only	Cooling only	Heat pump	Under suspension	<div style="border: 1px solid black; padding: 5px;"> Indoor controller board Set while the unit is off. <Initial setting> ON  OFF  Note : ※4 SW3-5 ※5 Please do not use SW-3-9,10. SW9 setting P15: ON P24,P30,P36: OFF ※6 Each angle can be used only 1 hour when fan speed setting Low and Middle 1,2 </div>															
	2	Louver	Available	Not available																	
	3	Vane	Available	Not available																	
	4	Vane swing function in heating (wave-flow)	Available	Not available																	
	5	Vane horizontal angle	Second setting ※4	First setting ※4																	
	6	Vane cooling limit angle setting	Horizontal	Setting A,B,C,D																	
	7	Changing the opening of linear expansion valve	Effective	Not effective																	
	8	4-deg up (Heating mode)	Not effective	Effective																	
	9	Superheat setting temperature ※5	—	—																	
	10	Sub cool setting temperature ※5	—	—																	
SW4 Model Selection	1~5	In case of replacing the indoor controller board, make sure to set the switch to the initial setting, which is shown below. ON  OFF 			Before power supply ON	Indoor controller board															




Note : ※4 SW3-5

SW3-5	Vane setting	Initial setting	Setting	Vane position
OFF	Set up ①	●	Standard	Standard
ON	Set up ②		Less draft	Upward position than the standard



Switch	Pole	Operation by switch	Effective timing	Remarks																
SWA Ceiling height selector	1~3	<p>(High ceiling) 3</p> <p>(Standard) 2</p> <p>(Silent) 1</p>  <p>* Ceiling height can be changed depending on SWA setting.</p> <table border="1"> <thead> <tr> <th>SWA</th> <th>①</th> <th>②</th> <th>③</th> </tr> <tr> <td></td> <td>Silent</td> <td>Standard</td> <td>High ceiling</td> </tr> </thead> <tbody> <tr> <td>P15, P24</td> <td>8.2ft.(2.5m)</td> <td>8.9ft.(2.7m)</td> <td>11.5ft.(3.5m)</td> </tr> <tr> <td>P30, P36</td> <td>8.5ft.(2.6m)</td> <td>9.8ft.(3.0m)</td> <td>13.8ft.(4.2m)</td> </tr> </tbody> </table>	SWA	①	②	③		Silent	Standard	High ceiling	P15, P24	8.2ft.(2.5m)	8.9ft.(2.7m)	11.5ft.(3.5m)	P30, P36	8.5ft.(2.6m)	9.8ft.(3.0m)	13.8ft.(4.2m)	Under operation or suspension	<p>Address board</p> <p><Initial setting></p> 
SWA	①	②	③																	
	Silent	Standard	High ceiling																	
P15, P24	8.2ft.(2.5m)	8.9ft.(2.7m)	11.5ft.(3.5m)																	
P30, P36	8.5ft.(2.6m)	9.8ft.(3.0m)	13.8ft.(4.2m)																	
SWC Option selector	2	<p>② オプ (Option)</p> <p>① 標 (Standard)</p>  <p>* In this model it is not necessary to change SWC to the option side.</p>	<p>Address board</p> <p><Initial setting></p> <p>② オプ</p> <p>① 標</p> 																	
SW11 1s digit address setting	Rotary switch	<p>SW12 SW11</p>  <p>How to set address</p> <p>Example : If address is "3", remain SW12 (for over 10) at "0", and match SW11 (for 1 to 9) with "3".</p>	Before power supply ON	<p>Address board</p> <p>Address can be set while the unit is stopped.</p> <p><Initial setting></p> 																
SW12 10ths digit address setting				<p>Address board</p> <p><Initial setting></p> 																
SW14 Branch No. setting	Rotary switch	<p>SW14</p>  <p>How to set branch number SW14 (Series R2 only)</p> <p>Match the indoor unit's refrigerant pipe with the BC controller's end connection number</p> <p>Remain other than series R2 at "0".</p>		<p>Address board</p> <p><Initial setting></p> 																

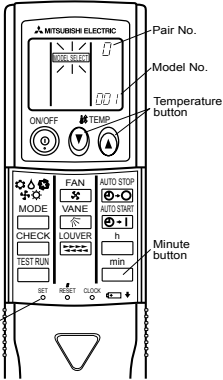


Switch	Pole	Operation by switch	Effective timing	Remarks																											
J41, J42 Wireless remote controller Pair No.	Jumper	<ul style="list-style-type: none"> To operate each indoor unit by each remote controller when installed 2 indoor units or more are near, Pair No. setting is necessary. <ol style="list-style-type: none"> Pair No. setting is available with the 4 patterns (Setting patterns A to D). Make setting for J41, J42 of indoor controller board and the Pair No. of wireless remote controller. You may not set it when operating it by 1 remote controller. <ol style="list-style-type: none"> Setting for indoor unit Jumper wire J41, J42 on the indoor controller board are cut according to the table below. Wireless remote controller pair number: Setting operation <ol style="list-style-type: none"> Press the SET button (using a pointed implement). Check that the remote controller's display has stopped before continuing. MODEL SELECT flashes, and the model No. (3 digits) appears (steadily-lit). Press the MINUTE button twice. The pair number appears flashing. Press the temperature (TEMP) buttons to select the pair number to set. Press the SET button (using a pointed implement). The set pair number is displayed (steadily-lit) for 3 seconds, then disappears. <table border="1" data-bbox="277 808 976 1010"> <thead> <tr> <th rowspan="2">Setting pattern</th> <th colspan="2">Indoor controller Jumper wire</th> <th rowspan="2">Pair No. of wireless remote controller *</th> <th rowspan="2"></th> </tr> <tr> <th>J41</th> <th>J42</th> </tr> </thead> <tbody> <tr> <td>A</td> <td>—</td> <td>—</td> <td>0</td> <td>Factory setting</td> </tr> <tr> <td>B</td> <td>Cut</td> <td>—</td> <td>1</td> <td>—</td> </tr> <tr> <td>C</td> <td>—</td> <td>Cut</td> <td>2</td> <td>—</td> </tr> <tr> <td>D</td> <td>Cut</td> <td>Cut</td> <td>3</td> <td>—</td> </tr> </tbody> </table> <p data-bbox="277 1014 831 1037">* Pair No.4-9 of wireless remote controller is setting pattern D.</p>	Setting pattern	Indoor controller Jumper wire		Pair No. of wireless remote controller *		J41	J42	A	—	—	0	Factory setting	B	Cut	—	1	—	C	—	Cut	2	—	D	Cut	Cut	3	—	Under operation or suspension	<p data-bbox="1203 310 1374 369"><Initial setting> Pattern A</p> 
Setting pattern	Indoor controller Jumper wire			Pair No. of wireless remote controller *																											
	J41	J42																													
A	—	—	0	Factory setting																											
B	Cut	—	1	—																											
C	—	Cut	2	—																											
D	Cut	Cut	3	—																											
SWE Test run for Drain pump (Option)	Connector	<p data-bbox="252 1171 935 1224">Drain pump and fan are activated simultaneously after the connector SWE is set to ON and turn on the power.</p>  <p data-bbox="252 1356 730 1381">The connector SWE is set to OFF after test run.</p>	Under operation	<p data-bbox="1203 1188 1374 1220"><Initial setting></p> 																											


7-3. TEST POINT DIAGRAM

7-3-1. Indoor controller board

PCFY-P15NKMU-E PCFY-P24NKMU-E PCFY-P30NKMU-E PCFY-P36NKMU-E

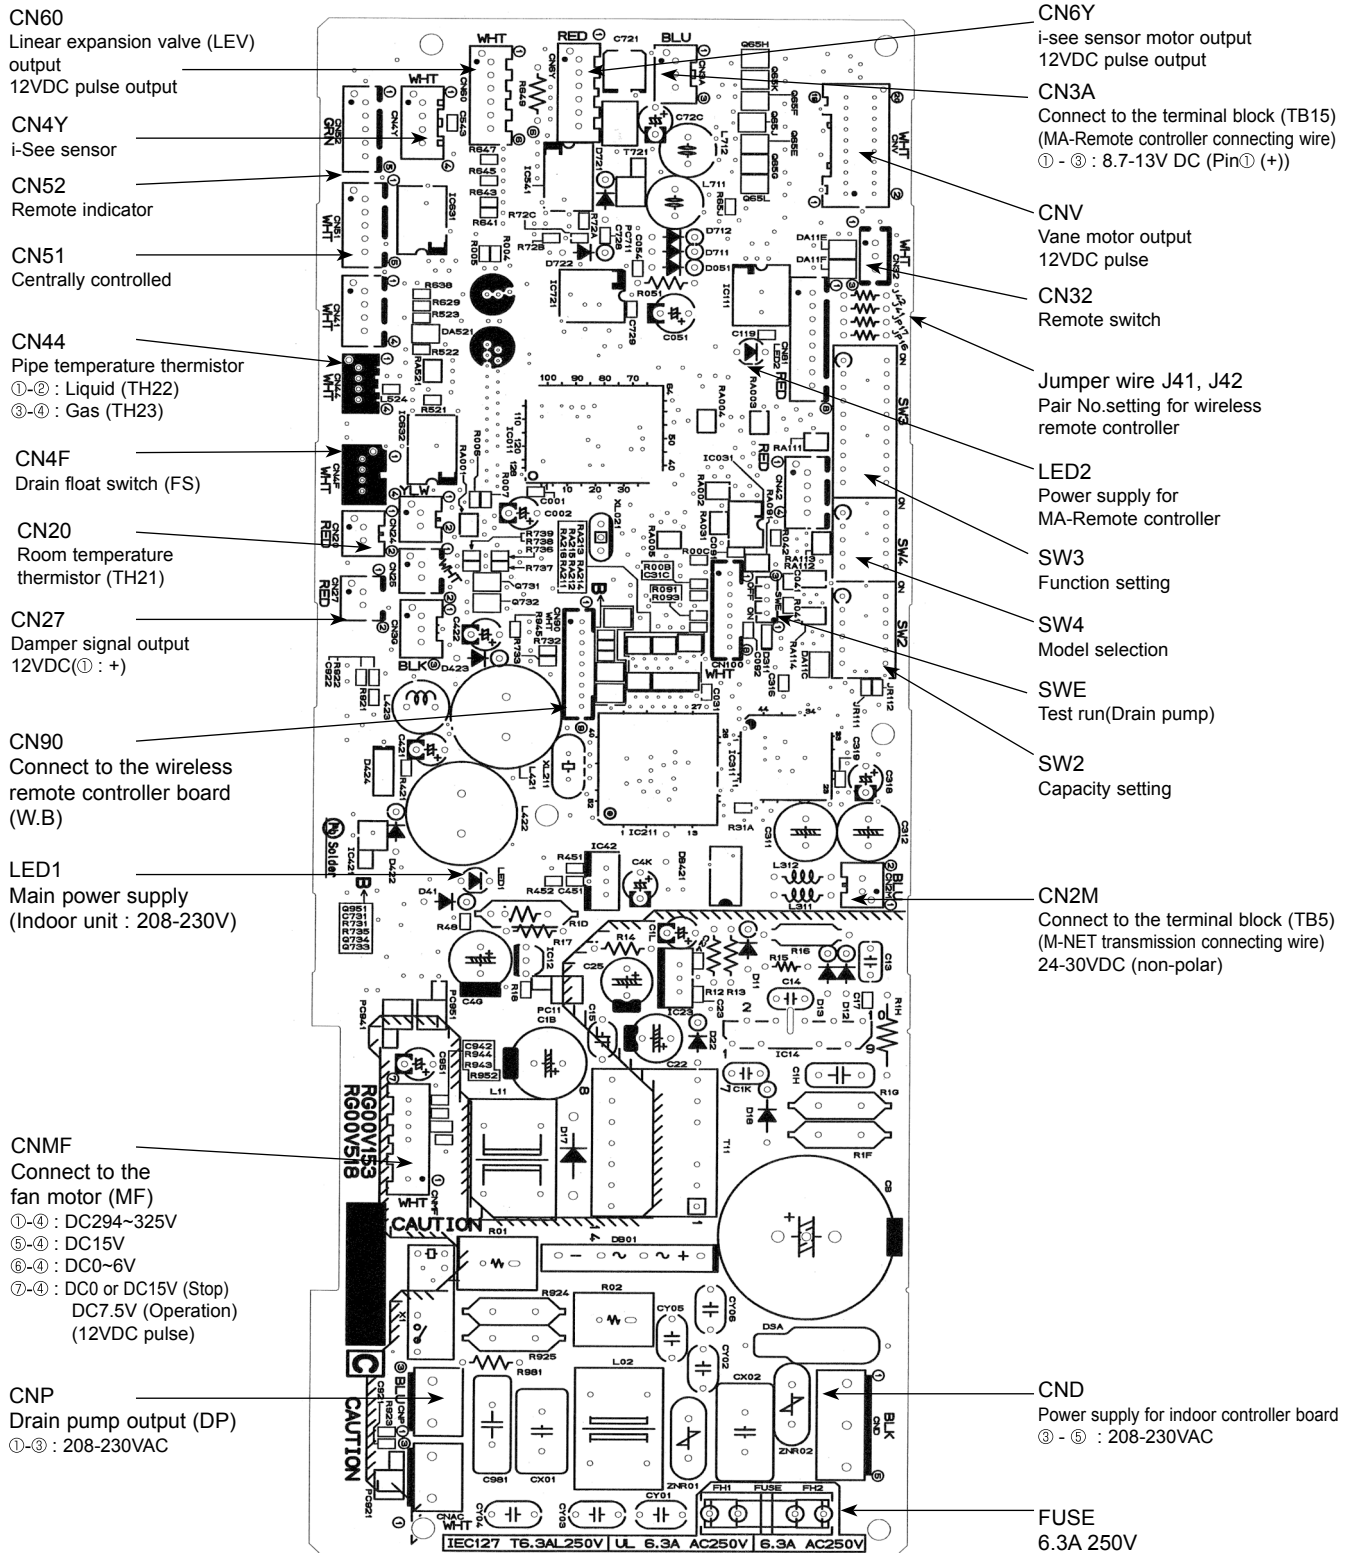






7-3-2. Address board
 PCFY-P15NKMU-E
 PCFY-P24NKMU-E
 PCFY-P30NKMU-E
 PCFY-P36NKMU-E

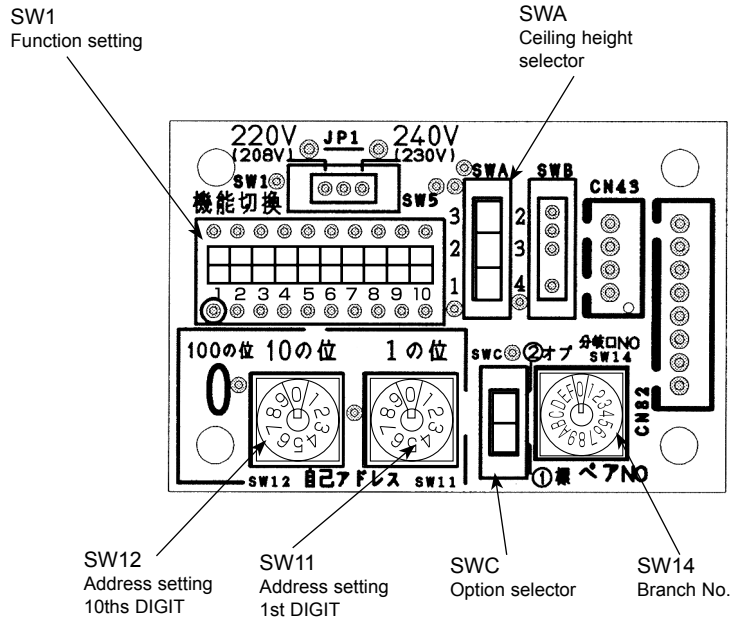

PCFY-P15NKMU-E PCFY-P24NKUM-E
PCFY-P30NKMU-E PCFY-P36NKMU-E

Be careful when removing heavy parts.

(Photo: PCFY-P36NKMU-E)

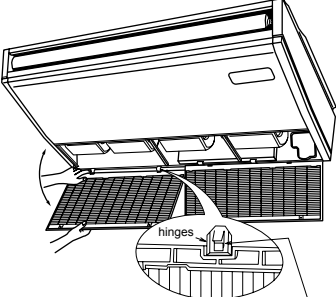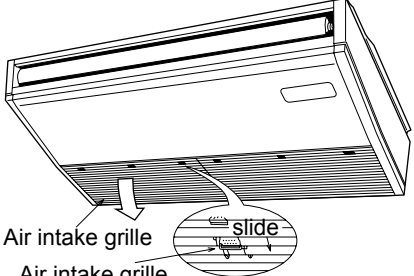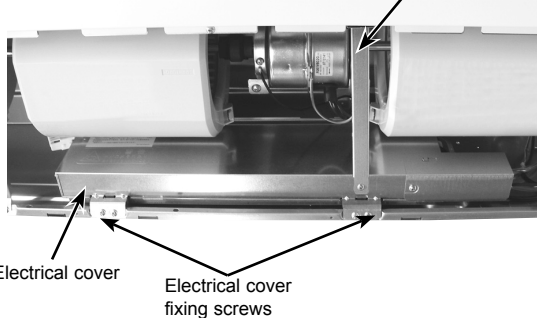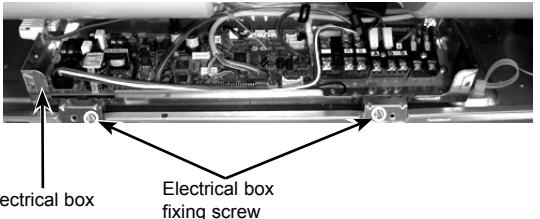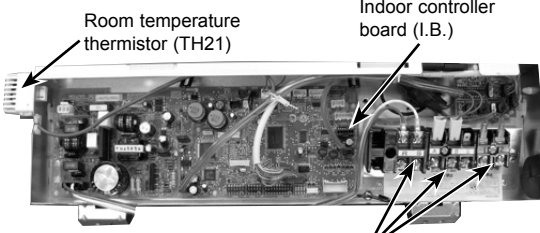OPERATING PROCEDURE	PHOTOS & ILLUSTRATIONS
<p>1. Removing the air intake grille</p> <p>(1) Slide the air intake grille holding knobs (at 2 or 3 locations) to the rear to open the air intake grille. (See Figure 1)</p> <p>(2) While the air intake grille left open, push the stoppers on the rear hinges (at 2 or 3 locations) to pull out the air intake grille. (See Figure 2)</p> <p>Figure 2</p>  <p>Pull out the air intake grille</p>	<p>Figure 1</p>  <p>Air intake grille Air intake grille holding knobs</p>
<p>2. Removing the indoor controller board and the electrical box</p> <p>(1) Remove the air intake grille. (See Figure 1,2)</p> <p>(2) Remove the screw from the beam and remove the beam. (See Photo 1)</p> <p>(3) Remove 2 screws from the electrical cover, and remove the electrical cover.</p> <p>(4) Remove 2 screws from the electrical box and pull the electrical box downward. Temporarily secure the electrical box using 2 hooks in the back of electrical box.</p> <p>(5) Disconnect the connectors on the indoor controller board.</p> <p>[Removing the electrical box]</p> <p>(6) Disconnect the wires from the terminal blocks and pull out the electrical box. (See Photo 2)</p> <p>[Removing the indoor controller board]</p> <p>(6) Remove the 6 supports from the indoor controller board and remove the indoor controller board. (See Photo 3)</p>	<p>Photo 1</p>  <p>Beam Electrical cover Electrical cover fixing screws</p> <p>Photo 2</p>  <p>Electrical box Electrical box fixing screw</p> <p>Photo 3</p>  <p>Room temperature thermistor (TH21) Indoor controller board (I.B.) Terminal blocks (TB2),(TB5),(TB15)</p>


OPERATING PROCEDURE

PHOTOS & ILLUSTRATIONS

3. Removing the room temperature thermistor (TH21)

- (1) Remove the air intake grille. (See Figure 1,2)
- (2) Remove the screw from the beam and remove the beam. (See Photo 1)
- (3) Remove 2 screws from the electrical cover, and remove the electrical cover.
- (4) Remove 2 screws from the electrical box and pull the electrical box downward. Temporarily secure the electrical box using 2 hooks in the back of electrical box.
- (5) Disconnect the connector CN20 (red) from the indoor controller board.
- (6) Remove the sensor holder from the electrical box and remove the thermistor from the holder.

Photo 4

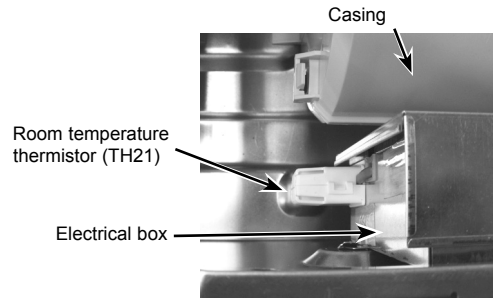

4. Removing the fan motor and right side fan

- (1) Remove the air intake grille. (See Figure 1,2)
- (2) Remove the screw from the beam and remove the beam. (See Photo 1)
- (3) Remove 2 screws from the electrical cover, and remove the electrical cover.
- (4) Remove 2 screws from the electrical box and pull the electrical box downward.
- (5) Temporarily secure the electrical box using 2 hooks in the back of electrical box.
- (6) Remove the lower casing while pressing the 4 catches of the casing (right side of the fan motor). (See Photo 6)
- (7) Loosen the 2 set screws (2 hexagon set screws) of connecting joint and slide the fan motor to the left. (See Photo 5)
- (8) Remove the screw for motor earth wire. (See Photo 5)
- (9) Remove the motor piece (left and right, each 1 screw). (See Photo 5)
- (10) Remove the fan motor and right side fan together.
- (11) Loosen the set screw (hexagon set screw) of fan and remove the fan from the shaft. (See Photo 7,8)

Photo 5

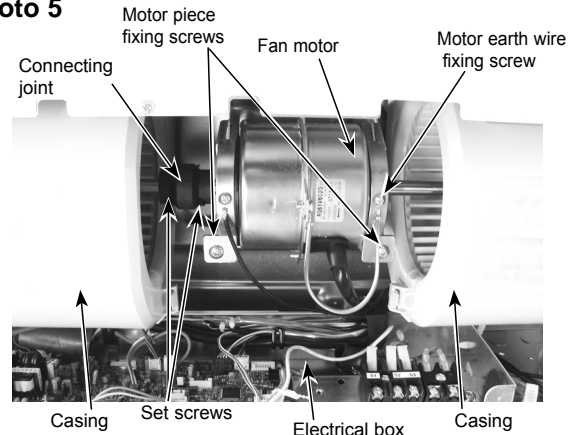


Photo 6

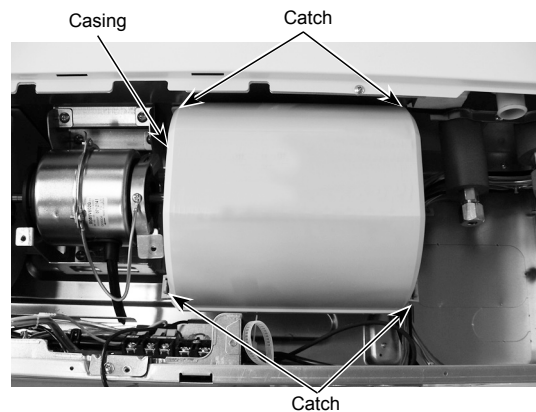


Photo 8


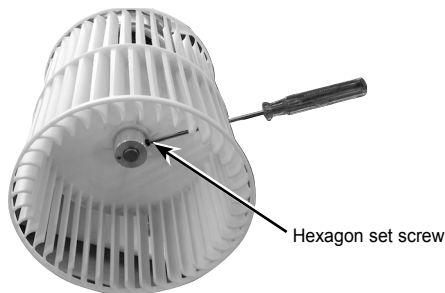


Photo 7

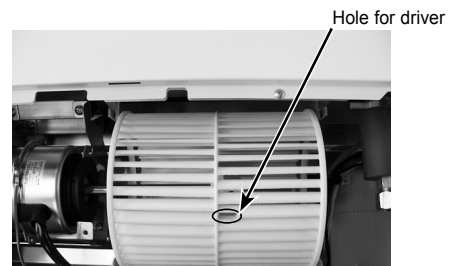


OPERATING PROCEDURE

5. Removing the fan (3 connection)

- (1) Remove the air intake grille. (See Figure 1,2)
- (2) Remove the screw from the beam and remove the beam. (See Photo 1)
- (3) Remove 2 screws from the electrical cover, and remove the electrical cover.
- (4) Remove 2 screws from the electrical box and pull the electrical box downward. Temporarily secure the electrical box using 2 hooks in the back of electrical box.
- (5) Remove 2 screws from the left side beam and remove the beam. (See Photo 9)
- (6) Loosen 2 set screws (2 hexagon set screws) of connecting joint. (See Photo 5)
- (7) Remove 3 lower casings while pressing each 4 catches of the casing. (See Photo 6)
- (8) Remove the 4 screws from the bearing support. (See Photo 10)
- (9) Slide the connecting joint to the left and remove the fans and shaft together. (See Photo 11)
- (10) Remove the fan from the shaft. (See Photo 7,8)

Photo 11

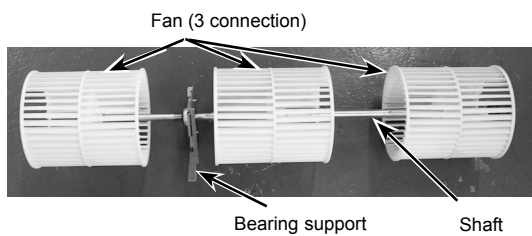

6. Removing the side panel

- (1) Remove the air intake grille. (See Figure 1,2)
- (2) Remove the screw from the side panel, and remove the side panel by sliding the panel to the front.

PHOTOS & ILLUSTRATIONS

Photo 9

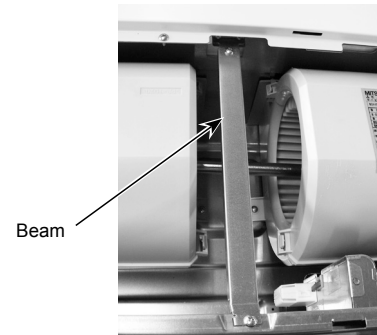


Photo 10


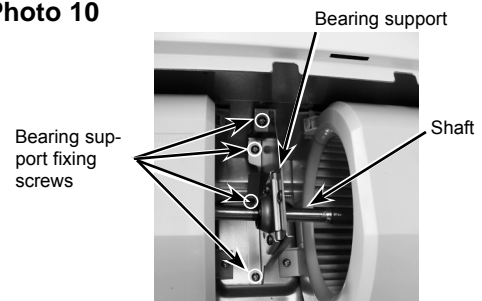


Figure 3

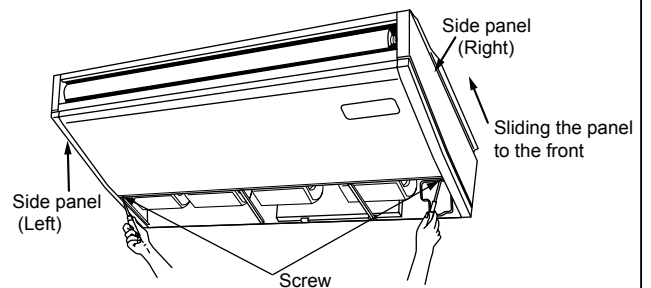


OPERATING PROCEDURE

PHOTOS & ILLUSTRATIONS

7. Removing the vane motor

- (1) Remove the air intake grille. (See Figure 1,2)
- (2) Remove the right side panel. (See Figure 3)
- (3) Remove the connector of vane motor.
- (4) Remove 2 screws of vane motor cover , then remove vane motor.


Photo 12

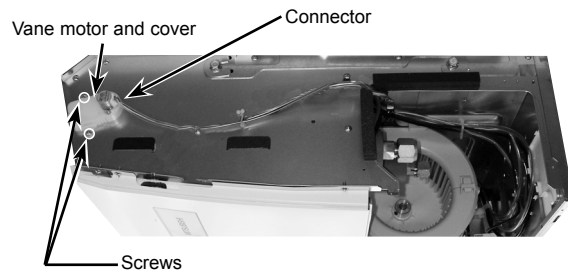

8. Removing the under panel

- (1) Remove the air intake grille. (See Figure 1,2)
- (2) Remove the left and right side panels. (See Figure 3)
- (3) Remove the beam. (See Photo 1)
- (4) Remove the electrical cover. (See Photo 1)
- (5) Pull the electrical box downward. (See Photo 2)
- (6) (Wireless remote controller receiver type only)
Disconnect the connector CNB from the PCB for wireless remote controller and remove the clamp and strap for wires.
- (7) Remove 8 screws from the under panel.
- (8) Move the under panel forward by about 7/16in. (10mm) and remove the under panel.

Photo 13

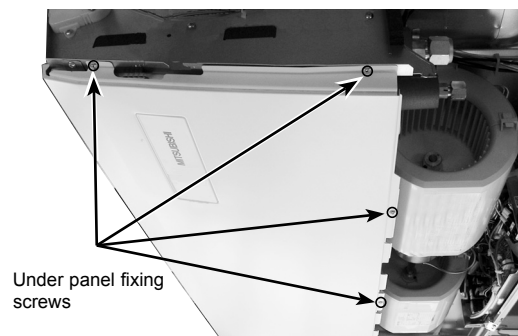

9. Removing the drain pan

- (1) Remove the air intake grille. (See Figure 1,2)
- (2) Remove the side panel (right and left). (See Figure 3)
- (3) Remove the under panel. (See Photo 13)
Remove the screws of the right and left side drain pan. (See Photo 14)
- (4) Remove 2 insulation in centre of the drain pan, and after removing 2 screws with washer, remove the drain pan. (See Photo 15,16)

(Note)

Please be aware that there might be some drainage left in the drain pan when you remove the drain pan.

Photo 14

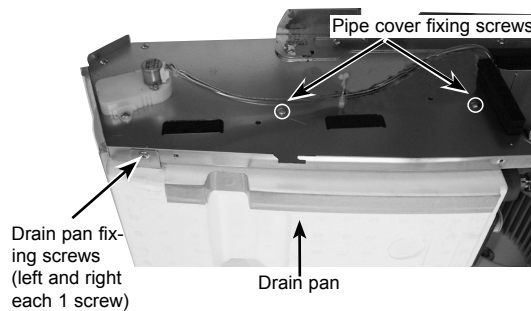


Photo 15


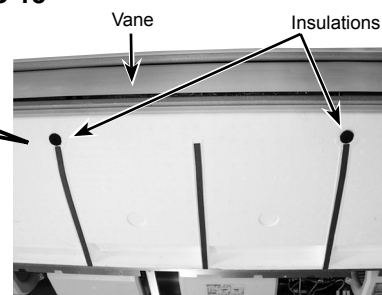


Photo 16

Screw with washer
(2 locations)





OPERATING PROCEDURE

PHOTOS & ILLUSTRATIONS

10. Removing the pipe thermistors/Liquid (TH22) and Gas (TH23)

- (1) Remove the air intake grille. (See Figure 1,2)
- (2) Remove the left and right side panels. (See Figure 3)
- (3) Remove the under panel. (See Photo 13)
- (4) Remove the drain pan. (See Photo 14, 15, 16)
- (5) Disconnect the connector CN44 (white) from the indoor controller board.
- (6) Remove 6 screws from the pipe cover and remove the pipe cover. (See Photo 14, 17)
- (7) Remove the fastener for wires and remove the thermistors (liquid and gas) from each holder. (See Photo 18)

Photo 17


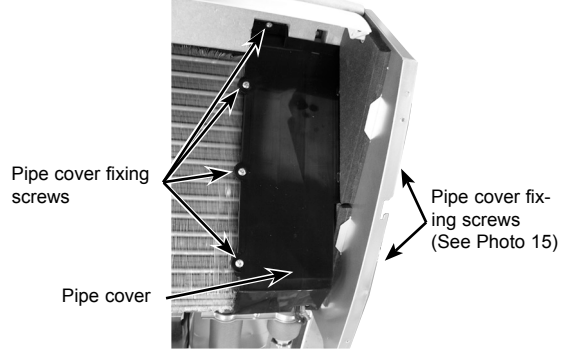



Photo 18

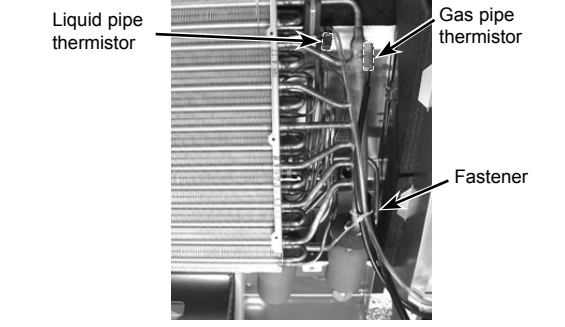

11. Removing the guide vane

- (1) Remove the intake grille. (See Figure 1,2)
- (2) Remove the side panel (right and left). (See Figure 3)
- (3) Remove the under panel. (See Photo 13)
- (4) Remove the drain pan. (See Photo 14, 15,16)
- (5) Remove the screw from the guide vane, then remove the guide vane.


Photo 19

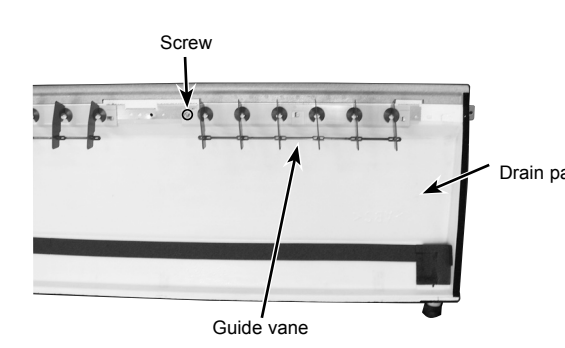

12. Removing the Auto vane

- (1) Remove the intake grille. (See Figure 1,2)
- (2) Remove the right side panel. (See Figure 3)
- (3) Remove the vane motor and cover. (See Photo 12)
- (4) Slide the auto vane to the vane motor side.
- (5) Remove 2 axes from each vane support pushing the vane support to the vane sleeve side.

Photo 20

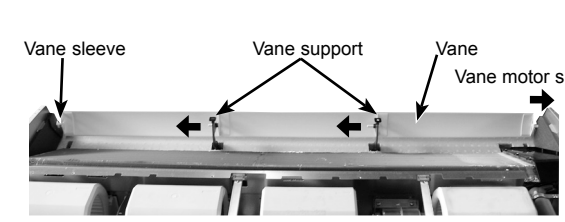

OPERATING PROCEDURE

13. Removing the heat exchanger and LEV

- (1) Remove the air intake grille. (See Figure 1,2)
- (2) Remove the beam. (See Photo 1)
- (3) Remove the electrical cover. (See Photo 1)
- (4) Pull the electrical box downward. (See Photo 2)
- (5) Disconnect the connector CN60 (white) from the indoor controller board.
- (6) Remove the left and right side panels. (See Figure 3)
- (7) Remove the under panel. (See Photo 13)
- (8) Remove the drain pan. (See Photo 14,15,16)
- (9) Remove the pipe cover. (See Photo 17)
- (10) Remove the pipe thermistors (TH22 and TH23) from each holder. (See Photo 18)
- (11) Remove the pipe band fixing screw and remove the pipe band. (See Photo 21)
- (12) Remove 2 screws from the heat exchanger and remove the heat exchanger with LEV.

PHOTOS & ILLUSTRATIONS

Photo 21


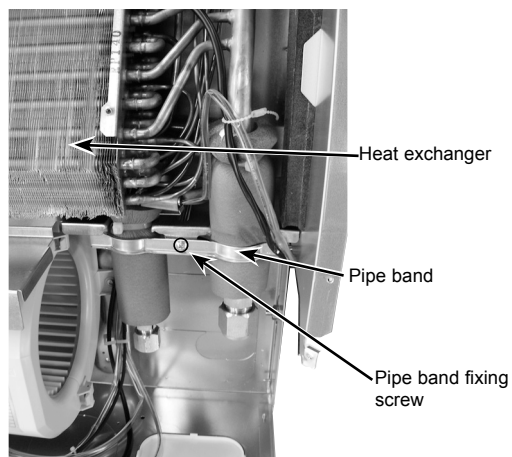


Photo 22





CITY MULTI™

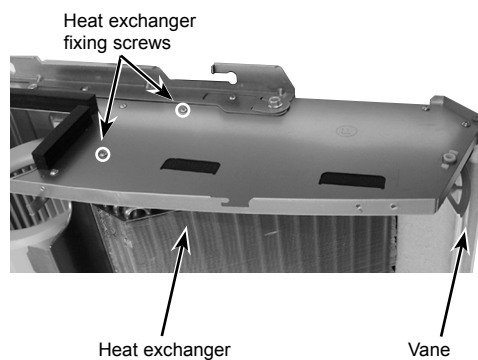

HEAD OFFICE : TOKYO BLDG., 2-7-3, MARUNOUCHI, CHIYODA-KU TOKYO 100-8310, JAPAN

PARTS CATALOG

CITY MULTI Series Ceiling Suspended R410A / R22

Indoor unit
[Model names]

[Service Ref.]

PCFY-P15NKMU-E

PCFY-P15NKMU-E

PCFY-P24NKMU-E

PCFY-P24NKMU-E

PCFY-P30NKMU-E


PCFY-P30NKMU-E

PCFY-P36NKMU-E

PCFY-P36NKMU-E

Note:

- RoHS compliant products have <G> mark on the spec name plate.

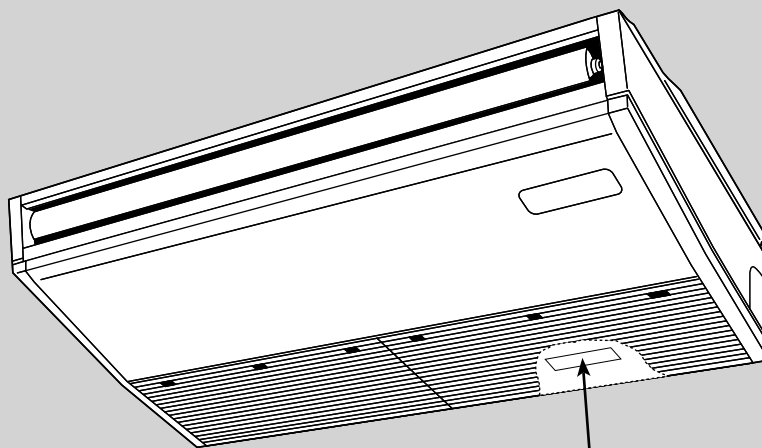

INDOOR UNIT

Model name
indication

CONTENTS

1. RoHS PARTS LIST2
2. OPTIONAL PARTS7

SERVICE MANUAL (OCH450)


STRUCTURAL AND FUNCTIONAL PARTS (1)

PCFY-P15NKMU-E

PCFY-P24NKMU-E

PCFY-P30NKMU-E

PCFY-P36NKMU-E

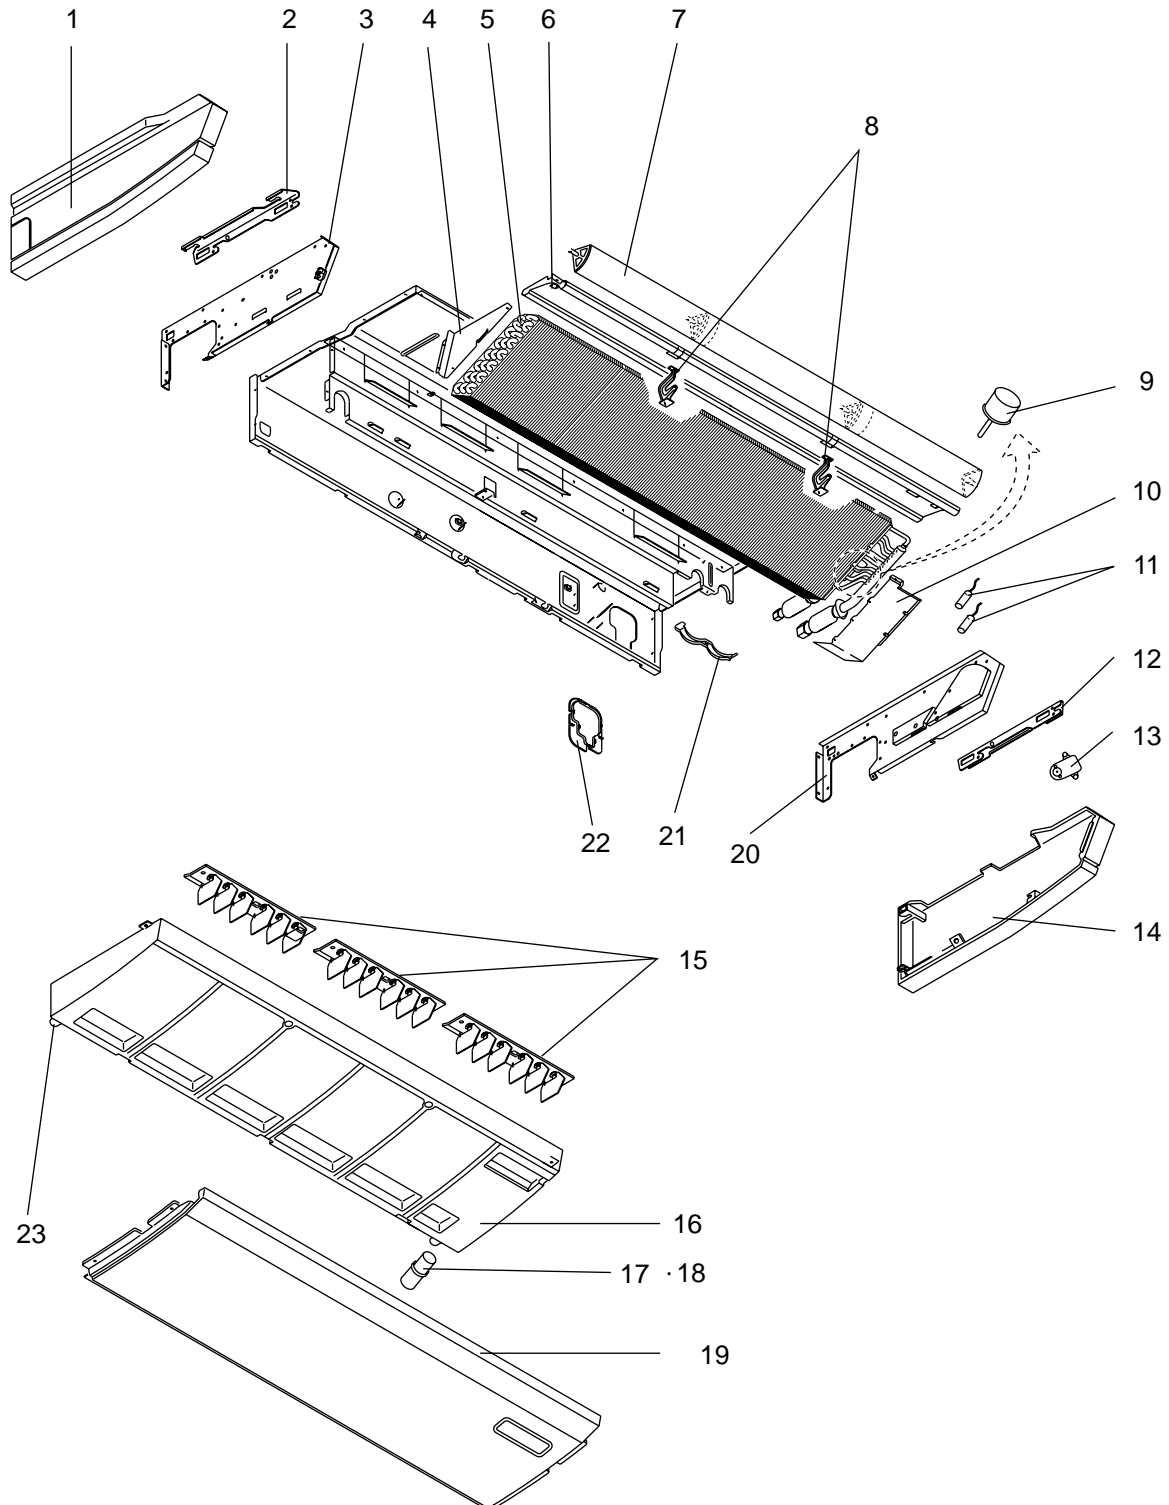



No.	RCHS	Part No.	Part Name	Specification	Q'ty/set				Remarks (Drawing No.)	Wiring Diagram Symbol	Recom- mended Q'ty
					PCFY-P•NKMU-E						
					15	24	30	36			
1	G	R01 E26 662	SIDE PANEL-L		1	1	1	1			
2	G	R01 E06 809	LEG-L		1	1	1	1			
3	G	R01 E02 666	SIDE PLATE-L		1	1	1	1			
4	G	R01 E05 615	COIL SUPPORT-H		1	1	1	1			
5	G	R01 N55 480	HEAT EXCHANGER		1						
	G	R01 N56 480	HEAT EXCHANGER			1					
	G	R01 N58 480	HEAT EXCHANGER				1				
	G	R01 N59 480	HEAT EXCHANGER					1			
6	G	T7W E13 651	FRONT PANEL		1						
	G	T7W E14 651	FRONT PANEL			1					
	G	T7W E15 651	FRONT PANEL				1	1			
7	G	R01 E28 002	AUTO VANE		1						
	G	R01 E29 002	AUTO VANE			1					
	G	R01 E30 002	AUTO VANE				1	1			
8	G	R01 E04 033	VANE SUPPORT		1	2	2	2			
9	G	R01 H04 401	EXPANSION VALVE		1	1				LEV	
	G	R01 H24 401	EXPANSION VALVE				1	1		LEV	
10	G	R01 E04 615	COIL SUPPORT		1	1	1	1			
11	G	T7W E61 202	THERMISTOR (PIPE)		1	1	1	1		TH22/23	
12	G	R01 E06 808	LEG-R		1	1	1	1			
13	G	R01 E25 223	VANE MOTOR ASSY		1	1	1	1		MV	
14	G	R01 E45 661	SIDE PANEL-R		1	1	1	1			
15	G	R01 E03 085	GUIDE VANE		2	3					
	G	R01 E04 085	GUIDE VANE				3	3			
16	G	T7W E35 529	DRAIN PAN		1						
	G	R01 E43 529	DRAIN PAN			1					
	G	R01 E44 529	DRAIN PAN				1	1			
17	G	R01 18J 523	JOINT SOCKET		1	1	1	1			
18	G	R01 18J 072	DRAIN HOSE COVER		1	1	1	1			
19	G	R01 E03 669	UNDER PANEL		1						
	G	R01 E04 669	UNDER PANEL			1					
	G	R01 E05 669	UNDER PANEL				1	1			
20	G	T7W E05 665	SIDE PLATE-R		1	1	1	1			
21	G	R01 E02 126	PIPE BAND		1	1	1	1			
22	G	R01 E00 053	PIPE HOLE COVER		1	1	1	1			
23	G	R01 18J 524	DRAIN PLUG		1	1	1	1			


STRUCTURAL AND FUNCTIONAL PARTS (2)

PCFY-P15NKMU-E

PCFY-P24NKMU-E

PCFY-P30NKMU-E

PCFY-P36NKMU-E

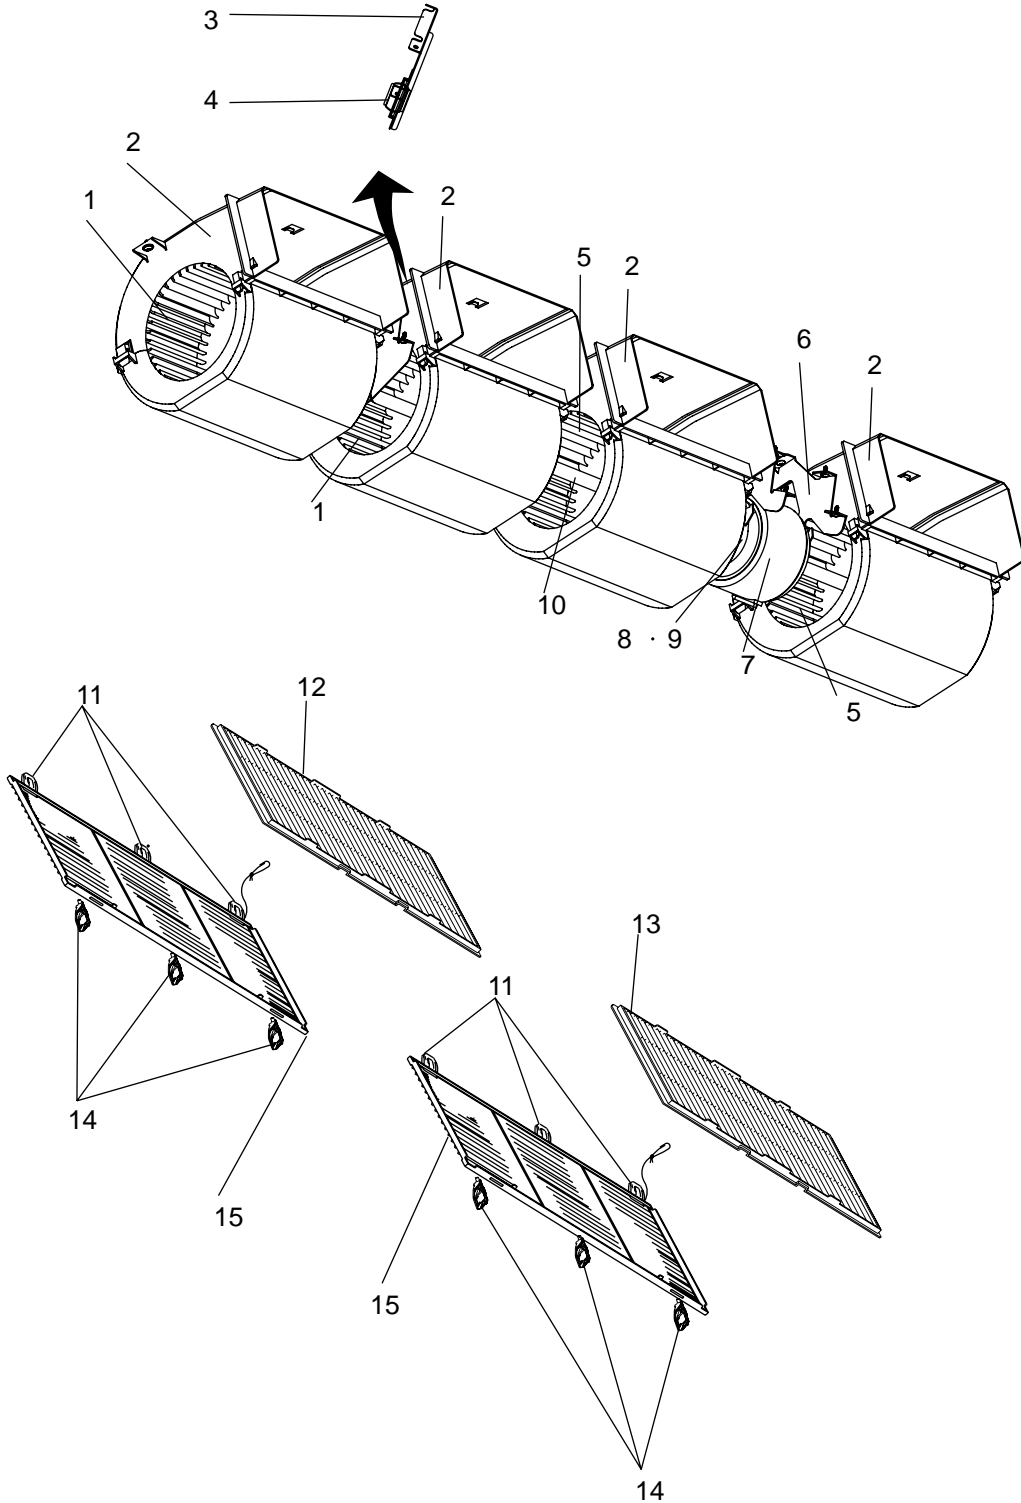



No.	R01S	Part No.	Part Name	Specification	Q'ty/set			Remarks (Drawing No.)	Wiring Diagram Symbol	Recom- mended Q'ty
					PCFY-P•NKMU-E					
					15	24	30, 36			
1	G	R01 E41 114	SIROCCO FAN			2				
2	G	R01 20J 110	CASING		2	3	4			
3	G	R01 E00 145	BEARING SUPPORT			1	1			
4	G	R01 E05 103	BEARING			1	1			
5	G	R01 E40 114	SIROCCO FAN		2	3	2			
6	G	R01 E41 130	MOTOR LEG		1	1	1			
7	G	R01 E46 220	FAN MOTOR		1				MF	
	G	R01 E47 220	FAN MOTOR			1			MF	
	G	R01 E48 220	FAN MOTOR				1		MF	
8	G	R01 46E 126	PIECE (MOTOR) R.L		1	1	1			
9	G	R01 E00 116	JOINT(SHAFT)			1	1			
10	G	R01 31J 100	SHAFT			1				
	G	R01 32J 100	SHAFT				1			
11	G	R01 E04 061	GRILLE HINGE		4	5	6			
12	G	R01 E24 500	AIR FILTER		2	1				
13	G	R01 E25 500	AIR FILTER			1	2			
14	G	R01 E11 054	GRILLE CATCH		4	5	6			
15	G	R01 E54 691	GRILLE (SMALL)		2	1				
	G	R01 E55 691	GRILLE (LARGE)			1	2			


ELECTRICAL PARTS

PCFY-P15NKMU-E

PCFY-P24NKMU-E

PCFY-P30NKMU-E

PCFY-P36NKMU-E

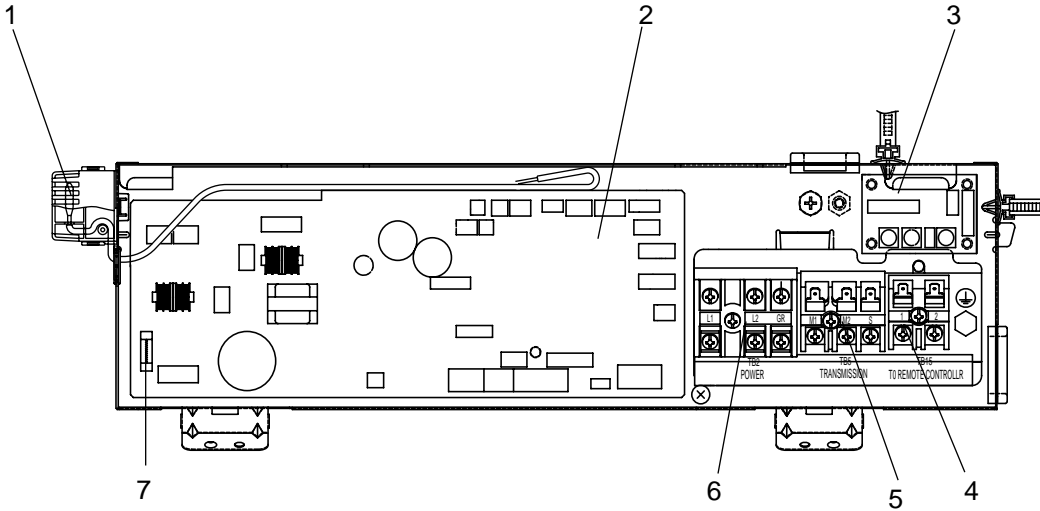

No.	ROHS	Part No.	Part Name	Specification	Q'ty/set	Remarks (Drawing No.)	Wiring Diagram Symbol	Recom- mended Q'ty
					PCFY-P•NKMU-E 15, 24, 30, 36			
1	G	T7W E60 202	THERMISTOR (ROOM)		1		TH21	
2	G	T7W E82 310	CONTROLLER BOARD		1		I.B.	
3	G	T7W E01 294	ADDRESS BOARD		1		A.B.	
4	G	T7W E51 716	TERMINAL BLOCK	2P (1,2)	1		TB15	
5	G	R01 E27 246	TERMINAL BLOCK	3P (M1,M2,S)	1		TB5	
6	G	T7W E41 716	TERMINAL BLOCK	3P (L1, L2, GR)	1		TB2	
7	G	R01 E06 239	FUSE	6.3A 250V	1		FUSE	

2**OPTIONAL PARTS****2-1. WIRELESS REMOTE CONTROLLER KIT**

Part No.	PAR-SL93B-E
----------	-------------

2-2. WIRELESS REMOTE CONTROLLER with i-see Sensor

Part No.	PAC-SA92MW-E
----------	--------------

2-3. i-see Sensor

Part No.	PAC-SH91MK-E
----------	--------------

2-4. WIRED REMOTE CONTROLLER (MA REMOTE CONTROLLER)

Part No.	PAR-21MAA
----------	-----------

2-5. WIRED REMOTE CONTROLLER (ME REMOTE CONTROLLER)

Part No.	PAR-F27MEA
----------	------------

2-6. DRAIN PUMP

Part No.	PAC-SH83DM-E	PAC-SH84DM-E
Applied model	PCFY-P15NKMU-E	PCFY-P24,30,36NKMU-E

2-7. HIGH EFFICIENCY FILTER

Part No.	PAC-SH88KF-E	PAC-SH89KF-E	PAC-SH90KF-E
Applied model	PCFY-P15NKMU-E	PCFY-P24NKMU-E	PCFY-P30,36NKMU-E

CITY MULTI™

 **MITSUBISHI ELECTRIC CORPORATION**
HEAD OFFICE : TOKYO BLDG., 2-7-3, MARUNOUCHI, CHIYODA-KU TOKYO 100-8310, JAPAN