


PresCal™ Pre-adjustable pressure reducing valves

© Copyright 2019 Caleffi

535H Series

Installation, commissioning and servicing instructions



Function

Pressure reducing valves are devices which, when installed on water systems, reduce and stabilize the pressure of the water entering from the water supply main. This pressure, in general, is too high and variable for domestic systems to operate correctly.

The PresCal™ 535H series pressure reducing valves, ideal for residential and commercial applications, feature a dial indicator with direct readout allowing easy pressure pre-adjustment. After installation, the valve will control at the pre-adjusted pressure setting.

The valve is constructed of DZR low-lead forged brass and incorporates a unique noise reducing and high flow seat design, is easily serviced with a replaceable cartridge and has an integral stainless steel filter (35 mesh), suitable for water systems that may contain sediment and debris.

The valve is ICC-ES certified to ASSE 1003, CSA B356, NSF/ANSI 61 (180°F/82°C Commercial Hot), NSF/ANSI 372, low lead laws and listed by ICC-ES. It meets codes IPC, IRC and UPC for use in accordance with the US and Canadian plumbing codes. Plenum rated: compliant with the requirements of standard UL 2043.

Product range

- 5353H Series Pre-adjustable pressure reducing valve with or without pressure gauge and NPT female threaded union connections, sizes ½", ¾", 1", 1¼", 1½" and 2".
- 5355H Series Pre-adjustable pressure reducing valve with or without pressure gauge and PEX expansion union connections, size ¾".
- 5356H Series Pre-adjustable pressure reducing valve with or without pressure gauge and union press connections, sizes ¾" and 1".
- 5357H Series Pre-adjustable pressure reducing valve with or without pressure gauge and union PEX crimp connections, sizes ¾" and 1".
- 5359H Series Pre-adjustable pressure reducing valve with or without pressure gauge and union sweat connections, sizes ½", ¾", 1", 1¼", 1½" and 2".



SAFETY INSTRUCTION



This safety alert symbol will be used in this manual to draw attention to safety related instructions. When used, the safety alert symbol means.

ATTENTION! BECOME ALERT! YOUR SAFETY IS INVOLVED! FAILURE TO FOLLOW THESE INSTRUCTIONS MAY RESULT IN A SAFETY HAZARD.



WARNING: This product can expose you to chemicals including lead, which is known to the State of California to cause cancer and birth defects or other reproductive harm. For more information go to www.P65Warnings.ca.gov.



CAUTION: All work must be performed by qualified personnel trained in the proper application, installation, and maintenance of systems in accordance with all applicable codes and ordinances.



CAUTION: If the 535H series pressure reducing valve is not installed, commissioned and maintained properly, according to the instructions contained in this manual, it may not operate correctly and may endanger the user.



CAUTION: Make sure that all the connecting pipework is water tight.



CAUTION: When making the water connections, make sure that the connecting pipework is not mechanically over-stressed. Over time this could cause breakages, with consequent water losses which, in turn, could cause harm to property and/or people.



CAUTION: Water temperatures higher than 100°F (38°C) can be dangerous. During the installation, commissioning and maintenance of the 535H PRV, take the necessary precautions to ensure that such temperatures do not endanger people.

Leave this manual for the user

CONSIGNE DE SÉCURITÉ



Ce symbole d'avertissement servira dans ce manuel à attirer l'attention sur la sécurité concernant instructions. Lorsqu'il est utilisé, ce symbole signifie.

ATTENTION! DEVENEZ ALERTE ! VOTRE SÉCURITÉ EST EN JEU ! NE PAS SUIVRE CES INSTRUCTIONS PEUT PROVOQUER UN RISQUE DE SECURITE.



AVERTISSEMENT: Ce produit peut vous exposer à des produits chimiques comme le plomb, qui est connu dans l'État de Californie pour causer le cancer, dommages à la naissance ou autre. Pour plus d'informations rendez-vous www.P65Warnings.ca.gov.



ATTENTION: Tous les travaux doivent être effectués par du personnel qualifié formé à la bonne application, installation et maintenance des systèmes conformément aux codes et règlements locaux.



ATTENTION: Si le réducteur de pression, Série 535H, n'est pas installé, mis en service et entretenu correctement, selon les instructions contenues dans ce manuel, il peut ne pas fonctionner correctement et peut mettre en danger l'utilisateur.



ATTENTION: S'assurer que tous les raccordements sont étanches.



ATTENTION: Lorsque vous effectuez les raccordements d'eau, assurez-vous que la tuyauterie reliant réducteur de pression n'est pas mécaniquement des overstressed. Au fil du temps, ceci pourrait causer des ruptures, avec pour conséquence des pertes en eau qui, à leur tour, peuvent causer des dommages à la propriété et/ou les gens.



ATTENTION: les températures de l'eau supérieure à 100°F (38°C) peut être dangereux. Au cours de l'installation, mise en service et l'entretien de le réducteur de pression, Série 535H, prendre les précautions nécessaires afin de s'assurer que de tels températures ne compromettent pas les gens.

LAISSEZ CE MANUEL AVEC L'UTILISATEUR

Technical specifications

Materials:	- Body:	DZR low-lead brass CR EN 1982 CC768S
	- Cover:	glass reinforced nylon PA66M40/1
	- Control stem:	DZR low-lead brass CR EN 12164 CW724R
	- Moving parts:	DZR low-lead brass CR EN 12164 CW724R
	- Diaphragm & seals:	peroxide-cured EPDM
	- Compensation piston rings:	PTFE
	- Filter	stainless steel EN 10088-3 (AISI 304)
	- Seat:	stainless steel EN 10088-3 (AISI 303)
	- Shuttle cartridge:	PPSG40

Max working pressure:	300 psi (20 bar)
Downstream pressure setting range:	15 - 90 psi (1 - 6 bar)
Factory setting:	45 psi (3 bar)
Max. working temperature:	180°F (80°C)
Pressure gauge scale:	0 - 100 psi (0 - 7 bar)
Filter mesh size:	0.51 mm (35 mesh)
Suitable fluids:	water


Main connections:	-NPT female and sweat union	½", ¾", 1", 1¼", 1½" and 2"
	-PEX expansion union	¾"
	-Press and PEX crimp union	¾" & 1"
Lay length (¾" press connection):		size ¾": 4¼"; size 1": 5 ¾"
Pressure gauge connection:		1/8" NPT female

Approvals


1. ICC-ES certified to ASSE 1003, CSA B356, NSF/ANSI 61 (180°F/82°C Commercial Hot), file PMG-1356.
2. NSF/ANSI 372, Drinking Water System Components-Lead Content Reduction of Lead in Drinking Water Act, California Health and Safety Code 116875 S.3874, Reduction in Drinking Water Act, certified by ICC-ES, file PMG-1360.
3. Plenum rated: Evaluated in accordance with the standard UL 2043 and was found compliant with the standard's requirements.

Hydraulic characteristics

Graph 1 (Circulation speed)

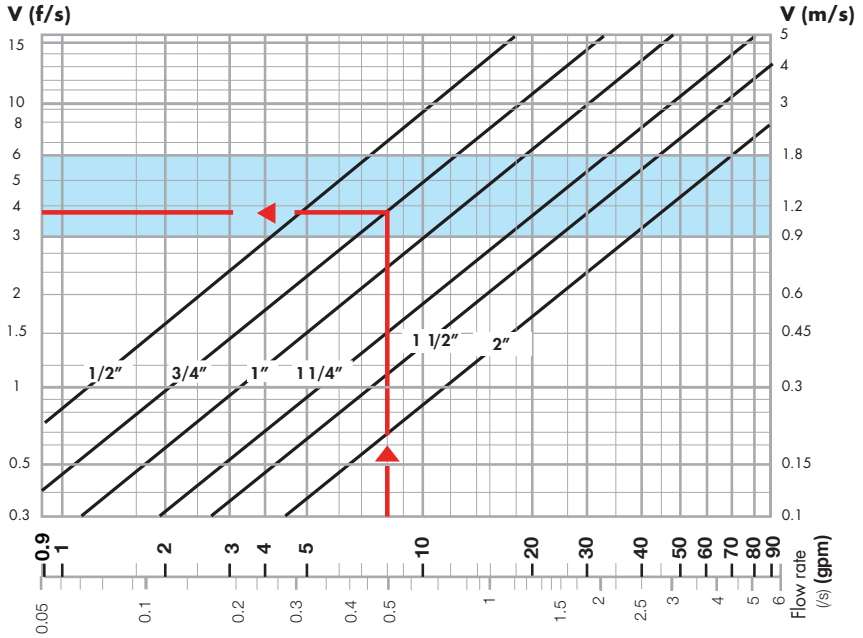

Graph 2 (Pressure drop)

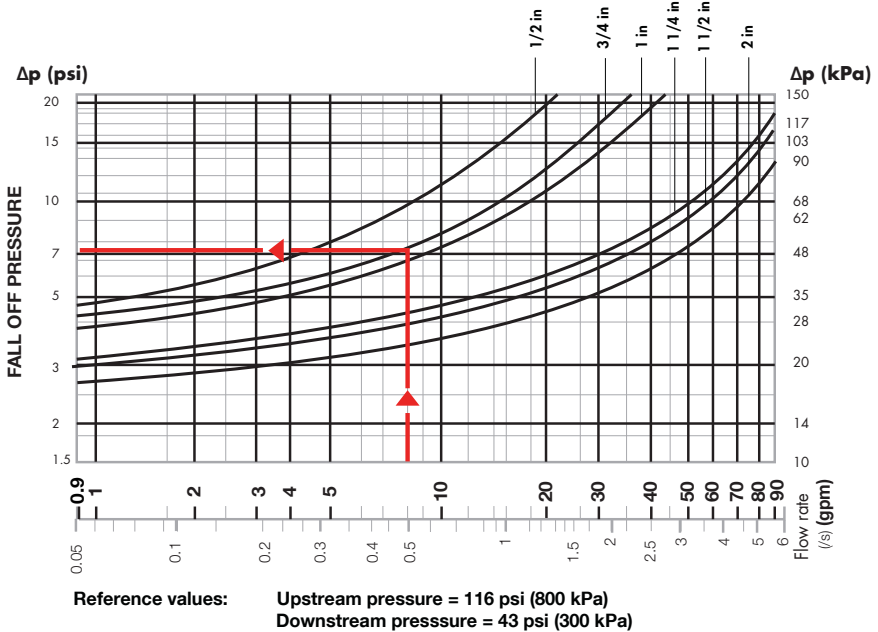

Sizing procedure

Flow velocity is recommended to be kept within 3 to 6 feet per second when calculating the correct pressure reducing valve size. This will prevent noise in the pipes and rapid wear of appliances.

The correct diameter of the pressure reducing valve is taken from graph 1 on the basis of the design flow rate taking into account an ideal flow velocity of between 3 and 6 f/s (blue band).

Example:

For 8 gpm, select the 3/4" size valve (see arrow on graph 1).

The pressure drop is taken from graph 2 also on the basis of where the design flow rate intersects the curve for the valve size already selected (the downstream pressure falls by an amount equal to the pressure drop, with respect to the set pressure at no flow condition).

Example:


For 8 gpm the $\Delta p = 7.3$ psi (see arrow on graph 2).

	Design Flow Rate					
Size	1/2"	3/4"	1"	1 1/4"	1 1/2"	2"
gpm	4 to 7.3	7 to 12.5	10 to 19	17 to 34	24 to 44	37 to 70

Installation

Before following the numbered steps listed, the installer must:

- a) Be sure this pressure reducing valve is compatible with the other equipment in the system that it may interact with or come into contact;
 - b) Assess and acknowledge all hazards related to the use of this product, including potential leakage, by installing this unit properly;
 - c) Install shut-off valve with pressure ports or similar equipment to measure the upstream pressure.
- 1) Turn all the faucets on before installing the pressure reducing valve, to flush the system and expel any air remaining in the pipes.
 - 2) Install shut-off valves upstream and downstream to facilitate maintenance operations.
 - 3) The pressure reducing valve may be installed on either vertical or horizontal pipe. However, it must not be installed upside down.
 - 4) Close the downstream shut-off valve.
 - 5) This mechanical pre-adjustment system, with the operating knob and pressure indicator visible from both sides, allows the pressure reducing valve to be set to the required value in the system prior to installation. The pressure indicator features incremental step movement, so that the pressure can be adjusted continuously and the value displayed at 15 psi increments.
 - 6) Set using the operating knob on the upper part of the valve. The pressure reducing valves are factory set to a pressure of 45 psi.
 - 7) Because the pre-adjustment dial displays in 15 psi increments, the optional downstream outlet pressure gauge can be used to show the exact outlet pressure, which is especially useful for applications requiring this precision.
 - 8) After installation, the internal mechanism will automatically control the pressure, until the set

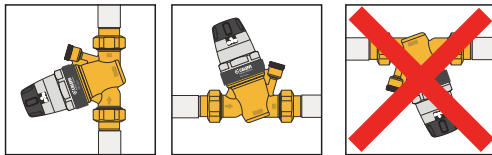

Installation recommendations

1. Installation below ground

Installation below the ground is not advisable.

2. Outdoor installation

Pressure reducing valves should not be installed outside the building unless properly protected from freezing and the weather.




3. Water hammer

Water hammer is a common reason for pressure reducing valve failures. Specific devices should be installed to absorb water hammer for systems with this risk.

Installation

When installing the pressure reducing valve upstream of a hot water tank, installing an expansion tank, or similar, is recommended to absorb the increase in pressure due to the thermal expansion of water.

When installing in large buildings, short pipes or expansion valves, and/or similar equipment, is recommended to limit the increased pressure due to the thermal expansion of water caused by temperature changes downstream of the pressure reducing valve itself (or downstream of the first and second stage pressure reducing valves, if two are used).

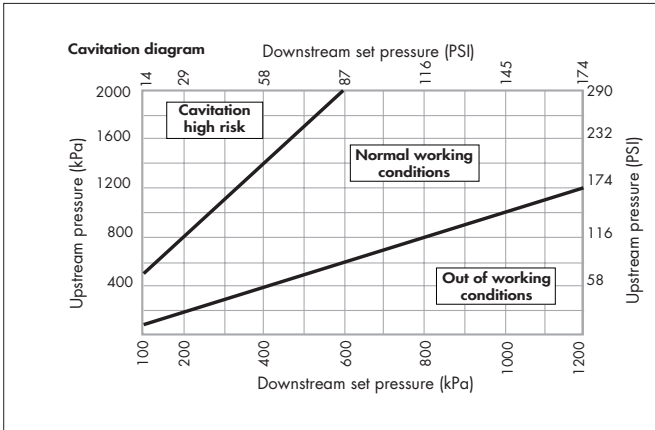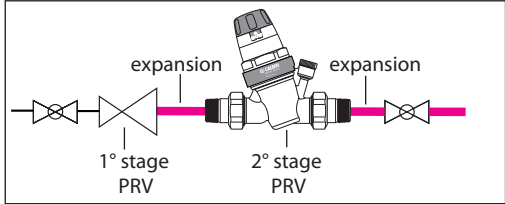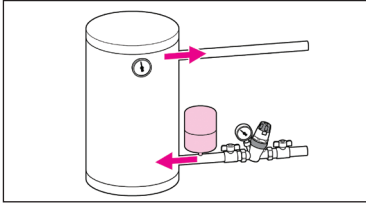

To minimize the risk of cavitation within the valve that may result in malfunctioning with erosion of the valve sealing area, vibrations and noise, it is highly recommended to refer to the working conditions represented in the above diagram. Due to the numerous factors and variable conditions experienced such as system pressure, water temperature, air presence, flow rate and velocity, which may affect the behavior of the pressure reducing valve, it is advisable that the pressure ratio between the upstream pressure and the downstream set pressure is kept ideally to a value 2:1 and no greater than a value of 3:1 (For example, upstream 150 psi (10 bar), set pressure 75 psi (5 bar), the pressure ratio = $150/75 = 2:1$). In these conditions, the possible risk of cavitation and malfunctioning is minimized, however this does not exclude the possible effects of the many other variables within the system under operating conditions. If the pressure ratio exceeds the indicated limit, the system design pressure or use of 1st stage pressure reducing valves shall be reviewed (For example, 1st stage reducing pressure from 200 to 100 psi and then 2nd stage from 100 to 58 psi). Piping upstream and downstream of the pressure reducing valve shall be supported in accordance with the manufacturer's instructions, and any local authority requirements, to avoid the creation and transfer of vibration and/or noise into the installation.



PVC jumper nipple with male union thread. The length of the jumper nipple matches the 535H valve face-to-face dimension, allowing the piping to be completed prior to the installation of valve and permitting quick change out from the jumper to the valve.




Code	Description	Face-to-Face Dimension
NA11304	Jumper nipple for 535H ½" series	3"
NA11305	Jumper nipple for 535H ¾" series	3 9/16"
NA11306	Jumper nipple for 535H 1" series	3 ¾"
NA11307	Jumper nipple for 535H 1¼" series	4 5/16"
NA11308	Jumper nipple for 535H 1½" series	4 ¾"
NA11309	Jumper nipple for 535H 2" series	5 ¼"

Maintenance

The pressure reducing valve must be checked and serviced to comply with applicable regulations. Even when installed, commissioned and serviced properly, the pressure reducing valve's internal components are subject to normal wear and tear, which may result in leaks and other malfunctions. Check or good working order and service and clean the cartridge at least every 12 months.

The cartridge, containing the diaphragm, strainer, seat, valve plug and compensating piston, is pre-assembled as a self-contained unit with a cover and can be removed for inspection and maintenance. When checking, cleaning or replacing the cartridge:

- 1) Shut off the inlet and outlet isolation valves.
- 2) The downstream pressure setting can be left at the set value.
- 3) Remove the upper cover, using a spanner. This cover is integral with the cartridge.
- 4) Check and clean the filter.

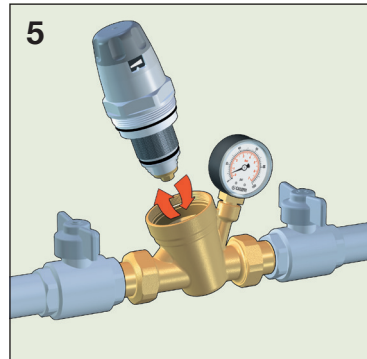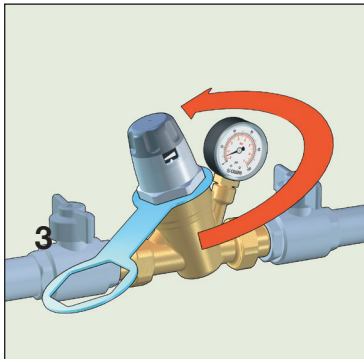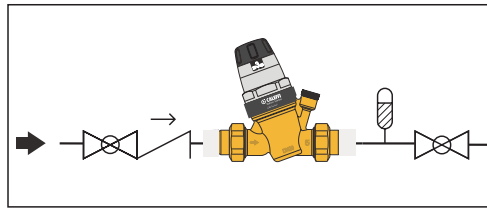

Troubleshooting


System failures are not always caused by the pressure reducing valve. Most frequently:

1. Increased downstream pressure in the presence of a water heater

If the downstream pressure increases beyond the desired setting due to an inline water heater, install an expansion tank between the pressure reducing valve and the water heater to absorb the increased pressure, caused by water expansion from heating.

2. The pressure reducing valve does not maintain downstream setting value

If the pressure reducing valve does not maintain the downstream setting, it most likely is due to impurities accumulating on the valve seat, causing unnecessary flow to pass-through, increasing the downstream pressure. Proper maintenance and cleaning of the removable cartridge is recommended.

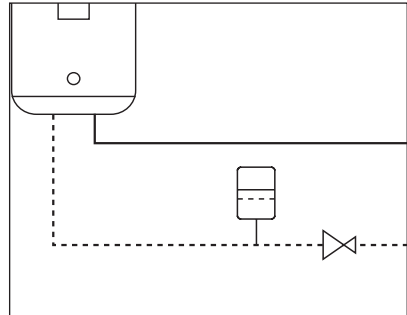

Leave this manual at the service of users for their use



Caleffi North America, Inc.
3883 W. Milwaukee Road
Milwaukee, WI 53208
T: 414.238.2360 F: 414.238.2366

09-18-19