



The Gruvlok® Fig. 7012 Flange allows direct connection of Class 125 or Class 150 flanged components to a grooved piping system. The two interlocking halves of the 2" thru 12" sizes of the Gruvlok Flange are hinged for ease of handling, and are drawn together by a latch bolt which eases assembly on the pipe. Precision machined bolt holes, key and mating surfaces assure concentricity and flatness to provide exact fit-up with flanged, lug, and wafer styles of pipe system equipment. A specially designed gasket provides a leak-tight seal on both the pipe and the mating flange face.

Working pressure ratings shown are for reference only and are based on Schedule 40 pipe. For the latest UL/ULC listed, LPCB, VdS and FM Approved pressure ratings versus pipe schedule, see www.anvilintl.com or contact your local Anvil Representative.

The Gruvlok Fig. 7012 Flange requires the use of a steel adapter insert when used against rubber faced surfaces, wafer/lug design valves and serrated or irregular sealing surfaces. In copper systems a phenolic adapter insert is required, in place of the steel adapter insert. (See Installation and Assembly Instructions Section or contact your Anvil Rep. for details.)



For Listings/Approval Details and Limitations, visit our website at www.anvilintl.com or contact an Anvil® Sales Representative.

 – Available galvanized.

* When ordering, refer to product as FP7012.

MATERIAL SPECIFICATIONS

HOUSING:

Ductile Iron conforming to ASTM A-536, Grade 65-45-12

LATCH BOLT/NUT (2"-12"):

Heat treated, zinc electroplated, carbon steel oval neck track bolts conforming to ASTM A-183 and zinc electroplated heavy hex nuts of carbon steel conforming to ASTM A-563 Grade A or Grade B, or J995 Grade 2.

METRIC BOLTS & HEAVY HEX NUTS:

Heat treated, zinc electroplated oval-neck track head bolts made of carbon steel with mechanical properties per ISO 898-1 Class 8.8. Hex nuts and bolts are zinc electroplated followed by a yellow chromate dip.

COATINGS:

- ☐ Rust inhibiting paint Color: ORANGE (standard)
 - ☐ Hot Dipped Zinc Galvanized (optional)
 - ☐ Other available options: Example: RAL3000 or RAL9000 Series
- For other coating requirements contact an Anvil Representative.

LUBRICATION:

- ☐ Standard Gruvlok
- ☐ Gruvlok Xtreme™ required for dry pipe systems and freezer applications.

GASKETS: Materials


Properties as designated in accordance with ASTM D-2000.

- ☐ **Grade "E" EPDM** (Green color code)
-40°F to 230°F (Service Temperature Range)(-40°C to 110°C)
Recommended for water service, diluted acids, alkalies solutions, oil-free air and many chemical services.
NOT FOR USE IN PETROLEUM APPLICATIONS.

PROJECT INFORMATION

APPROVAL STAMP

Project:	<input type="checkbox"/> Approved
Address:	<input type="checkbox"/> Approved as noted
Contractor:	<input type="checkbox"/> Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	

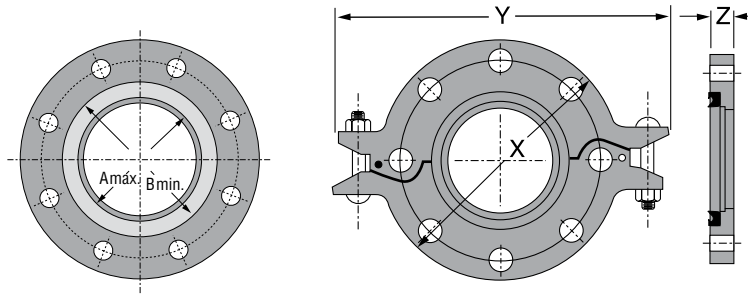
FIGURE 7012 FLANGE: ANSI CLASS 125 & 150

Nominal Size	Pipe O.D.	Max. Working Pressure ▲	Max. End Load ▲	Latch Bolt			Dimensions			Sealing Surface		Mating Flange Bolts				Approx. Wt. Ea.
				Latch Bolt Size*	Specified Torque §		X	Y	Z	A Max.	B Min.	Mating Flange Bolts		Specified Torque §		
					Min.	Max.						Qty.	Size (ANSI)	Min.	Max.	
In./DN(mm)	In./mm	PSI/bar	Lbs./kN	In./mm	Ft.-Lbs/N-m	In./mm	In./mm	In./mm	In./mm	In./mm		in. (ISO) mm	Ft.-Lbs/N-m			
2	2.375	300	1,329	3⁄8 x 2¾	30 45	6¼	8¾	¾	2¾	3⅞	4	5⁄8 x 2¾	110 140	4.2		
50	60.3	20.7	5.91	M10 x 70	40 60	159	213	19	60	87	4	M16 x 70	149 190	1.9		
2½	2.875	300	1,948	3⁄8 x 2¾	30 45	7	9½	¾	2¾	4	4	5⁄8 x 2¾	110 140	4.6		
65	73.0	20.7	8.66	M10 x 70	40 60	178	241	19	73	102	-	M16 x 70	149 190	2.1		
3 O.D.	2.996	300	2,115	-	30 45	7¼	9¾	¾	3	4⅞	-	-	110 140	4.8		
76.1	76.1	20.7	9.41	M10 x 70	40 60	184	248	19	76	105	4	M16 x 70	149 190	2.2		
3	3.500	300	2,886	3⁄8 x 2¾	30 45	7⅞	10½	¾	3½	4⅞	4	5⁄8 x 2¾	110 140	6.0		
88.9	88.9	20.7	12.84	M10 x 70	40 60	200	267	19	89	116	8	M16 x 70	149 190	2.7		
4	4.500	300	4,771	3⁄8 x 2¾	30 45	9	11½	¾	4½	5⅞	8	5⁄8 x 2¾	110 140	6.3		
100	114.3	20.7	21.22	M10 x 70	40 60	229	292	19	114	141	8	M16 x 70	149 190	2.9		
5½ O.D.	5.500	300	7,127	-	30 45	9⅞	12⅞	⅞	5⅞	6¾	-	-	220 250	15.6		
139.7	139.7	20.7	31.70	M10 x 70	40 60	251	327	22	141	171	8	M16 x 75	298 339	7.1		
5	5.563	300	7,292	3⁄8 x 2¾	30 45	10	12½	⅞	5⅞	6¾	8	¾ x 2⅞	220 250	8.8		
125	141.3	20.7	32.44	M10 x 70	40 60	254	318	22	141	171	-	-	298 339	4.0		
6½ O.D.	6.500	300	9,955	-	30 45	11¼	14	⅞	6⅞	7⅞	-	-	220 250	9.7		
165.1	165.1	20.7	44.28	M10 x 70	40 60	286	356	22	168	198	8	M20 x 80	298 339	4.4		
6	6.625	300	10,341	3⁄8 x 2¾	30 45	11	14	⅞	6⅞	7⅞	8	¾ x 3⅞	220 250	9.6		
150	168.3	20.7	46.00	M10 x 70	40 60	279	356	22	168	198	8	M20 x 80	298 339	4.4		
8	8.625	300	17,528	3⁄8 x 2¾	30 45	13½	16½	1	8⅞	10	8	¾ x 3¼	220 250	15.6		
200	219.1	20.7	77.97	M10 x 70	40 60	343	419	25	219	254	8 (12)	M20 x 80	298 339	7.1		
10	10.750	300	27,229	3⁄8 x 2¾	30 45	16	19	1	10¾	12⅞	12	⅞ x 3½	320 400	18.2		
250	273.1	20.7	121.12	M10 x 70	40 60	406	483	25	273	308	12	M20 x 90	439 542	8.3		
12	12.750	300	38,303	3⁄8 x 2¾	30 45	19	21¾	1¼	12¾	14⅞	12	⅞ x 3¾	320 400	29.9		
300	323.9	20.7	170.38	M10 x 70	40 60	483	552	32	324	359	12	-	439 542	13.6		

+ PN 16 uses M24 x 90 (PN) Dimensions for bolt circle PN 10 & 16 Flange.

* Available in ANSI or metric bolt sizes only as indicated.

▲ – Working Pressure Ratings are for reference only and based on Sch. 40 pipe. For the latest UL/ULC, FM, VdS and LPCB pressure ratings versus pipe schedule, please visit anvilintl.com or contact your local Anvil Representative.

§ – For additional Bolt Torque information, see Technical Data Section.

The Gruvlok Flange bolt hole pattern conforms to ANSI Class 150 and Class 125 flanges.

To avoid interference issues, flanges cannot be assembled directly to Series 7700 butterfly valve. Flange can be assembled to one side of series 7500 and 7600 valve only.

Mating flange bolts must be at least Intermediate Strength Bolting per ASME B16.5. Bolts with material properties equal or greater than SAE J429 Grade 5 are acceptable.




Refer to the Gruvlok Product Catalog or Anvil's web site for more information on installing this flange.

300 Lb Flange is available, Fig. 7013, see Gruvlok Catalog or contact your Anvil Rep. for more information.

Other sizes available, contact an Anvil Representative.



For dry pipe systems and freezer applications lubrication of the gasket is required, Gruvlok® Xtreme™ Lubricant is required.

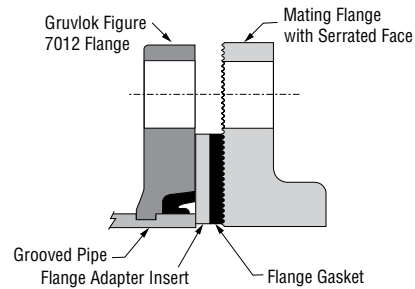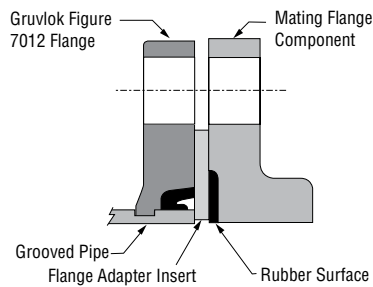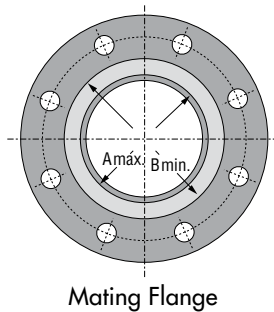

- A. The sealing surfaces A Max. to B Min. of the mating flange must be free from gouges, undulations and deformities of any type to ensure proper sealing of the gasket.
- B. Gruvlok Flanges are to be assembled on butterfly valves so as not to interfere with actuator or handle operation.
- C. Do not use Gruvlok Flanges within 90 degrees of one another on standard fittings because the outside dimensions may cause interference.
- D. Gruvlok Flanges should not be used as anchor points for tie-rods across non-restrained joints.
- E. Fig. 7012 Gruvlok Flange sealing gaskets require a hard flat surface for adequate sealing. The use of a Gruvlok Flange Adapter Insert is required for applications against rubber faced valves or other equipment. The Gruvlok Flange Adapter Insert is installed between the Gruvlok Flange sealing gasket and the mating flange or surface to provide a good sealing surface area.
- F. Gruvlok Flanges are not recommended for use against formed rubber flanges.
- G. An additional bolt is recommended for the hinge side of the 2" - 12" Figure 7012 when connecting to lug valves.
- H. Contact an Anvil Representative for Di-Electric Flange connections.

Applications which require a Gruvlok Flange Adapter Insert:

1. When mating to a wafer valve (lug valve), if the valve is rubber faced in the area designated by the sealing surface dimensions (A Max. to B Min.), place the Gruvlok Flange Adapter Insert between the valve and the Gruvlok flange.
2. When mating to a rubber-faced metal flange, the Gruvlok Flange Adapter Insert is placed between the Gruvlok Flange and the rubber-faced flange.
3. When mating to a serrated flange surface, a standard full-faced flange gasket is installed against the serrated flange face and the Gruvlok Flange Adapter Insert is placed between the Gruvlok Flange and the standard Flange gasket.
4. When mating to valves or other component equipment where the flange face has an insert, use procedure described in note 3.

FIG. 7012 Gruvlok Flange



ALWAYS USE A GRUVLOK® SPF/ANVIL™ LUBRICANT FOR PROPER COUPLING ASSEMBLY. Thorough lubrication of the external surface of the gasket is essential to prevent pinching and possible damage to the gasket. For temperatures above 150°F (65°C) and below 32°F (0°C) use Gruvlok® SPF/Anvil™ Xtreme Lubricant™ and lubricate all gasket surfaces, internal and external. See Gruvlok SPF/Anvil Lubricants in the Technical Data section of the Anvil SPF catalog for additional important information. **Check pipe end for proper grooved dimensions and to assure that the pipe end is free of indentations and projections that would prevent proper sealing of the Gruvlok flange gasket.**

Step 1




1 On the side without the hinge pin, loosen the latch bolt nut to the end of the bolt thread. (It is not necessary to remove the nut from the latch bolt.) Swing the latch bolt out of the slot. Open the Gruvlok Flange and place around the grooved pipe end with the key section fitting into the groove. The flange gasket cavity must face the pipe end.

Step 2



2 Place the latch bolt back into the slotted hole. Tighten the nut until there is a $\frac{1}{16}$ " gap between the flange halves at location "A". (See Figure below)




Step 3



3 Check the gasket to assure that it is properly suited for the intended service. Lubricate the entire exterior surface of the gasket, including the sealing lips, using the proper Gruvlok lubricant.

4 Stretch the Gruvlok gasket around the pipe end and then press the gasket into the cavity between the pipe O.D. and the flange. The gasket must be properly positioned as shown in the figure below.

Step 4



5 With the gasket in place apply lubricant to the exposed gasket tip, which will seal on the mating flange. **Tighten the nuts on the latch bolts alternately to the specified latch bolt torque. The flange housings must be in firm metal-to-metal contact.**

Step 5



WARNING

The Gruvlok Flange gasket must be inserted so that the sealing lips face toward the pipe end and the mating flange. The lip of the gasket, sealing on the pipe, should not extend beyond the pipe end. The pipe should extend out beyond the end of the sealing lip by approximately $\frac{1}{8}$ " on the 2"-6" sizes and $\frac{3}{16}$ " on the 8"-12" sizes.





6 Verify that the mating flange face is hard, flat and smooth, free of indentations, which would prevent proper sealing of the Gruvlok Flange gasket. Assure the gasket is still in the proper position and align Gruvlok Flange bolt holes with the mating flange, pump, tank, etc., bolt holes.

WARNING

It is important to line up the bolt holes before bringing the two flanges together. Sliding the flanges into place will dislodge the gasket and cause leakage to occur. When using a flange insert, it is important that the insert is properly aligned with the gasket prior to tightening the bolts.



7 Insert a flange bolt or stud with material properties of SAE J429 Grade 5 or higher through the bolt holes and thread a nut on hand tight. Continue this procedure until all bolt holes have been fitted. Tighten the nuts alternately and evenly so the flange faces remain parallel. All the bolts or studs must be torqued to the mating flange bolts specified torque. The flange faces should have metal-to-metal contact.

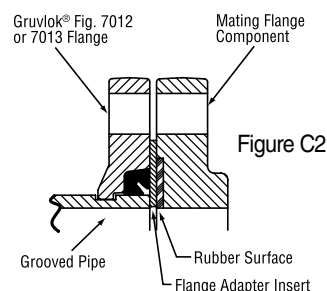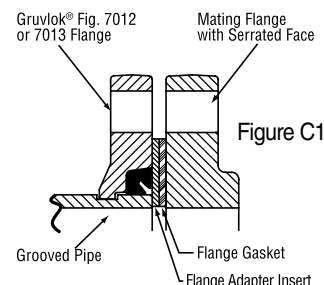

Note: The Gruvlok Fig. 7012 Flange requires the use of a Flange Adapter Insert when used against rubber surfaces (Figure C1), serrated flange surfaces or mating flanges with inserts (Figure C2). The Flange Adapter Insert will be exposed to the fluids in the system. Ensure that the Insert is compatible with the fluids in the systems and with adjacent piping components.

WARNING

Do not use a steel Flange Adapter Insert in copper systems or in systems where galvanic corrosion is possible.

Specified Bolt Torque for Latch and Mating Flange Bolts

Specified bolt torque is for the latch and mating flange bolts used on Gruvlok® flanges. The nuts must be tightened alternately and evenly until fully tightened. **Caution:** Use of an impact wrench is not recommended because the torque output can vary significantly due to many variables including air pressure supply, battery strength and operational variations.

Caution: Proper torquing of latch and mating flange bolts is required to obtain specified performance. **Over torquing the bolts may result in damage to the bolt and/or casting which could result in pipe joint separation.** Under torquing the bolts may result in lower pressure retention capabilities, lower bend load capabilities, joint leakage and pipe joint separation. Pipe joint separation may result in significant property damage and serious injury.

Note: For VDS approved applications, please refer to data sheet VDSGruv: "VDS – Roll Grooving Approval Specifications" in the Technical Data/Installation Instruction Section at www.anvilintl.com.

ANSI/METRIC SPECIFIED LATCH BOLT TORQUE		
Bolt Size	Wrench Size	Specified Bolt Torque *
$\frac{3}{8}$ M10	$\frac{11}{16}$ 16	30-45 40-60
$\frac{1}{2}$	$\frac{7}{8}$	80-100
$\frac{5}{8}$	$1\frac{1}{16}$	100-130
$\frac{3}{4}$	$1\frac{1}{4}$	130-180
$\frac{7}{8}$	$1\frac{7}{8}$	180-220

* Non-lubricated bolt torques.

ANSI/METRIC SPECIFIED MATING FLANGE BOLT TORQUE		
Bolt Size	Wrench Size	Specified Bolt Torque *
$\frac{5}{8}$ M16	$1\frac{1}{16}$ 24	110-140 149-190
$\frac{3}{4}$ M20	$1\frac{1}{4}$ 30	220-250 298-339
$\frac{7}{8}$ M24	$1\frac{7}{8}$ 36	320-400 434-542
1	$1\frac{3}{8}$	360-520
$1\frac{1}{8}$	$1\frac{13}{16}$	450-725
$1\frac{1}{4}$	2	620-1000

* Non-lubricated bolt torques.