



Retrofit Restraining Strap Fig. AF090R

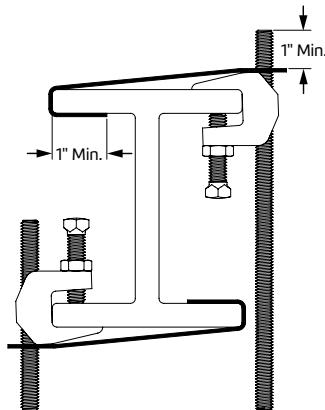

Dimensions (In)

L Length	W Width	T Thickness
6		
8		
10	1	15 ga.
12		



Notes

ASC Engineered Solutions™ brand bracing components are designed to be compatible ONLY with other ASC Engineered Solutions brand bracing components, resulting in a Listed seismic bracing assembly. Updated UL listing information may be viewed at www.ul.com

Disclaimer

ASC Engineered Solutions does not provide any warranties and specifically disclaims any liability whatsoever with respect to ASC Engineered Solutions bracing products and components that are used in combination with products, parts or systems not manufactured or sold by ASC Engineered Solutions. In no event shall ASC Engineered Solutions be liable for any incidental, direct, consequential, special or indirect damages or lost profits where non-ASC Engineered Solutions bracing components have been, or are used.

Material Specifications

Size Range

3/8" through 1/2" Threaded Rod

Material

Carbon steel

Finish

Pre-Galvanized per ASTM A653

Service

Secures beam clamps to the beam where building movement is expected due to seismic activity. NFPA 13 requires the use of restraining straps in seismic areas. For use with Anvil Fig. 86, 88, 92, 93, and 95 beam clamps.

Approvals

cULus Listed. Complies with the hanging and bracing requirements listed in NFPA 13.

Features

- Universal hook allows for installation on 3/8" and 1/2" rod.
- Unique hook design allows for easy installation on existing piping systems.

Installation Instructions

- Install beam clamp per manufacturer's installation instructions.
- Hook the end of the retrofit restraining strap around the rod or beam clamp set screw.
- Pull tight and wrap the opposite end of the retrofit restraining strap around the beam flange. At least 1" must wrap around the beam. For best performance, ensure the retrofit restraining strap is tight against the beam.
- For rod which extends less than 1" past the retrofit restraining strap, a nut must be installed to secure the retrofit restraining strap to the beam clamp and rod.
- Fire Protection applications shall also be installed per the requirements of NFPA 13 and local codes.

Patent

No. 5,897,088

Ordering

Specify size, length, figure number and description.



ANVIL®

An ASC Engineered Solution

PROJECT INFORMATION

Project:

Address:

Contractor:

Engineer:

Submittal Date:

Notes 1:

Notes 2:

APPROVAL STAMP

Approved

Approved as noted

Not approved

Remarks: