

○ **GBF1672** Recessed Emergency Shower, Wall Mounted Exposed Shower Head

Application: Recessed emergency shower with wall mounted shower head. Recessed shower conserves valuable floor space, while eliminating the clutter and obstruction created by conventional shower equipment. Unit can be installed in either a corridor or a lab room, close to where accidents might occur.

ADA Compliance: When installed at recommended mounting heights, unit complies with ADA requirements for accessibility by handicapped persons.

Shower Head: 10" diameter stainless steel. Furnished with horizontal supply pipe and wall escutcheon.

Valve: 1" IPS brass stay-open ball valve with stainless steel "panic bar." Pulling bar down activates shower; shower remains in operation until bar is returned to original closed position. Furnished with stainless steel access panel and 1" IPS unions for valve.

Pipe and Fittings: Exposed pipe and escutcheon are brushed stainless steel.


Supply: 1" IPS female inlet.

Sign: ANSI-compliant identification sign.

U.S. Patent 5,768,721

Available Options

- **FC20** Regulates shower flow rate to 20 GPM.
- **AP250-065** Modesty curtain for wall mounting.
- **AP280-235** Electric Light and Alarm Horn.
Flashing light/alarm horn unit is recess mounted in finished wall. Light is illuminated and horn sounds when shower is activated. Includes additional leads for remote monitoring.
- **TMV** G3800LF thermostatic mixing valve precisely blends hot and cold water to deliver tepid water as required by ANSI Z358.1-2014.

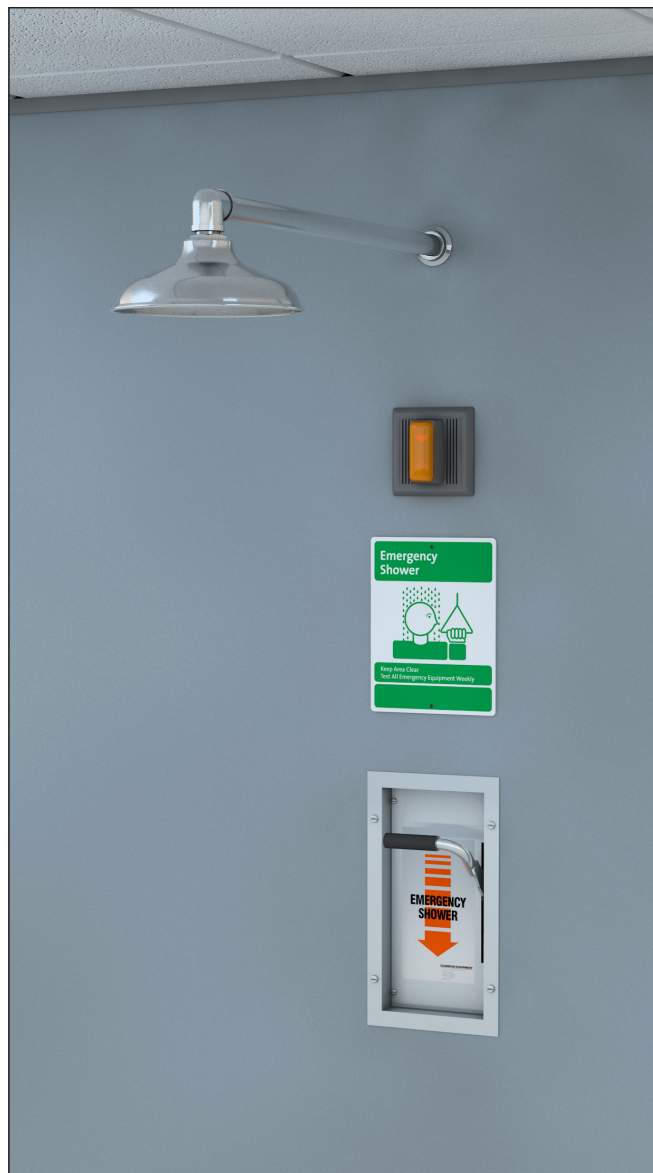


Note: Shown with optional AP280-235 electric light and alarm horn unit (sold separately).



GBF1672 Recessed Emergency Shower, Wall Mounted Shower Head

NOTES:

1. A MINIMUM OF 4 1/8" IS REQUIRED FROM FINISHED WALL SURFACE TO REAR OF WALL CAVITY TO ACCOMMODATE UNIT.
2. U.S. PATENT NO. 5,768,721.
3. PROVIDE 7 1/4" X 14 1/2" CUTOUT IN WALL FOR HOUSING INSTALLATION.

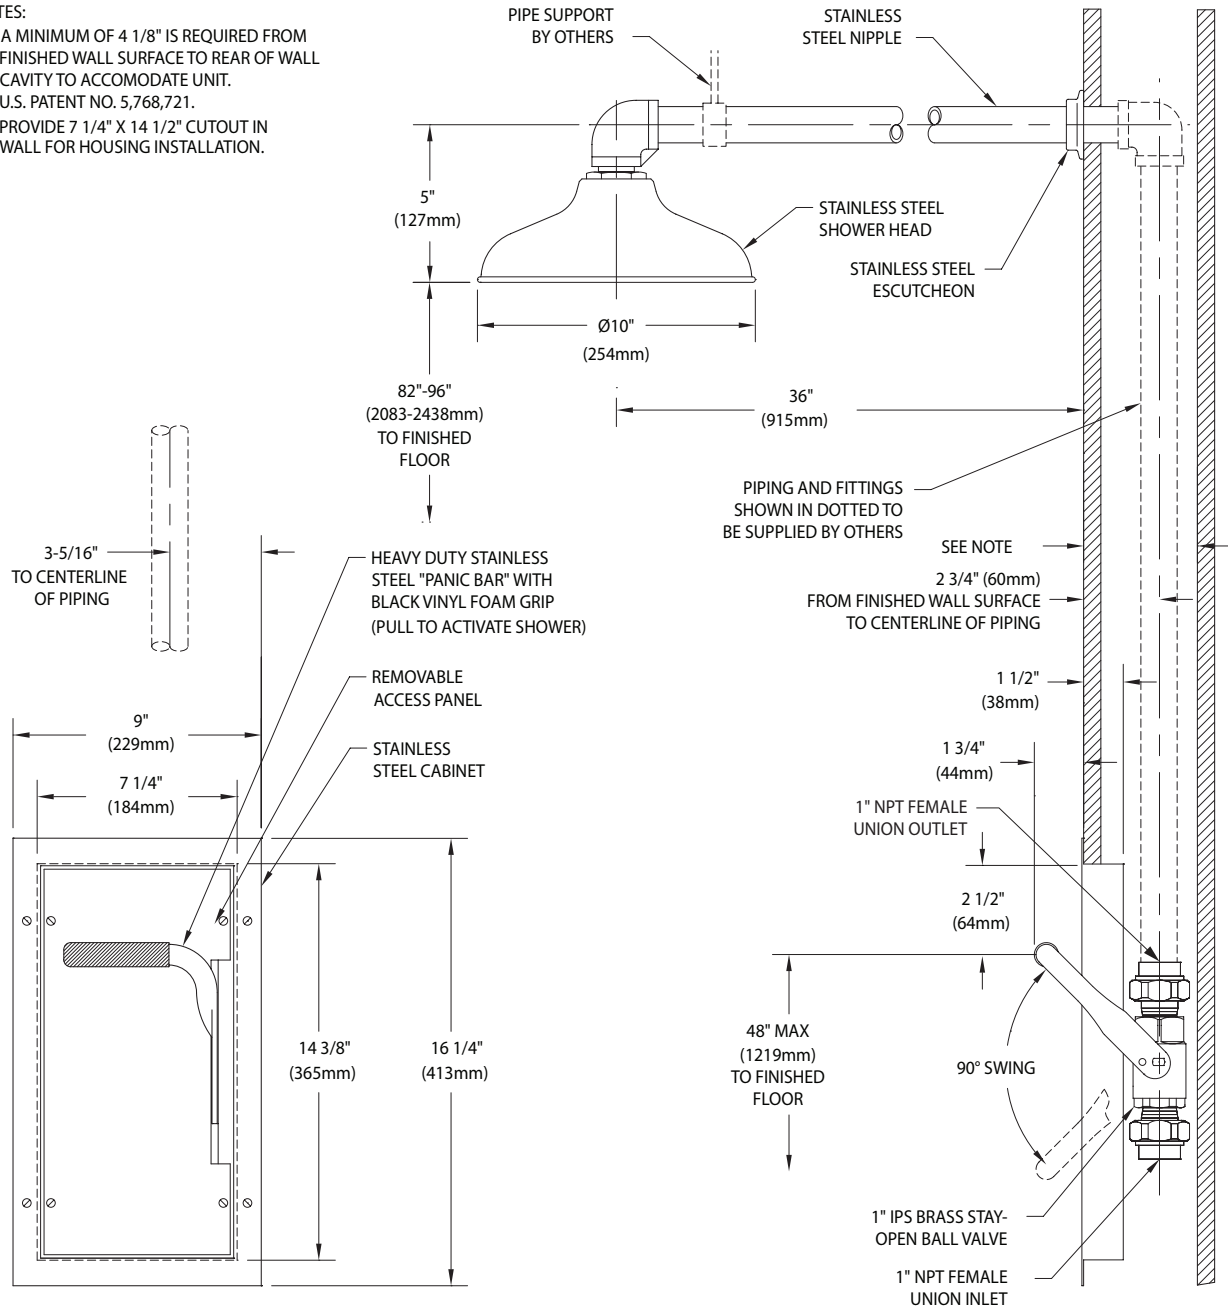

THIS SPACE FOR ARCHITECT/ENGINEER APPROVAL

Due to continuing product improvement, the information contained in this document is subject to change without notice. All dimensions are $\pm 1/4"$ (6mm). rev. 0115

Sign Included



Guardian Equipment
1140 N North Branch St
Chicago, IL 60642

312 447 8100 TELEPHONE
312 447 8101 FACSIMILE
gesafety.com



Listed 8116. Units have been tested to and comply with ANSI Z358.1-2014 and the Uniform Plumbing Code.



ETL Listed 101496. Units have been tested to and comply with ANSI Z358.1-2014.

