

# Installer's Guide


## Variable Speed AccuLink™ Side Discharge HP Models

*For coastal applications where units are installed within one (1) mile of salt water, epoxy coated models are recommended. These models have an 8 week lead time after order.*

4A6L9024A1000A  
4A6L9036A1000A  
4A6L9048A1000A  
4A6L9060A1000A

### Epoxy Coated Model

4A6L9024A1COTA  
4A6L9036A1COTA  
4A6L9048A1COTA  
4A6L9060A1COTA

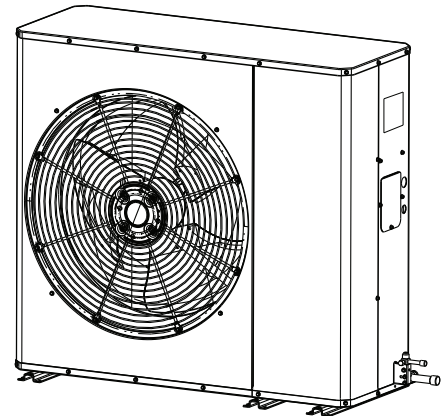

**Note:** "Graphics in this document are for representation only. Actual model may differ in appearance."

### ▲ SAFETY WARNING

Only qualified personnel should install and service the equipment. The installation, starting up, and servicing of heating, ventilating, and air-conditioning equipment can be hazardous and requires specific knowledge and training. Improperly installed, adjusted or altered equipment by an unqualified person could result in death or serious injury. When working on the equipment, observe all precautions in the literature and on the tags, stickers, and labels that are attached to the equipment.

## Safety Section-VSPD Side Discharge

**Important** — This document contains a wiring diagram and service information. This is customer property and is to remain with this unit. Please return to service information pack upon completion of work.

### **⚠ WARNING**

#### **HAZARDOUS VOLTAGE!**

Failure to follow this Warning could result in property damage, severe personal injury, or death.

Disconnect all electric power, including remote disconnects before servicing. Follow proper lockout/tagout procedures to ensure the power cannot be inadvertently energized.

### **⚠ WARNING**

#### **REFRIGERANT OIL!**

Failure to follow this Warning could result in property damage, severe personal injury, or death.

These units use R-410A refrigerant which operates at 50–70% higher pressures than R-22. Use only R-410A approved service equipment. Refrigerant cylinders are painted a “Rose” color to indicate the type of refrigerant and may contain a “dip” tube to allow for charging of liquid refrigerant into the system. R-410A systems use a POE oil that readily absorbs moisture from the atmosphere. To limit this “hygroscopic” action, the system should remain sealed whenever possible. If a system has been open to the atmosphere for more than 4 hours, the compressor oil must be replaced. Never break a vacuum with air and always change the driers when opening the system for component replacement. For specific handling concerns with R-410A and POE oil.

### **⚠ CAUTION**

#### **HOT SURFACE!**

May cause minor to severe burning. Failure to follow this Caution could result in property damage or personal injury.

Do not touch top of compressor.

### **⚠ CAUTION**

#### **CONTAINS REFRIGERANT!**

Failure to follow proper procedures can result in personal illness or injury or severe equipment damage.

System contains oil and refrigerant under high pressure. Recover refrigerant to relieve pressure before opening system.

### **⚠ CAUTION**

#### **GROUNDING REQUIRED!**

Failure to inspect or use proper service tools may result in equipment damage or personal injury.

Reconnect all grounding devices. All parts of this product that are capable of conducting electrical current are grounded. If grounding wires, screws, straps, clips, nuts, or washers used to complete a path to ground are removed for service, they must be returned to their original position and properly fastened.

### **⚠ WARNING**

#### **SERVICE VALVES!**

Failure to follow this warning will result in abrupt release of system charge and may result in personal injury and/or property damage.

Extreme caution should be exercised when opening the Suction and Liquid Line Service Valve. Turn valve stem counterclockwise only until the stem contacts the rolled edge. No torque is required.

### **⚠ WARNING**

#### **BRAZING REQUIRED — IF USING MECHANICAL CONNECTIONS, ENSURE LEAK TEST IS NEGATIVE!**

Failure to inspect lines or use proper service tools may result in equipment damage or personal injury.

if using existing refrigerant lines make certain that all joints are brazed, not soldered.

### **⚠ WARNING**

#### **HIGH LEAKAGE CURRENT!**

Failure to follow this Warning could result in property damage, severe personal injury, or death.

Earth connection essential before connecting electrical supply.

### **⚠ WARNING**

#### **Warning!**


This product can expose you to chemicals including lead which are known to the State of California to cause cancer and birth defects or other reproductive harm.

For more information go to [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)

Safety Section-VSPD Side Discharge

**Important:** If using other than copper pipe, follow manufacturer's installation instructions. Joints must be brazed or other UL/IMC/URMC approved joint that meets pressure requirements.


**⚠ WARNING**



**400 VOLTS  
ELECTRICAL HAZARD**

Failure to follow this warning could result in personal injury or death.

WAIT TWO (2) MINUTES after disconnecting power prior to touching electrical components as they may hold a dangerous charge of 400VDC, then verify DC Voltage is less than 42 VDC at inverter test points labeled +VDC and -VDC before servicing board.



**⚠ WARNING**

**HAZARDOUS VOLTAGE!**



Voltage may be present with power disconnected due to high winds causing fan rotation. See Service Facts or Technical Manual for servicing instructions.

**Important:** It may be necessary to block prevailing winds through unit to stop fan rotation before servicing.

- Approved Combinations for Variable Speed Units**

  - ACONT850, AZONE950 or AZON1050
  - TAM9
  - TAM8C
  - TEM8
  - S9V2 Furnace w/Relay Panel
  - Platinum 95 Furnace
  - Platinum 80 Furnace
  - Approved System Accessories

**Note:** See AHRI directory for approved indoor and outdoor model combinations. Only American Standard coils and air handlers/furnaces are approved for use with variable speed outdoor units.

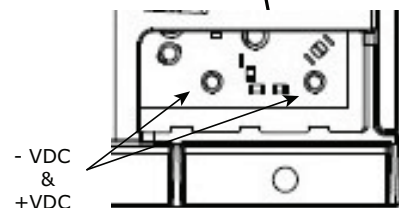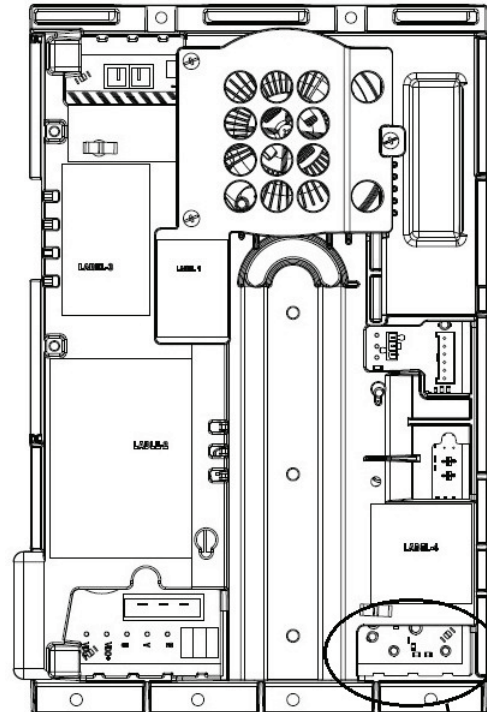

**Important:** Use caution when cleaning outdoor coil to ensure no water enters the electrical control compartment. When cleaning coil, take special care not to spray water towards the control panel. Water may enter the control compartment and drive damaging the electronics. Disconnect all electric power, including remote disconnects before servicing.

**Table 1. Operating Range**

Cooling	45° F to 120° F
Heating	-10° F to 66° F


## Table of Contents

Unit Location Considerations.....	5	LED Indicators — Variable Speed Side Discharge Drive .....	18
Setting Up the Unit .....	8	Electrical — High Voltage.....	19
Refrigerant Line Considerations .....	9	Start Up .....	20
Refrigerant Line Brazing.....	12	System Charge Adjustment .....	21
Refrigerant Line Leak Check .....	14	Charging and Correction Charts .....	22
Refrigerant Line and Indoor Coil Evacuation.....	14	Charging the Unit.....	23
Charging: Weigh-In Method .....	15	Communicating Display Assembly (CDA).....	25
Electrical — Low Voltage .....	16	Defrost Control (HP Only) .....	25
Service Valves.....	17	Checkout Procedures .....	27

# Unit Location Considerations

**Table 2. Unit Dimensions (in inches) and Weight**

Models	H x D x W (in)	A	B	C	D	E	F	Net Weight (lb)
4A6L9024A1XXX	36.75 x 17 1/2 x 47	32.75	47.0	36.75	17.5	19.5	20.5	204
4A6L9036A1XXX	36.75 x 17 1/2 x 47	32.75	47.0	36.75	17.5	19.5	20.5	226
4A6L9048A1XXX	36.75 x 17 1/2 x 47	32.75	47.0	36.75	17.5	19.5	20.5	245
4A6L9060A1XXX	42.75 x 17 1/2 x 47	32.75	47.0	42.75	17.5	19.5	20.5	245

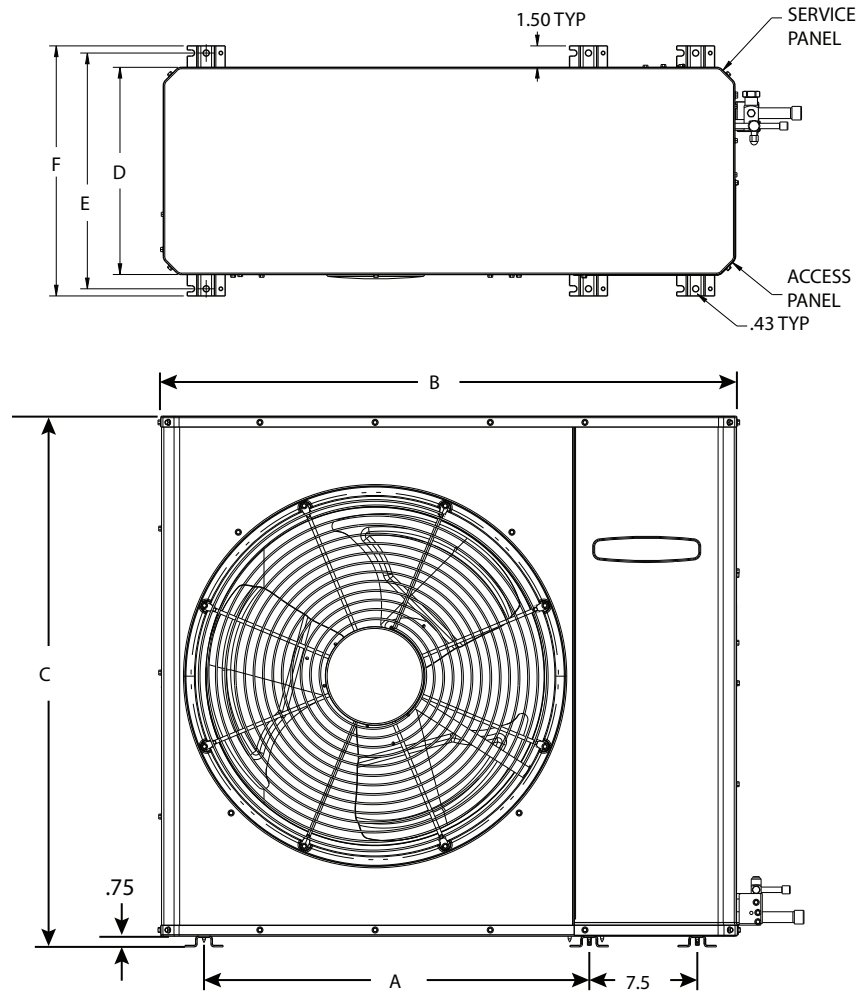



## Unit Location Considerations

**Table 3. Suggested Locations for Best Reliability**

- Do not locate close to bedrooms as operational sounds may be objectionable.
- Avoid locations near windows and similar areas where condensation and freezing defrost vapor can annoy a customer.
- The **coil side** of the outdoor unit must be a minimum of 6" from any wall or surrounding shrubbery to ensure adequate airflow.


**Important:** When installing multiple units, ensure the discharge air from one unit is not drawn into another unit. When installing single or multiple units in an alcove, roof well, or partially enclosed area, ensure there is adequate ventilation to prevent recirculation of discharge air.

**Important:** If installation is in areas with known prevailing winds in excess of 25 mph, a wind baffle kit is suggested.

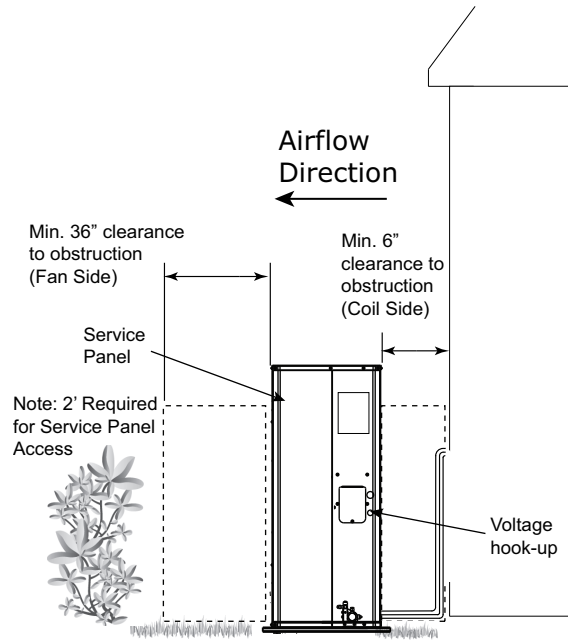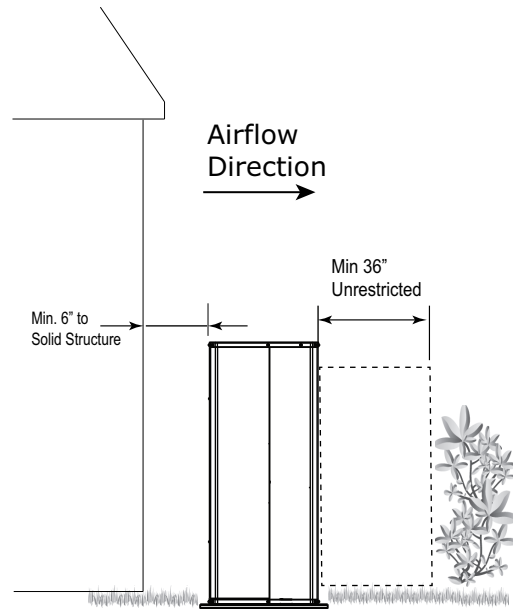


## Unit Location Considerations

**Table 3. Suggested Locations for Best Reliability (continued)**
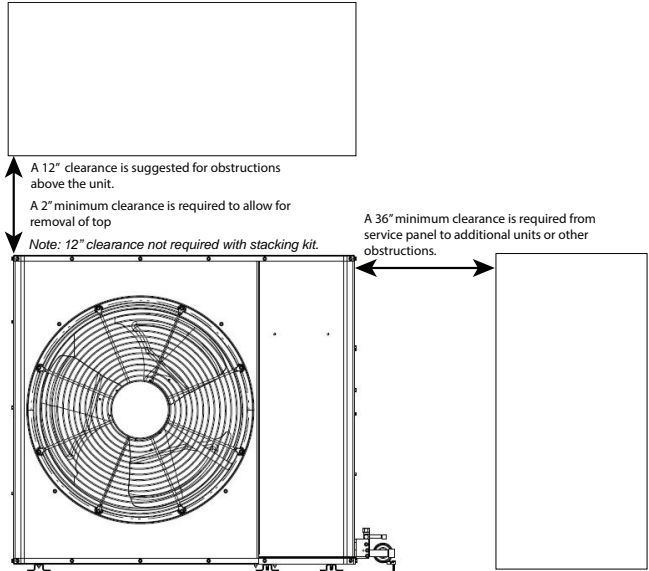
<ul style="list-style-type: none"> <li>• A 36" minimum clearance is required on the line voltage electrical service side access panel to any wall or obstruction.</li> <li>• For ease of service maintenance, provide 24" clearance in front of the control box (access panel) and any other side requiring service.</li> </ul>	 <p>A 12" clearance is suggested for obstructions above the unit. A 2" minimum clearance is required to allow for removal of top <i>Note: 12" clearance not required with stacking kit.</i> A 36" minimum clearance is required from service panel to additional units or other obstructions.</p>
---	---

**Table 4. Refrigerant Piping Limits**

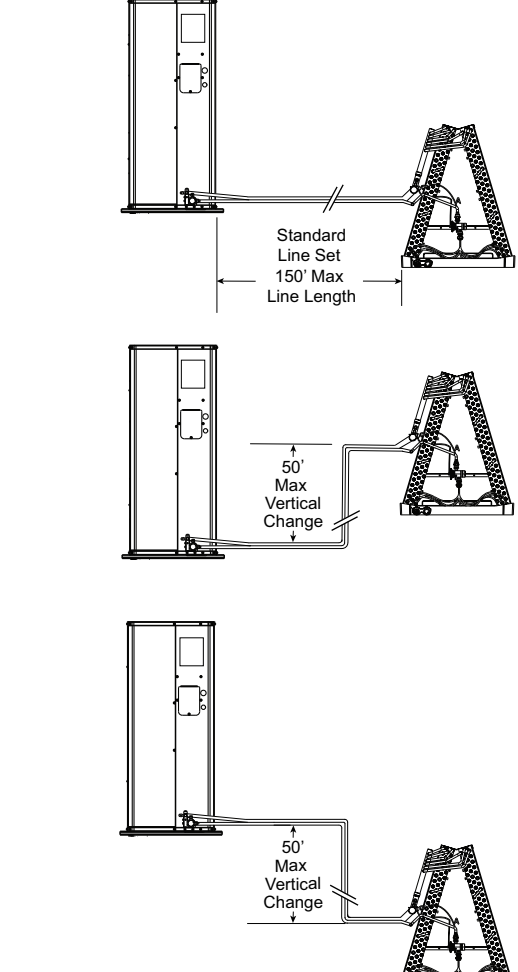
<ol style="list-style-type: none"> <li>1. The maximum length of refrigerant lines from outdoor to indoor unit should NOT exceed 150 feet.</li> <li>2. The maximum vertical change should not exceed 50 feet in most applications.</li> <li>3. Service valve connection diameters are shown in "Refrigerant Line and Service Valve Connection Size Chart."</li> </ol> <p><b>Important:</b> Follow subcool charts for specific operation.</p>	 <p>Standard Line Set 150' Max Line Length</p> <p>50' Max Vertical Change</p> <p>50' Max Vertical Change</p>
---	---

## Unit Location Considerations

**Table 5. Cold Climate Considerations**

**Note:** It is recommended that these precautions be taken for units being installed in areas where snow accumulation and prolonged below-freezing temperatures occur.

- Units should be elevated 3–12 inches above the pad or rooftop, depending on local weather. This additional height will allow drainage of snow and ice melted during defrost cycle prior to its refreezing. Ensure that drain holes in unit base pan are not obstructed, preventing drainage of defrost water.
- If possible, avoid locations that are likely to accumulate snow drifts. If not possible, a snow drift barrier should be installed around the unit to prevent a build-up of snow on the sides of the unit.

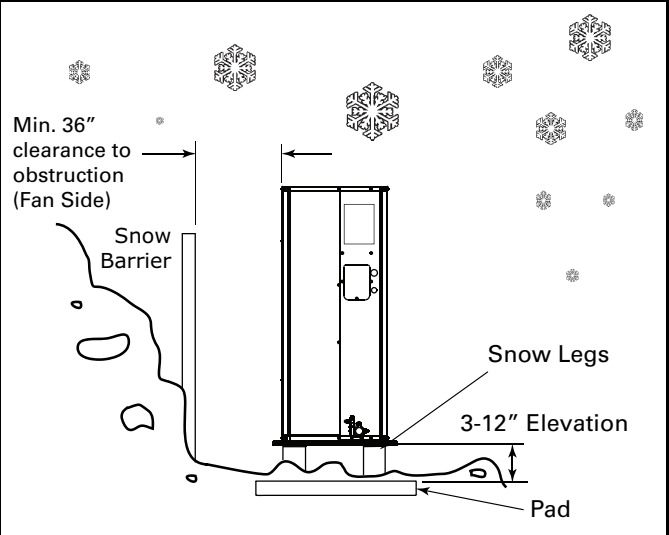

**Table 6. Coastal Considerations**

If installed within one mile of salt water, including seacoasts and inland waterways, models with epoxy coated coils are available. Model numbers with "COT" in the eleventh (11) through thirteenth (13) digits represent epoxy coated coil. These models have an 8 week lead time after order.

## Setting Up the Unit


**Table 7. Pad Installation**

When installing the unit on a support pad, such as a concrete slab, consider the following:

- The pad should be at least 1" larger than the unit on all sides.
- The pad must be separate from any structure.
- The pad must be level.
- The pad should be high enough above grade to allow for drainage.
- The pad location must comply with National, State, and Local codes.

**Important:**

- Unit can be secured to the pad if there is concern of the unit tipping.

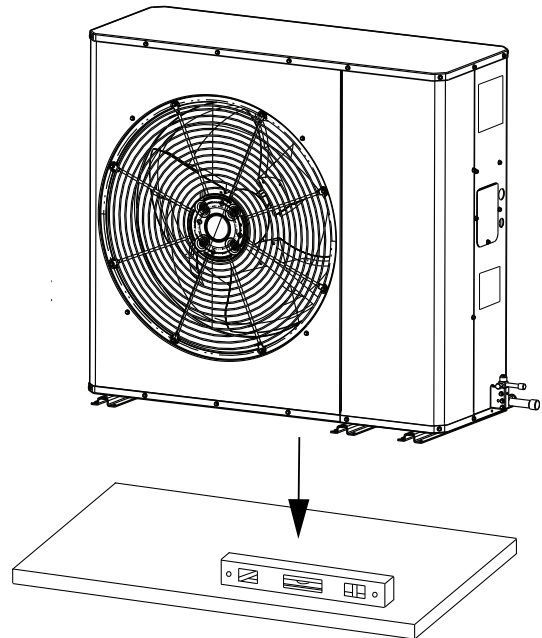

**Important: Heat Pump models should never be stacked!**

# Refrigerant Line Considerations

**Table 8. Refrigerant Line and Service Valve Connection Sizes**

Model	Rated Line Sizes		Alternate Line Sizes		Service Valve Connection Sizes	
	Vapor Line	Liquid Line	Vapor Line	Liquid Line	Vapor Line Connection	Liquid Line Connection
4A6L9024A1XXX	5/8	3/8	5/8	3/8	5/8	3/8
4A6L9036A1XXX	3/4	3/8	5/8, 3/4	3/8	3/4	3/8
4A6L9048A1XXX	7/8	3/8	3/4, 7/8	3/8	7/8	3/8
4A6L9060A1XXX	7/8	3/8	3/4, 7/8	3/8	7/8	3/8

**Table 9. Factory Charge**


These outdoor condensing units are factory charged with the system charge required for the outdoor condensing unit. See unit nameplate. Use the Subcooling charging procedure found in the outdoor unit Service Facts. Charge level can always be verified with the Refrigerant Charging Chart found in the Service Facts.

**Table 10. Required Refrigerant Line Length**

Determine required line length and lift. You will need this to determine the subcooling charging corrections later in the installation process.

Total Line Length = \_\_\_\_\_ Ft.

Total Vertical Change (lift) = \_\_\_\_\_ Ft.

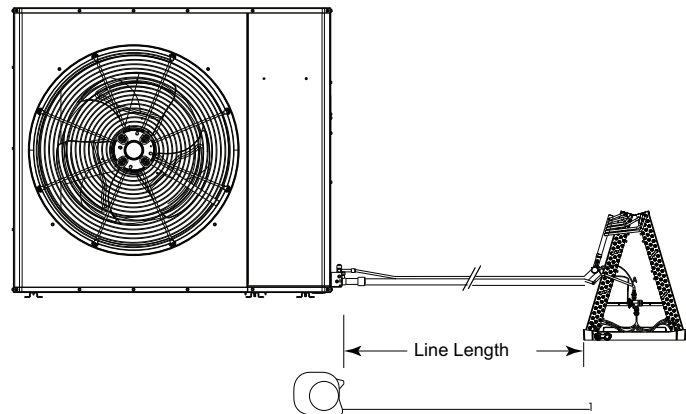


Line Length

**Table 11. Refrigerant Line Insulation**

**Important:** The Vapor Line must always be insulated. DO NOT allow the Liquid Line and Vapor Line to come in direct (metal to metal) contact.


**Note:** The gas line must always be insulated. Insulating the liquid line through attic spaces may benefit system performance by minimizing heat gain in the liquid line.

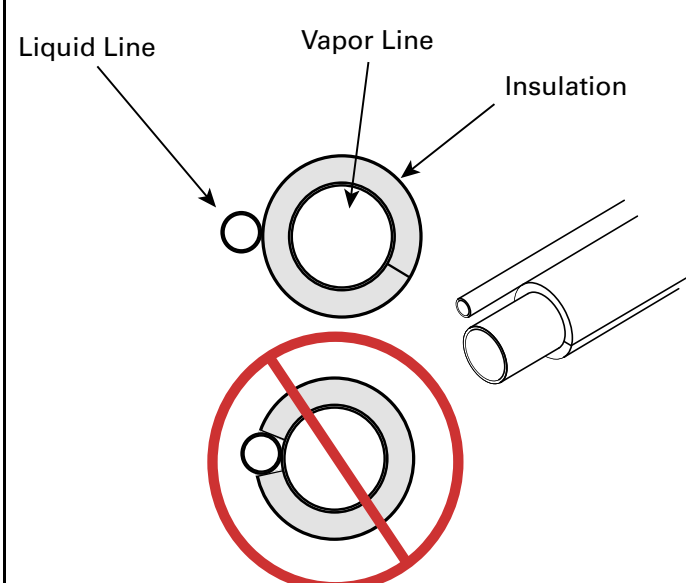

Liquid Line      Vapor Line      Insulation

## Refrigerant Line Considerations



**Table 12. Reuse Existing Refrigerant Lines**
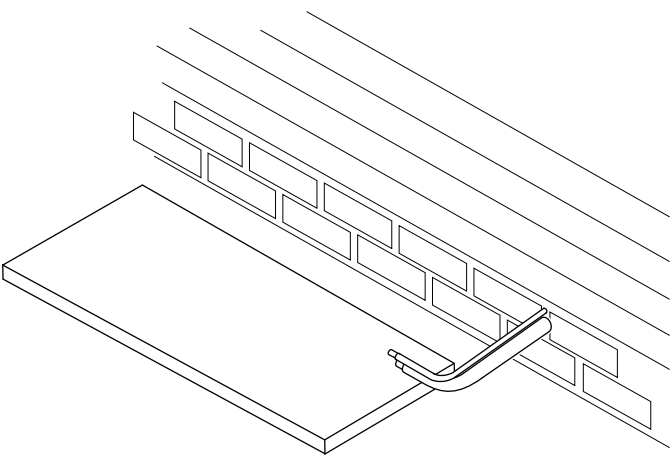
<div style="background-color: black; color: white; text-align: center; padding: 5px;"><b>⚠ CAUTION</b></div> <div style="background-color: #f0f0f0; padding: 5px;"><b>REFRIGERANT!</b></div> <p>Failure to inspect or use proper service tools may result in equipment damage or personal injury. If using existing refrigerant lines make certain that all joints are brazed, not soldered.</p> <p>For retrofit applications, where the existing indoor evaporator coil and/or refrigerant lines will be used, the following precautions should be taken.</p> <ul style="list-style-type: none"> <li>• Ensure that the indoor evaporator coil and refrigerant lines are the correct size.</li> <li>• Ensure that the refrigerant lines are free of leaks, acid, and oil.</li> </ul> <p><b>Important:</b> For more information, see publication number SS-APG006-EN</p>	
---	--

**Table 13. Refrigerant Line Routing Precautions**


<p><b>Important:</b> Comply with National, State, and Local Codes when isolating line sets from joists, rafters, walls, or other structural elements.</p> <p><b>Important:</b> Take precautions to prevent noise within the building structure due to vibration transmission from the refrigerant lines.</p> <p>For Example:</p> <ul style="list-style-type: none"> <li>• When the refrigerant lines must be fastened to floor joists or other framing in a structure, use isolation type hangers.</li> <li>• Isolation hangers should also be used when refrigerant lines are run in stud spaces or enclosed ceilings.</li> <li>• Where the refrigerant lines run through a wall or sill, they should be insulated and isolated.</li> <li>• Isolate the lines from all duct work.</li> <li>• Minimize the number of 90° turns.</li> </ul>
--

**Table 14. Isolation From Joist/Rafter**

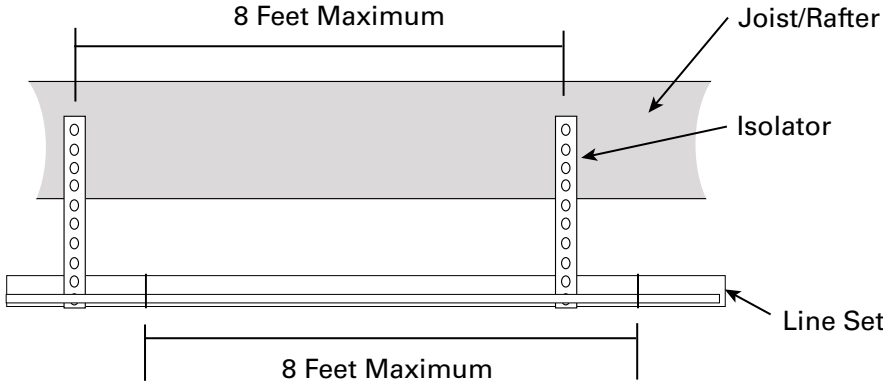
 <p>Side View</p>	 <p>8 Feet Maximum</p> <p>Joist/Rafter</p> <p>Isolator</p> <p>Line Set</p> <p>8 Feet Maximum</p>
<p>Secure Vapor Line from joists using isolators every 8 ft. Secure Liquid Line directly to insulated Vapor Line using tape, wire, or other appropriate method every 8 ft.</p>	

## Refrigerant Line Considerations

**Table 15. Isolation In Wall Spaces**

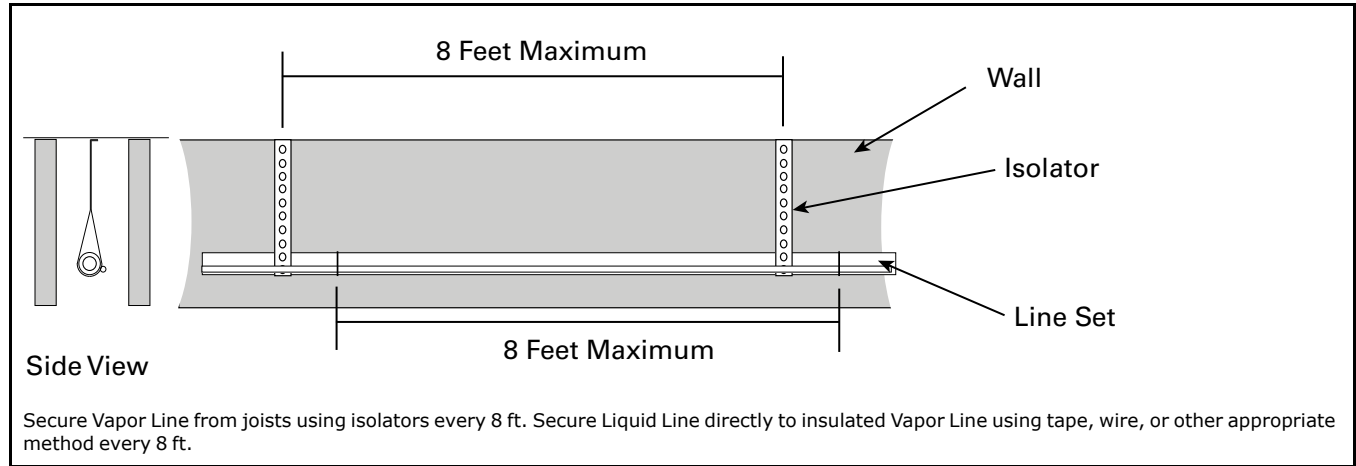

**Table 16. Isolation Through Wall**

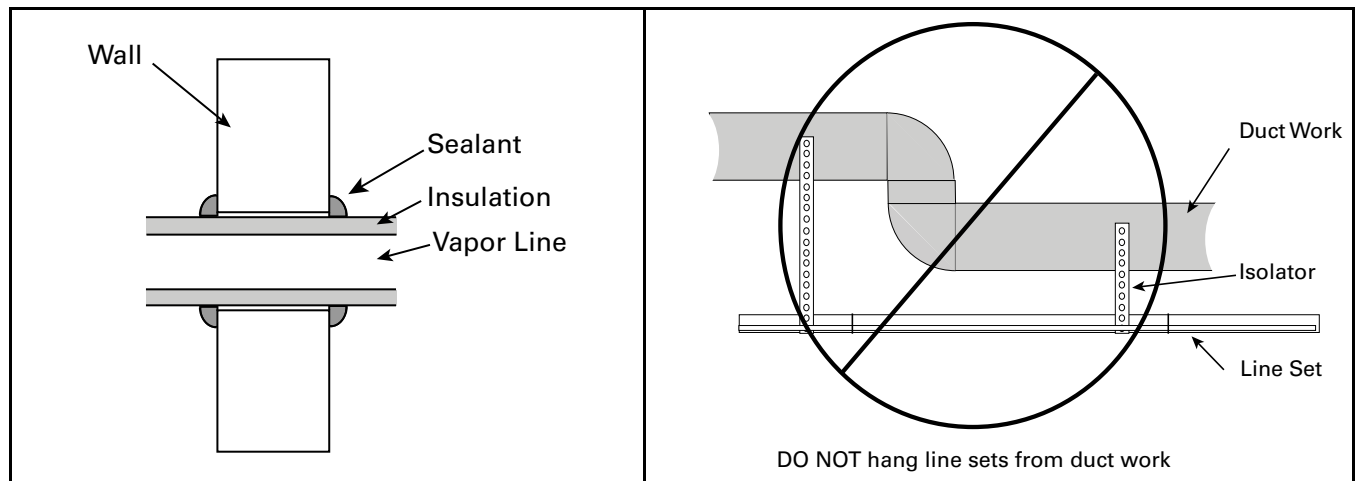

## Refrigerant Line Brazing

**Table 17. Braze the Refrigerant Lines**




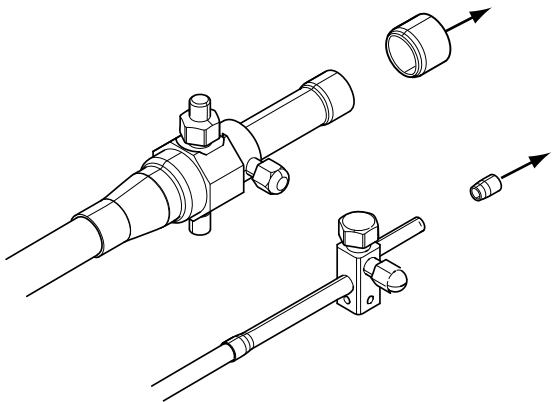
<p>1. Remove caps or plugs. Use a deburring tool to deburr the pipe ends. Clean both internal and external surfaces of the tubing using an emery cloth.</p>	 <p>The diagram illustrates the first step of the brazing process. It shows two refrigerant lines: a larger line with a service valve and a smaller line with a pressure tap. Arrows indicate the removal of caps and plugs from both valves. The caps are shown floating away from the valves.</p>
<p>2. Remove the pressure tap cap and valve core from each service valve.</p>	 <p>The diagram illustrates the second step. It shows the same two refrigerant lines. Arrows indicate the removal of the pressure tap cap and the valve core from each service valve. The caps and cores are shown floating away from the valves.</p>
<p>3. Purge the refrigerant lines and indoor coil with dry nitrogen.</p>	 <p>The diagram illustrates the third step. It shows the same two refrigerant lines. Arrows indicate the flow of dry nitrogen through the lines and the indoor coil, purging them.</p>


Table 17. Braze the Refrigerant Lines (continued)

4. Wrap a wet rag around the valve body to avoid heat damage and continue the dry nitrogen purge.
5. Braze the included filter drier to the liquid line (Heat Pump units ship with a BI-Flow Drier).
6. Continue the dry nitrogen purge. Do not remove the wet rag until all brazing is completed.

**Important:** Remove the wet rag before stopping the dry nitrogen purge.

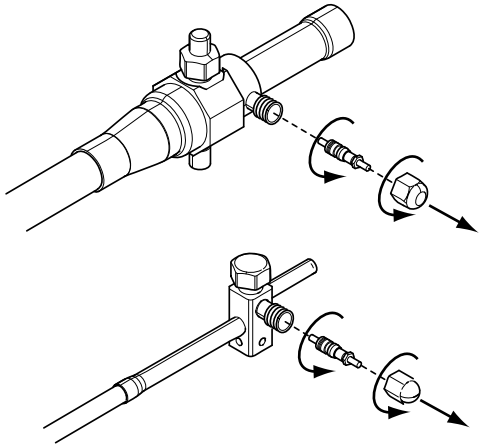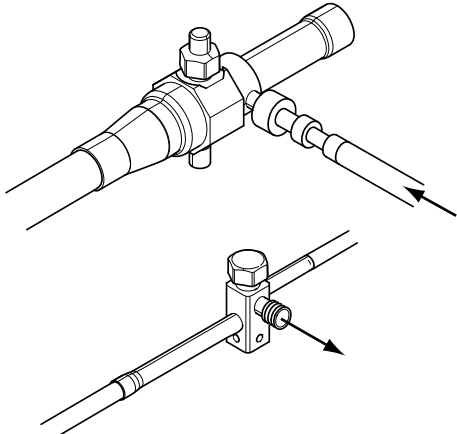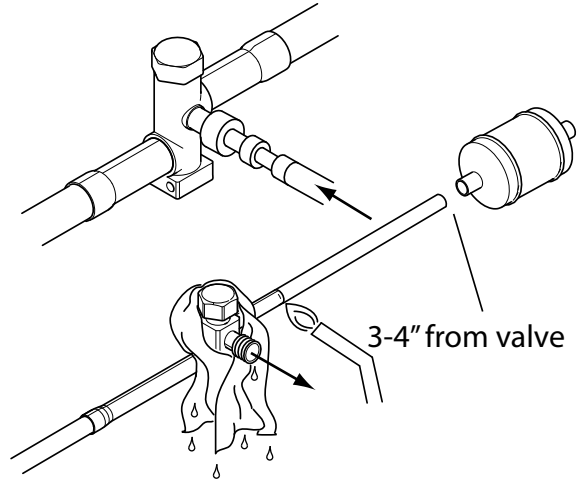



7. Replace the pressure tap valve cores after the service valves have cooled.

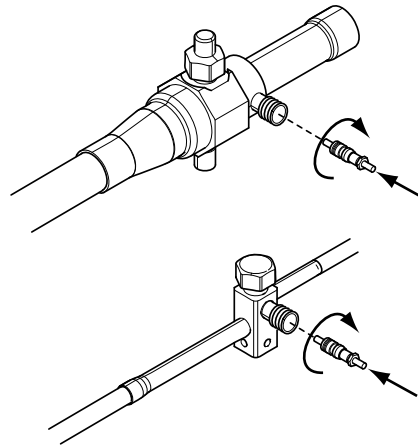



## Refrigerant Line Brazing

### Refrigerant Line Leak Check

Table 18. Check for Leaks
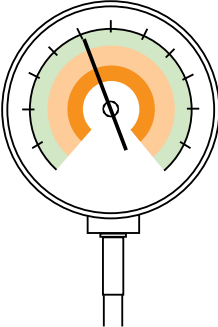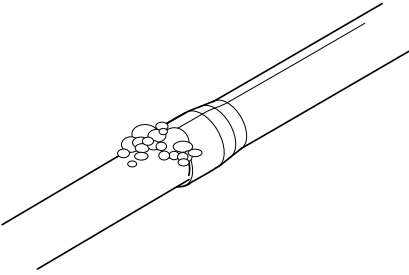
<p>1. Pressurize the refrigerant lines and evaporator coil to 150 PSIG using dry nitrogen.</p>	<p>150 PSIG</p> 
<p>2. Check for leaks by using a soapy solution at each brazed location. <b>Note:</b> Remove nitrogen pressure and repair any leaks before continuing.</p>	

### Refrigerant Line and Indoor Coil Evacuation
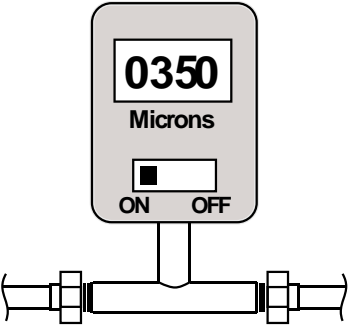
<p><b>Important:</b> Do not open the service valves until the refrigerant lines and indoor coil leak check and evacuation are complete.</p> <p>1. Evacuate until the micron gauge reads no higher than 350 microns, then close off the valve to the vacuum pump.</p>	
<p>2. Observe the micron gauge. Evacuation is complete if the micron gauge does not rise above 500 microns in one (1) minute.</p> <p>3. When evacuation is complete, blank off the vacuum pump and micron gauge, and close the valves on the manifold gauge set.</p>	

# Charging: Weigh-In Method

Weigh-In Method can be used for the initial installation, or anytime a system charge is being replaced. Weigh-In Method can also be used when power is not available to the equipment site or operating conditions (indoor/outdoor temperatures) are not in range to verify with the subcooling charging method.

**Table 19. Variable Speed Side Discharge Heat Pumps**

A	B		C		D
Model	Factory Charge		Charge adder for Indoor Coil		Charge multiplier for interconnecting refrigerant tube length (3/8" OD)
024	6 lb	8 oz	0 lb	12 oz	0.6 oz/ft
036	8 lb	0 oz	1 lb	0 oz	0.6 oz/ft
048	9 lb	0 oz	1 lb	4 oz	0.6 oz/ft
060	9 lb	0 oz	1 lb	4 oz	0.6 oz/ft

**Table 20. New Installations — Calculating Charge using the Weigh-In method:**

<ol style="list-style-type: none"> <li>1. Measure in feet the distance between the outdoor unit and the indoor unit and record on Line 1. Include the entire length of the line from the service valve to the IDU.</li> <li>2. Enter the charge multiplier from Column D.</li> <li>3. Multiply the total length of refrigerant tubing (Line 1) times the value on Step 2. Record the result on Line 3 of the Worksheet.</li> <li>4. Locate the outdoor equipment size in Column A. Record the value shown in Column C of the relevant table above.</li> <li>5. Add the values from Step 3 and Step 4 and record the resulting value. This is the amount of refrigerant to weigh-in prior to opening the service valves.</li> </ol>	<p style="text-align: center;"><b>New Installation Weigh-In Method Worksheet</b></p> <ol style="list-style-type: none"> <li>1. Line Length (ft) _____</li> <li>2. Value from Column D x .06 oz/ft _____</li> <li>3. Step 1 x Step 2 = _____</li> <li>4. Charge Adder (column C) + _____</li> <li>5. Refrigerant (Steps 3+4) = _____ oz</li> </ol>
--	---

**Table 21. Sealed-System Repairs — Calculating Charge using the Weigh-In method.**

<ol style="list-style-type: none"> <li>1. Measure in feet the distance between the outdoor unit and the indoor unit and record on Line 1. Include the entire length of the line from the service valve to the IDU.</li> <li>2. Enter the charge multiplier from Column D.</li> <li>3. Multiply the total length of refrigerant tubing (Line 1) times the value on Line 2. Record the result on Line 3 of the Worksheet.</li> <li>4. Locate the outdoor equipment size in Column A. Record the value shown in Column C of the relevant table above.</li> <li>5. Record the value in Column B to Line 5 of the Worksheet.</li> <li>6. Add the values from Step 3, Step 4, and Step 5 and record the resulting value on Line 6. This is the amount of refrigerant to weigh-in.</li> </ol>	<p style="text-align: center;"><b>New Installation Weigh-In Method Worksheet</b></p> <ol style="list-style-type: none"> <li>1. Line Length (ft) _____</li> <li>2. Value from Column D x .06 oz/ft _____</li> <li>3. Step 1 x Step 2 = _____</li> <li>4. Charge Adder (column C) + _____</li> <li>5. Factory Charge (column B) + _____</li> <li>6. Refrigerant (Steps 3+4+5) = _____ oz</li> </ol>
--	---

**Note:** The only mode approved for setting or validating system charge is using Charging Mode-Cooling. Charging Mode-Cooling is a variable speed test mode found in the 1050/950/850 comfort control Technician Menu. Outdoor Temperature must be between 55F and 120F with Indoor Temperature kept between 70F and 80F.

**Important:** VARIABLE SPEED OUTDOOR UNITS REQUIRE THE INDOOR UNIT BE CONFIGURED FOR 400 CFM/TON

# Electrical – Low Voltage


**Note:** The use of color coded low voltage wire is recommended to simplify connections between the outdoor unit, the control, and the indoor unit.

**Note:** The maximum total cable length for the entire comfort control communicating system is 500 ft. 18 AWG.

**Table 22. Low Voltage Maximum Wire Length**

CONTROL WIRING	
WIRE SIZE	MAX. WIRE LENGTH
18 AWG	500 Ft. Combined

**Table 23. Low Voltage Hook-up Diagrams**

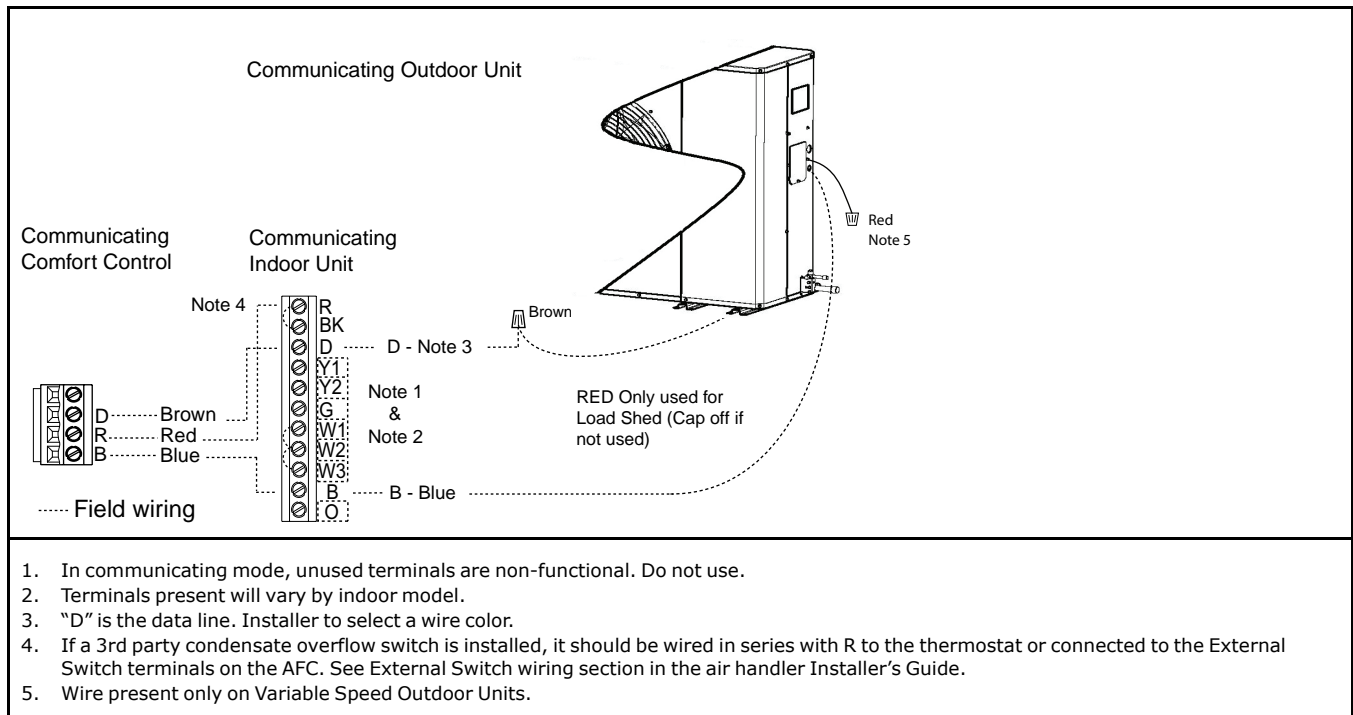

**Note:** Anti-oxidizing grease is supplied in the documentation package for use when making low voltage field wiring connections at the outdoor unit. Apply grease to field wiring before installing wire caps to protect these connections from corrosion.

# Service Valves


**Table 24. Open the Gas Service Valve**

<p><b>Important:</b> Leak check and evacuation must be completed before opening the service valves.</p> <p><b>Note:</b> Do not vent refrigerant gases into the atmosphere.</p> <ol style="list-style-type: none"> <li>1. Remove valve stem cap.</li> <li>2. Using a wrench, turn valve stem 1/4 turn counterclockwise to the fully open position.</li> <li>3. Replace the valve stem cap to prevent leaks. Tighten finger tight plus an additional 1/4 turn.</li> </ol>	<p>The diagram shows a gas service valve with a cap being removed from the valve stem. A curved arrow indicates a 1/4 turn counterclockwise rotation. Labels include: Cap, 1/4 Turn Only Counterclockwise for Full Open Position, Valve Stem, Unit Side of Valve, Pressure Tap Port, and Gas Line Connection.</p>
---	---

**Table 25. Open the Liquid Service Valve**

<div style="background-color: black; color: white; text-align: center; padding: 5px;"><b>⚠ WARNING</b></div> <p><b>SERVICE VALVES!</b></p> <p>Failure to follow this warning will result in abrupt release of system charge and may result in personal injury and/or property damage. Extreme caution should be exercised when opening the Suction and Liquid Line Service Valve. Turn valve stem counterclockwise only until the stem contacts the rolled edge. No torque is required.</p> <p><b>Important:</b> Leak check and evacuation must be completed before opening the service valves.</p> <ol style="list-style-type: none"> <li>4. Remove service valve cap.</li> <li>5. Fully insert 3/16" hex wrench into the stem and back out counterclockwise until valve stem just touches the rolled edge (approximately five (5) turns).</li> <li>6. Replace the valve cap to prevent leaks. Tighten finger tight plus an additional 1/4 turn.</li> </ol>	<p>The diagram shows a liquid service valve with a cap being removed. A 3/16" hex wrench is inserted into the stem, and a curved arrow indicates a counterclockwise rotation until it reaches a rolled edge. Labels include: Cap, Unit Side of Service Valve, 3/16" Hex Wrench, Rolled Edge to Captivate Stem, Hex Headed Valve System, and Service Port.</p>
--	---

# LED Indicators – Variable Speed Side Discharge Drive

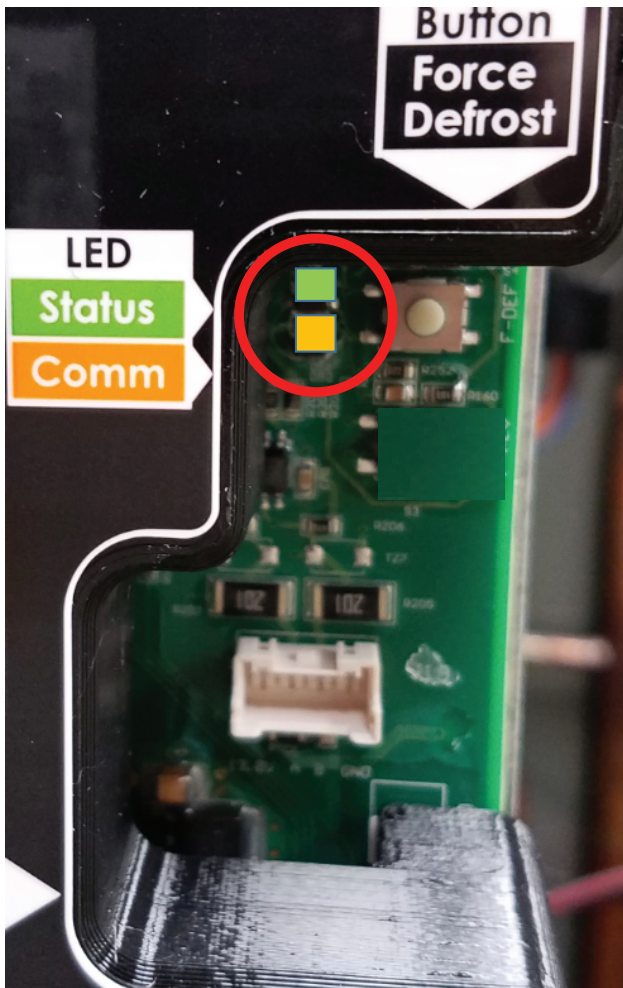


## LED'S

LED	RATE	DESCRIPTION	INDICATION
STATUS (GREEN)	SLOW	1 TIME PER SECOND	STANDBY/IDLE
	MEDIUM	2 TIMES PER SECOND	CALL FOR CAPACITY
	FAST	5 TIMES PER SECOND	POWER UP DELAY
	SOLID ON		TEST MODE
	INTERMITTENT	1 FLASH EVERY 4 SECONDS	HARD LOCKOUT


LED	RATE	DESCRIPTION	INDICATION
COMM (AMBER)	SLOW	1 TIME PER DEVICE	DEVICE COUNT
	FAST	5 TIME PER SECOND	LOSS OF COMMUNICATION

# Electrical – High Voltage


**Table 26. High Voltage Power Supply**
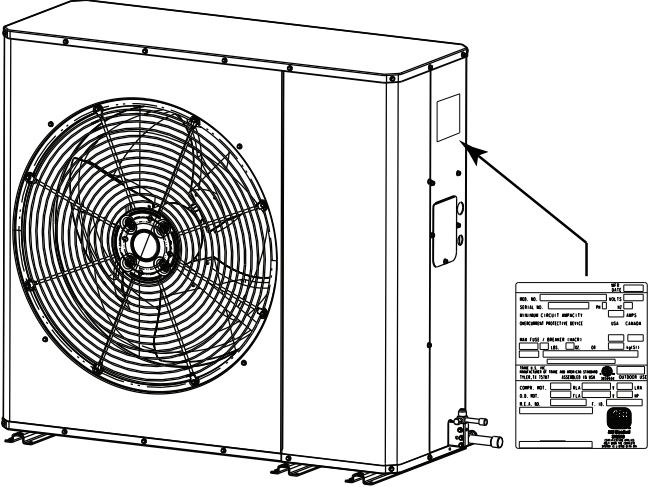
<div style="background-color: black; color: white; text-align: center; padding: 5px;"><b>⚠ WARNING</b></div> <p><b>LIVE ELECTRICAL COMPONENTS!</b> Failure to follow this Warning could result in property damage, severe personal injury, or death. Follow all electrical safety precautions when exposed to live electrical components. It may be necessary to work with live electrical components during installation, testing, servicing, and troubleshooting of this product.</p> <p>The high voltage power supply must agree with the equipment nameplate.</p> <p>Power wiring must comply with national, state, and local codes.</p> <p>Follow instructions on unit wiring diagram located on the inside of the control box cover.</p>	
--	--

**Table 27. High Voltage Disconnect Switch**
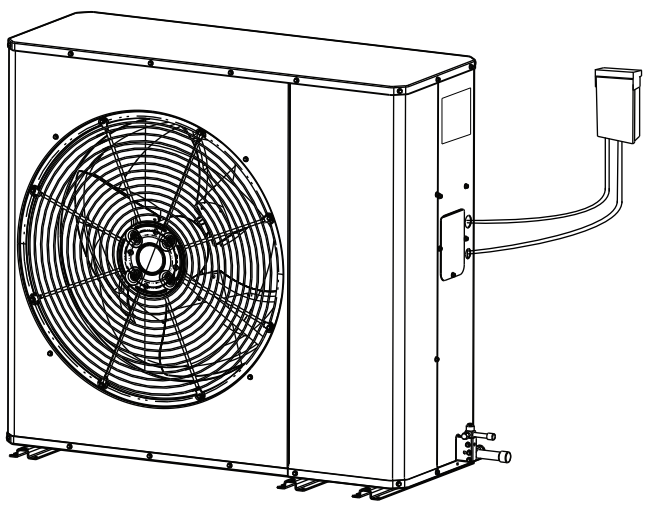
<div style="background-color: black; color: white; text-align: center; padding: 5px;"><b>⚠ WARNING</b></div> <p><b>HIGH LEAKAGE CURRENT!</b> Failure to follow this Warning could result in property damage, severe personal injury, or death. Earth connection essential before connecting electrical supply.</p> <p>Install a separate disconnect switch at the outdoor unit.</p> <p>For high voltage connections, flexible electrical conduit is recommended whenever vibration transmission may create a noise problem within the structure.</p>	
<div style="background-color: black; color: white; text-align: center; padding: 5px;"><b>⚠ WARNING</b></div> <p><b>HAZARDOUS VOLTAGE!</b> Voltage may be present with power disconnected due to high winds causing fan rotation. See Service Facts or Technical Manual for servicing instructions.</p>	


**Table 28. High Voltage Disconnect Switch**

<p>Ground the outdoor unit per national, state, and local code requirements.</p>	
--	---


# Start Up

1. Ensure you have completed the following sections. “1” through “4”


2. Set System Thermostat to OFF.

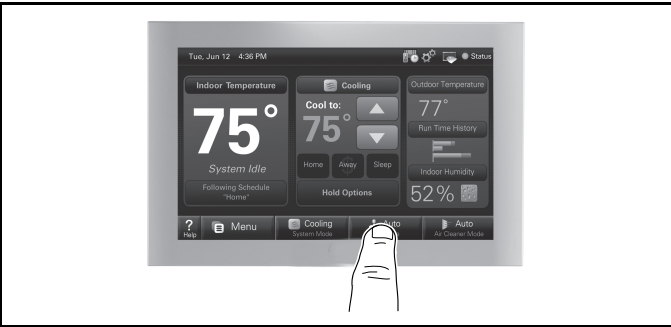

3. Turn on disconnect(s) to apply power to the indoor and outdoor units.

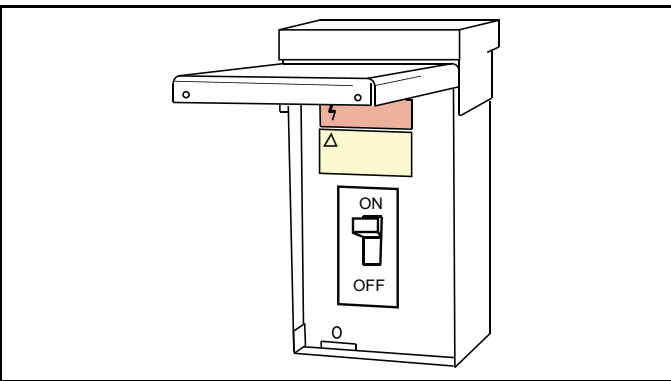

4. Wait 3 hours before starting the unit if the outdoor ambient temperature is below 85° F.

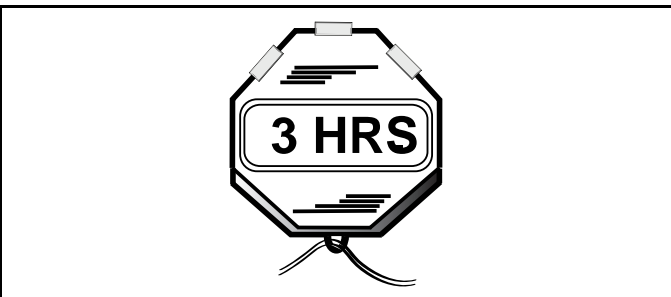

5. Run the system using the “Charging Mode-Cooling” test mode found in the 850/950/1050 comfort control. This is the only approved method for setting the system charge level by subcooling.



Follow the on-screen prompts.

**Important:** ENSURE INDOOR BLOWER IS CONFIGURED FOR 400 CFM/TON



# System Charge Adjustment

**Table 29. Temperature Measurements**

<p>Check the outdoor temperatures.</p> <p>Subcooling using <b>"Charging Mode-Cooling"</b> is the only recommended method of charging between 55 ° F and 120° F ambient outdoor temperature.</p>	
<p>For best results the indoor temperature should be kept between 70° F to 80° F.</p>	


**Table 30. Subcooling Charging Corrections**

<p>Determine the final subcooling value using total Line Length and Lift measured in "Required Refrigerant Line Length" and the "Subcooling Charging Corrections Charts."</p>	<p><b>Subcooling Charging Correction Worksheet</b></p> <p>Total Line Length (ft) _____</p> <p>Total Vertical Charge (lift) _____ <i>(Values from — Required Refrigerant Line Length)</i></p> <p>Design Subcooling Value _____ <i>(from nameplate or Service Facts)</i></p> <p><b>Final Subcooling Value</b> _____</p>
---	---

## Charging and Correction Charts


R-410A REFRIGERANT CHARGING CHART							
LIQUID TEMP (°F)	DESIGN SUBCOOLING (°F)						
	8	9	10	11	12	13	14
	LIQUID GAGE PRESSURE (PSI)						
55	179	182	185	188	191	195	198
60	195	198	201	204	208	211	215
65	211	215	218	222	225	229	232
70	229	232	236	240	243	247	251
75	247	251	255	259	263	267	271
80	267	271	275	279	283	287	291
85	287	291	296	300	304	309	313
90	309	313	318	322	327	331	336
95	331	336	341	346	351	355	360
100	355	360	365	370	376	381	386
105	381	386	391	396	402	407	413
110	407	413	418	424	429	435	441
115	435	441	446	452	458	464	470
120	464	470	476	482	488	495	501
125	495	501	507	514	520	527	533

**Table 31. Subcool Charging Correction Charts**

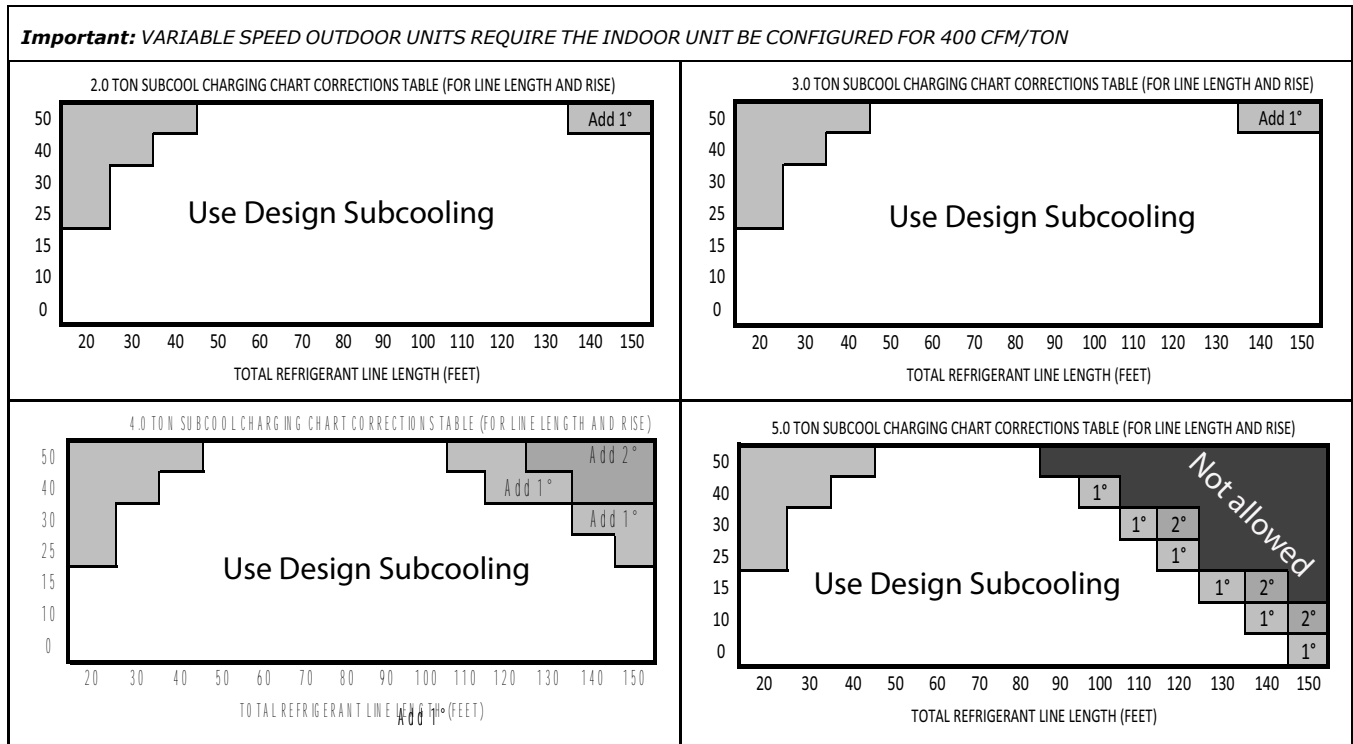


# Charging the Unit


**Table 32. Stabilize the system**

<p>1. Wait 20 minutes for the system condition to stabilize between adjustments.</p> <p><b>Note:</b> When the Liquid Line Temperature and Gage Pressure approximately match the chart, the system is properly charged.</p> <p>2. Remove gauges.</p> <p>3. Replace service port caps to prevent leaks. Tighten finger tight plus an additional 1/4 turn.</p>	
---	---

**Table 33. Proper Gage Pressure**
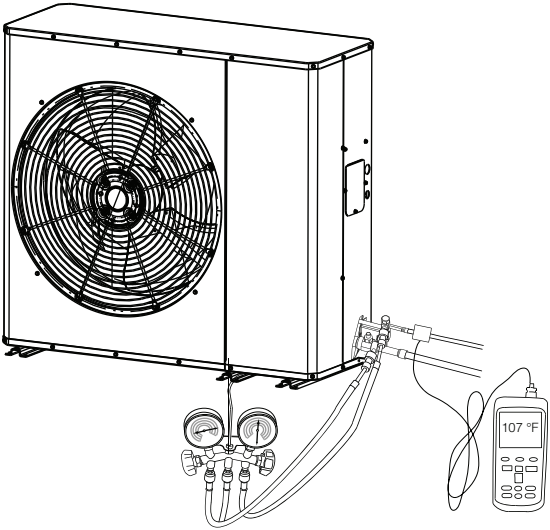
<p>Measure the liquid line temperature and pressure at the outdoor unit's service valve.</p> <p>Measure Liquid Line Temp = _____ °F</p> <p>Liquid Gage Pressure = _____ PSI</p> <p>Final Subcooling Value = _____ °F</p>	
--	---

**Table 34. Verify Performance**
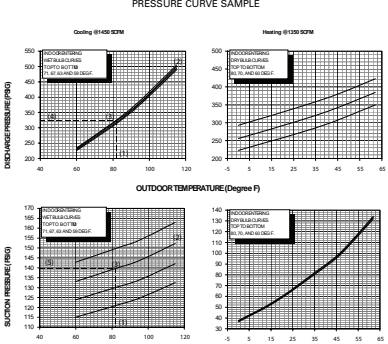
<p>4. Refer to System Pressure Curves in the Service Facts document to verify typical performance.</p>	<p><b>PRESSURE CURVE SAMPLE</b></p> 
--	--

## Charging the Unit


**Table 35. Proper Gage Pressure**

Using the “V” adjust refrigerant level to attain proper gage pressure.

Add refrigerant if the Liquid Gage Pressure is lower than the chart value.

5. Connect gauges to refrigerant bottle and unit as illustrated.
6. Purge all hoses.
7. Open bottle.
8. Stop adding refrigerant when liquid line temperature and Liquid Gage Pressure match the charging chart.

**Note:** Recover refrigerant if the Liquid Gage Pressure is higher than the chart value.

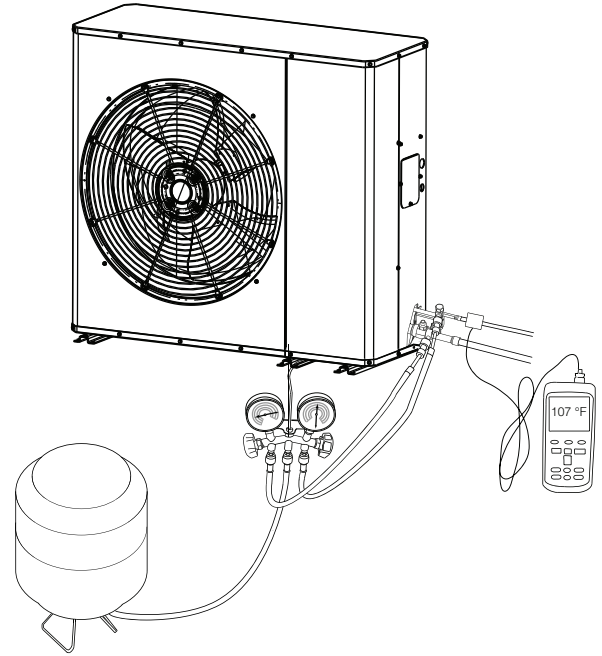

**Table 36. System Information**

9. Record system pressures and temperatures after charging is complete.

Outdoor model number = \_\_\_\_\_

Measured Outdoor Ambient = \_\_\_\_\_ °F

Measured Indoor Ambient = \_\_\_\_\_ °F

Measured Liquid Line Temp = \_\_\_\_\_ °F


Measured Suction Line Temp = \_\_\_\_\_ °F

Indoor Wet Bulb = \_\_\_\_\_ °F

Liquid Gage Pressure = \_\_\_\_\_ PSIG

Suction Gage Pressure = \_\_\_\_\_ PSIG

# Communicating Display Assembly (CDA)

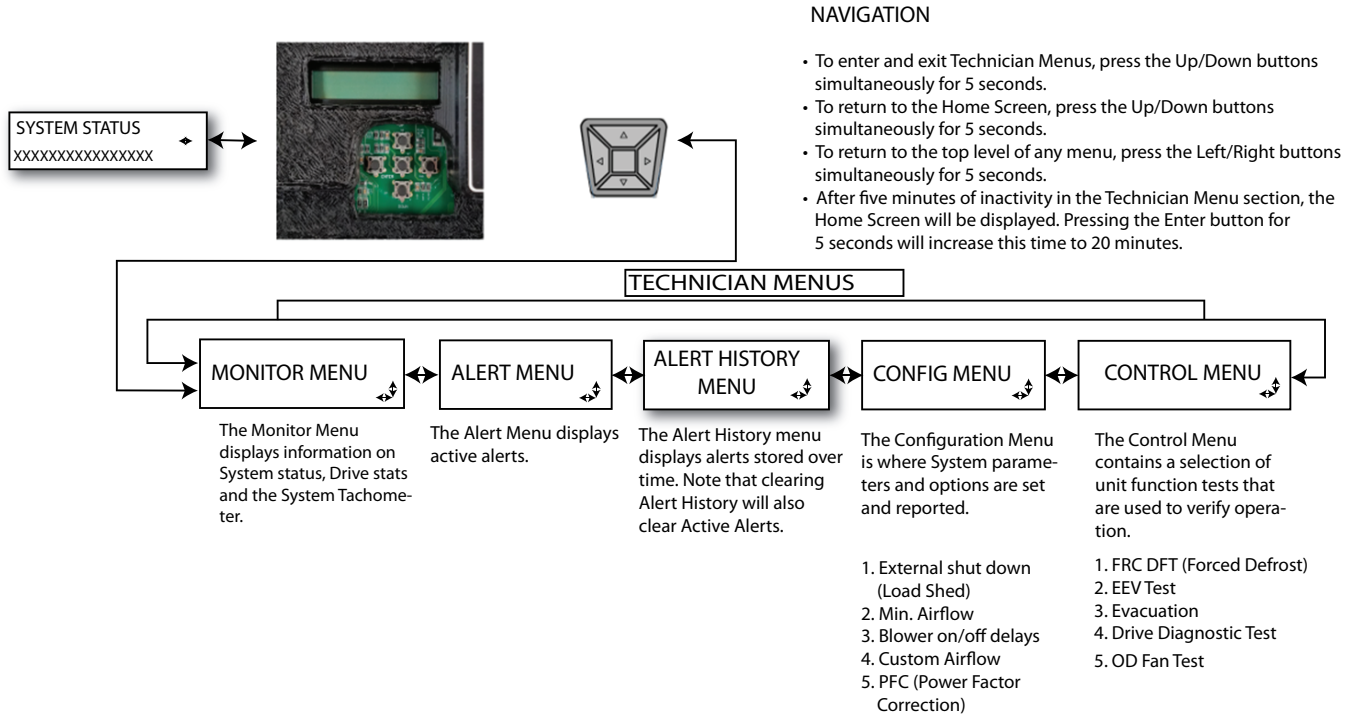

## Defrost Control (HP Only)

**Demand Defrost** The demand defrost control measures heat pump outdoor ambient temperature with a sensor located outside the outdoor coil. A second sensor located on the outdoor coil is used to measure the coil temperature. The difference between the ambient and the colder coil temperature is the difference or delta-T measurement. This delta-T measurement is representative of the operating state and relative capacity of the heat pump system. By measuring the change in delta-T, we can determine the need for defrost. The coil sensor also serves to sense outdoor coil temperature for termination of the defrost cycle.

### Fault Identification

A fault condition is indicated by the CDA connected to the control board inside the heat pump control box.

### Defrost Enabled

Demand Defrost is enabled with the following inputs to the drive::

- Outdoor ambient temperature sensor (ODS-B) reporting an outdoor temperature at or below 52° F.
- Coil temperature sensor (CBS) reporting a coil temperature at or below 32° F.
- Heat/Cool Demand (HCD) from the communicating comfort control for at least two minutes or more.


### Defrost Initiation

The calculated temperature difference between the outdoor temperature sensor and the coil temperature sensor is called Delta T. Defrost can occur once the current Delta T exceeds the Delta T initiate value. This adaptive logic assures a complete defrost for a range of outdoor temperatures.

**Note:** There are three (3) defrost termination temperature selections available in the Configure Menu. Factory is set to 47°F, medium is 53°F, and high is 60°F.

### CDA Navigation to Forced Defrost

Figure 1. CDA Mini Menu

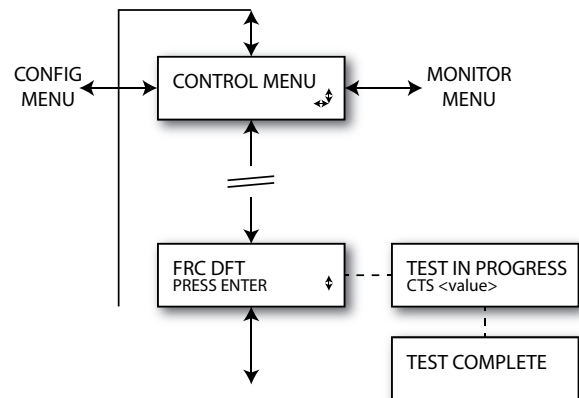

**NOTES: Forced Defrost**

## Communicating Display Assembly (CDA)

1. System must be running with demand from the thermostat.
2. FRC DFT TEST can be initiated in heat mode only.
3. Press ENTER to begin forced defrost.
4. Execute Forced Defrost following Forced Defrost (Defrost terminates on Coil Temperature or maximum time override of 15 minutes).
5. When test begins, TEST IN PROGRESS displays on line 1 and Coil Temperature value on line 2.


**Note:** Home Screen, under System Status will display DEFROST.

6. When test is complete, TEST COMPLETE displays for 10 seconds.
7. If there is a defrost fault condition, test terminates and sends alert to the alert menu.
8. For more information, refer to the Alert Code Tables in Service Facts and Technical Service Manual (Pub. No. 34-4103-04) documents.

**Note:** Screens will update as the test proceeds.

**Note:** For Variable Speed Side Discharge models, Forced Defrost is selected either in the CDA or from the FRC DFT button on the VSPD Side Discharge AOC.

Figure 2. Force Defrost Button

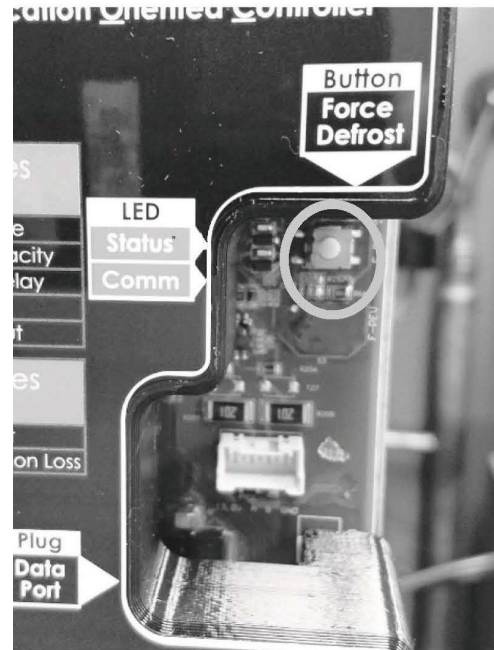

## Checkout Procedures

The final phase of the installation is the system Checkout Procedures. The following list represents the most common items covered in a Checkout Procedure. Confirm all requirements in this document have been met.

<ul style="list-style-type: none"><li><input type="checkbox"/> All wiring connections are tight and properly secured.</li><li><input type="checkbox"/> Voltage and running current are within limits.</li><li><input type="checkbox"/> All refrigerant lines (internal and external to equipment) are isolated, secure, and not in direct contact with each other or structure.</li><li><input type="checkbox"/> All braze connections have been checked for leaks. A vacuum of 350 microns provides confirmation that the refrigeration system is leak free and dry.</li><li><input type="checkbox"/> Final unit inspection to confirm factory tubing has not shifted during shipment. Adjust tubing if necessary so tubes do not rub against each other or any component when unit runs.</li><li><input type="checkbox"/> Ductwork is sealed and insulated.</li><li><input type="checkbox"/> All drain lines are clear with joints properly sealed. Pour water into drain pan to confirm proper drainage. Provide enough water to ensure drain trap is primed.</li></ul>	<ul style="list-style-type: none"><li><input type="checkbox"/> Supply registers and return grilles are open, unobstructed, and air filter is installed.</li><li><input type="checkbox"/> Indoor blower and outdoor fan are operating smoothly and without obstruction.</li><li><input type="checkbox"/> Indoor blower motor set on correct speed setting to deliver required CFM. "Blower and fan set screws are tight."</li><li><input type="checkbox"/> Cover panels are in place and properly tightened.</li><li><input type="checkbox"/> For gas heating systems, manifold pressure has been checked and all gas line connections are tight and leak free.</li><li><input type="checkbox"/> For gas heating systems, flue gas is properly vented.</li><li><input type="checkbox"/> System functions safely and properly in all modes.</li><li><input type="checkbox"/> Owner has been instructed on use of system and given manual.</li></ul>
--	---



Ingersoll Rand (NYSE: IR) advances the quality of life by creating comfortable, sustainable and efficient environments. Our people and our family of brands – including Club Car®, Ingersoll Rand®, Thermo King® and Trane® – work together to enhance the quality and comfort of air in homes and buildings; transport and protect food and perishables; and increase industrial productivity and efficiency. We are a global business committed to a world of sustainable progress and enduring results.



[ingersollrand.com](http://ingersollrand.com)



The AHRI Certified mark indicates Ingersoll Rand participation in the AHRI Certification program. For verification of individual certified products, go to [www.ahridirectory.org](http://www.ahridirectory.org).

Ingersoll Rand has a policy of continuous product and product data improvements and reserves the right to change design and specifications without notice.

We are committed to using environmentally conscious print practices.